

TECHNICAL PUBLICATION SJ 90-2

RAINFALL ANALYSIS FOR NORTHEAST FLORIDA

**PART IV: FREQUENCY ANALYSIS OF
WARM SEASON AND COLD SEASON RAINFALL**



**ST. JOHNS RIVER WATER MANAGEMENT DISTRICT
P.O. BOX 1429 PALATKA, FLORIDA 32178-1429**

Technical Publication SJ 90-2

RAINFALL ANALYSIS FOR NORTHEAST FLORIDA
PART IV: FREQUENCY ANALYSIS OF
WARM SEASON AND COLD SEASON RAINFALL

By

Donthamsetti V. Rao

S. Abe Jenab

and

David A. Clapp

St. Johns River Water Management District

Palatka, Florida

1990

Project No. 10 200 02

CONTENTS

LIST OF FIGURES.....	v
INTRODUCTION.....	1
BASIC DATA	5
RAINFALL SEASONS	7
Warm Season Rainfall	7
Cold Season Rainfall	7
Wet and Dry Season Rainfall	10
FREQUENCY ANALYSIS	11
ISOPLUVIAL MAPS	15
REFERENCES	17



FIGURES

FIGURE		PAGE
1	State of Florida water management districts	2
2	Rain gage stations used in this study	9
3	Maximum and minimum events at desired probability level	12

INTRODUCTION

Rainfall data are an essential element of basic data input to many hydrologic and engineering studies. Peak rainfall data are used in designing stormwater management systems and in determining the flooding potential of various frequency storm events. Daily or hourly data are required in continuous hydrologic simulation procedures. Monthly and seasonal rainfall data are used in determining supplementary irrigation water requirements, and in engineering studies related to storage analyses, water supply, and reservoir management.

The St. Johns River Water Management District (SJRWMD) (Fig. 1) is responsible for management of the water resources of the District, which includes all or parts of nineteen counties in northeast Florida. The District makes extensive use of rainfall data in its consumptive use and management and storage of surface waters (MSSW) permit activities and in its hydrologic and engineering studies related to surface water basin management plans. For example, in the SJRWMD's consumptive use program, agricultural withdrawals are permitted based on certain monthly and/or seasonal drought conditions. Also, when certain thresholds are exceeded, surface water management systems are required to satisfy conditions based on the 10- and 25-year maximum storm discharges and the 100-year flood elevation.

This project, "Rainfall Analysis for Northeast Florida," has been undertaken to fulfill the needs of the District and to

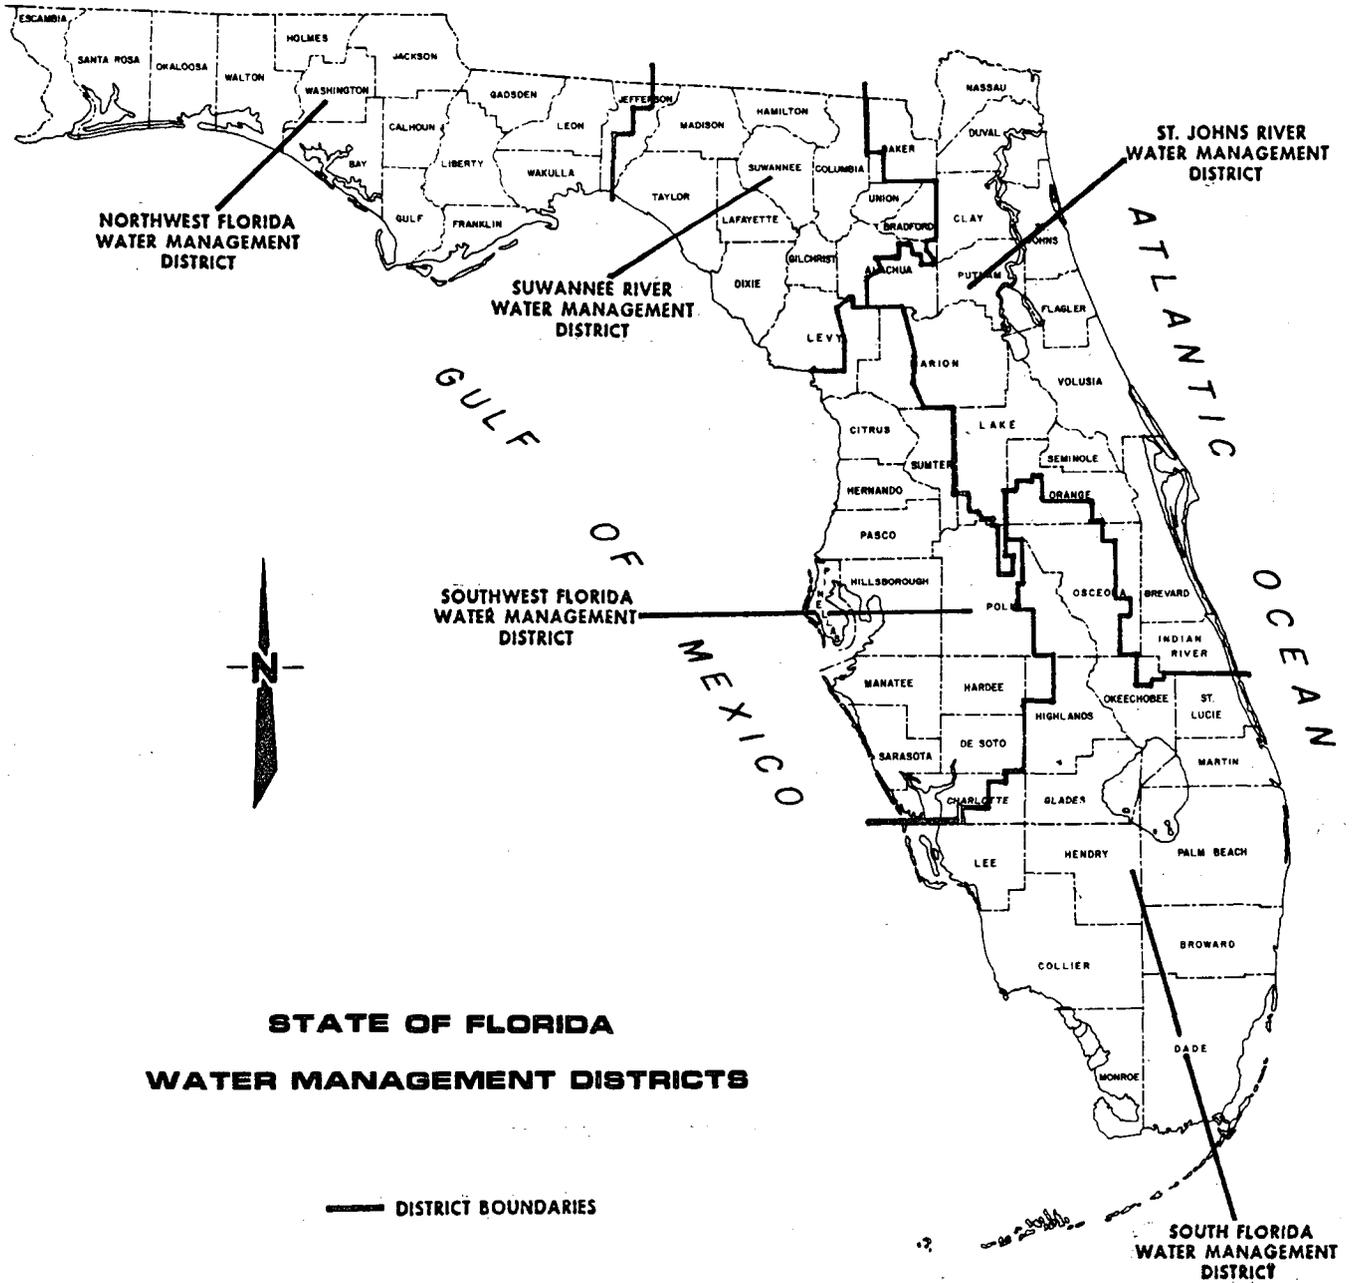


Figure 1. State of Florida water management districts

4

provide the same information to interested organizations and individuals. The project objective is the production of a series of reports, each report based on the collection and detailed analysis of rainfall data and directed at a specific hydrologic/engineering study goal. This report, presenting the results of frequency analysis of warm season and cold season rainfall, is Part IV of the series. The series consists of six reports. The first three reports present basic rainfall data and the final three reports present the results of specific analyses. (Part I) 24-Hour to Ten-Day Maximum Rainfall Data; (Part II) Summary of Monthly and Annual Rainfall Data; (Part III) Seasonal Rainfall Data; (Part IV) Frequency Analysis of Warm Season and Cold Season Rainfall; (Part V) Frequency Analysis of Wet Season and Dry Season Rainfall; and (Part VI) 24-Hour to 96-Hour Maximum Rainfall for Return Periods 10 years, 25 years, and 100 years.



BASIC DATA

The main sources of rainfall data for northeast Florida are the publications of the National Oceanic and Atmospheric Administration, NOAA [formerly the U. S. Weather Bureau (through 1965) and the Environmental Sciences Services Administration (1965-1970)]. The rainfall recording program in northeast Florida was initiated in the latter half of the 1800s. The monthly bulletins titled Climatological Data provide daily precipitation data. Hourly rainfall data are published in Hydrologic Bulletin (1940-1948), Climatological Data (1948-1951), and since 1951 in the monthly publications titled Hourly Precipitation Data. State and local agencies including the SJRWMD and some other organizations also maintain rain gage stations. This project uses primarily NOAA rain gage stations. Data collected by the SJRWMD and other organizations are used to estimate missing data or to extend data for discontinued stations.

Monthly rainfall data are readily available (in summary form) in the NOAA publications entitled Climatic Summary of the United States and the Annual Summaries of Climatological Data. Data from these publications were compiled with updates, as necessary, and published as Part II of this series, "Summary of Monthly and Annual Rainfall Data" (Jenab et al. 1986). The same data were used to compute the seasonal rainfall data presented in Part III of this series, "Seasonal Rainfall Data" (Rao et al.

1989). A frequency analysis was performed on these data to estimate maximum and minimum seasonal rainfall values for various return periods.

RAINFALL SEASONS

Based on rainfall distributions for northeast Florida, a year can be divided into a rainy or wet season (June-October) and a dry season (November-May). In addition, the warm season (June-September) and cold season (December-March) rainfall are of interest in agricultural studies related to crop consumptive use. This report estimates maximum and minimum rainfall totals for various return periods for two of these seasons (wet season and dry season). The seasonal rainfall data presented for 43 long-term stations in Part III of this series were used in frequency analysis. The names of these rain gage stations are given in Table 1; their locations are shown in Figure 2.

Warm Season Rainfall

During the four warmest months of the year, June through September, crops have their highest consumptive use requirements. In Florida, this season is also the wettest period of the year. The distribution of warm season rainfall determines the supplemental irrigation needs of the summer crops. This information is used by the SJRWMD in permitting agricultural irrigation water withdrawals.

Cold Season Rainfall

The four coldest months of the year, December through March,

Table 1. Rain gage stations used in this study

<u>PRINCIPAL STATION AND COUNTY</u>	<u>NOAA NUMBER</u>	<u>PERIOD OF RECORD</u>	<u>SUPPLEMENTARY STATIONS</u>
AVON PARK (HIGHLANDS)	0369	(1902-1984)	
BARTOW (POLK)	0478	(1887-1984)	
BITHLO (ORANGE)	0758	(1947-1984)	CHRISTMAS*
BUSHNELL 2E. (SUMTER)	1163	(1937-1984)	
CLERMONT (LAKE)	1641	(1893-1984)	
CRESCENT CITY (PUTNAM)	1978	(1897-1984)	
DAYTONA BEACH AIRPORT (VOLUSIA)	2158	(1923-1984)	NEW SMYRNA BCH*
DELAND (VOLUSIA)	2229	(1909-1984)	ORANGE CITY*
FEDERAL POINT (PUTNAM)	2915	(1892-1984)	
FELLSMERE (INDIAN RIVER)	2936	(1912-1984)	
FERNANDINA BCH. (NASSAU)	2944	(1902-1984)	
FORT DRUM (OKEECHOBEE)	3137	(1943-1984)	
FT. PIERCE (ST. LUCIE)	3207	(1901-1984)	
GAINESVILLE (ALACHUA)	3321	(1897-1984)	UNIV. OF. FLA.*
GLEN ST. MARY (BAKER)	3470	(1896-1984)	
HART LAKE (ORANGE)	3840	(1943-1978)	
HIGH SPRINGS (ALACHUA)	3956	(1945-1984)	
HILLIARD (NASSAU)	3978	(1909-1984)	FOLKSTON*
INVERNESS (CITRUS)	4289	(1899-1984)	
ISLEWORTH (ORANGE)	4332	(1916-1982)	WINTER GARDEN*
JACKSONVILLE AIRPORT (DUVAL)	4358	(1867-1984)	JAX CITY*
JACKSONVILLE BCH. (DUVAL)	4366	(1945-1984)	
KISSIMMEE (OSCEOLA)	4625	(1892-1984)	KISSIM FLD STA*
LAKE ALFRED EXP.STA. (POLK)	4707	(1925-1984)	
LAKE CITY (COLUMBIA)	4731	(1893-1984)	
LAKELAND WSO CI (POLK)	4797	(1915-1984)	
LISBON (LAKE)	5076	(1891-1984)	EUSTIS*
LYNNE (MARION)	5237	(1942-1984)	
MARINELAND (FLAGLER)	5391	(1942-1984)	
MELBOURNE (BREVARD)	5612	(1939-1984)	
MOUNTAIN LAKE (POLK)	5973	(1922-1984)	
NITTAW (OSCEOLA)	6251	(1943-1984)	
OCALA (MARION)	6414	(1891-1984)	
OKEECHOBEE (OKEECHOBEE)	6485	(1913-1984)	
ORLANDO WSO MCCOY (ORANGE)	6628	(1892-1984)	ORLANDO*
PALATKA (PUTNAM)	6753	(1923-1984)	PALATKA SJRWMD*
ST. AUGUSTINE R.TWR (ST.JOHNS)	7826	(1877-1984)	ST.AUGUSTINE*
SANFORD EXP.STA. (SEMINOLE)	7982	(1913-1984)	SANFORD*
STARKE (BRADFORD)	8527	(1896-1984)	CAMP BLANDING*
TITUSVILLE (BREVARD)	8942	(1878-1984)	MERRITT ISLAND*
USHER TOWER (LEVY)	9120	(1956-1984)	
VERO BCH. (INDIAN RIVER)	9219	(1943-1984)	VERO BCH AIRPT*
WINTER HAVEN (POLK)	9707	(1941-1984)	

* - DATA COMBINED WITH PRINCIPAL STATION DATA

coincide with the period of lowest precipitation in northeast Florida (about 22 percent of the annual rainfall). The distribution of cold season rainfall is useful for estimating the irrigation requirements of winter crops and the water needed for frost and freeze protection. The SJRWMD uses this information for allocating cold season agricultural irrigation water withdrawals.


Wet and Dry Season Rainfall

The five months June through October receive about 60 percent of the annual rainfall in northeast Florida and are thus considered the wet season of the year. The seven-month period November through May is considered the dry season. Wet season, dry season, and annual rainfall data provide information for comparing current rainfall with historic extremes and making certain managerial decisions, e.g., whether a water shortage warning should be declared when rainfall is less than, for example, a 50-year low. These seasonal rainfall values also are useful in storage analysis, water supply studies, and reservoir planning. The results of frequency analysis of wet and dry season rainfall are presented in Part V of this series.

FREQUENCY ANALYSIS

This report presents both maximum and minimum seasonal rainfall values for return periods, $T = 5$ yr, 10 yr, 25 yr, and 100 yr. The methodology for estimating maximum and minimum values consists of choosing an appropriate probability distribution and fitting it to data samples by one of the available statistical procedures. The fitted distribution provides the magnitudes of the events (x) at desired probability levels. The maximum events are determined from an annual exceedance probability, P (i.e., in a given year, there is a $100P$ percent chance that the actual rainfall may equal or exceed the value, X_P . See Figure 3.) The minimum values are determined from the non-exceedance probability, P' (Figure 3).

Several probability distributions have been used to determine the frequencies of hydrologic variables (Chow 1964, Markovic 1965, Matalas 1963). These vary in complexity from the simple two-parameter Gumbel distribution (1958) to the five-parameter Wakeby distribution (Houghton 1978). A distribution widely used in storm rainfall analysis (Hershfield 1961 and Miller 1964) is the Extreme Value Type I distribution using a fitting procedure suggested by Gumbel (the Gumbel Method). This distribution, however, has some properties which are not hydrologically appealing. It inherently has a constant skewness coefficient ($CS = 1.14$) and its lower bound extends to $-\infty$. The latter property implies that part of the data should be negative.

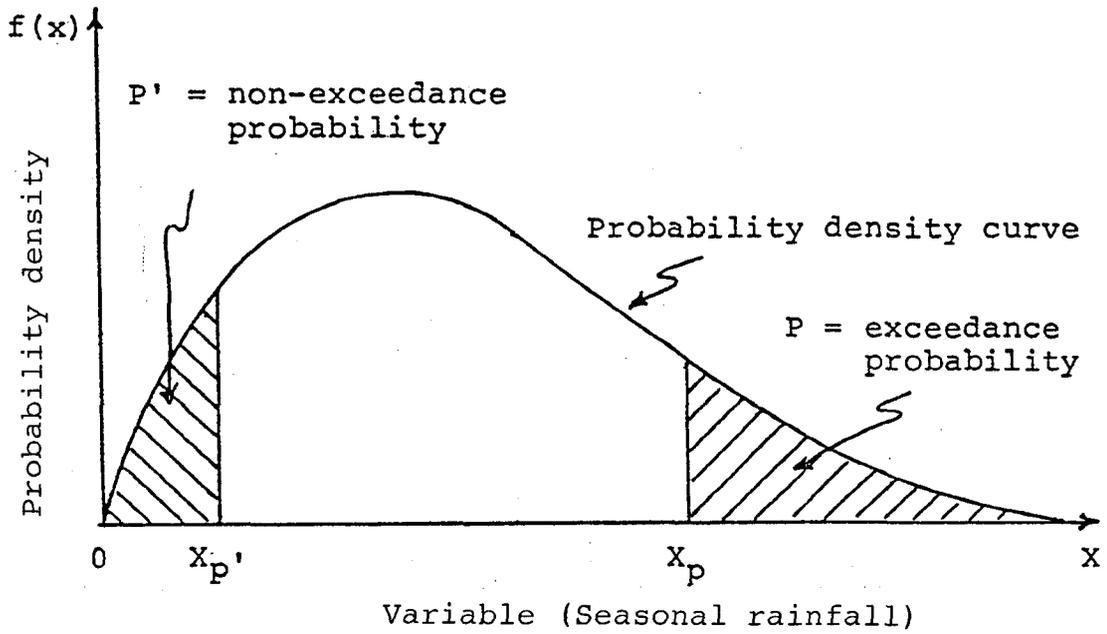

$x_{p'}$ = Minimum event; $T = 1/P'$

x_p = Maximum event; $T = 1/P$

Figure 3. Maximum and minimum events at desired probability level

At a coefficient of variation $CV = 0.5$, theoretically 0.07 percent of the data represented by the Gumbel distribution is negative, but this percentage increases to 13 percent at $CV = 1.0$. Rao (1981) quantitatively illustrates how these inconformities of Gumbel distribution with real data affect the design estimates. For the seasonal rainfall data samples analyzed in this study, the skewness coefficient had a range of -0.5 to 5.0, and CV varied from 0.15 to 1.22. Gumbel's suggested fitting procedure was also found to be misleading. Therefore, the use of the method was discouraged by Lettenmaier and Burges (1982).

The Log Pearson Type 3 distribution, a more flexible (three-parameter) distribution than the Gumbel, is selected for this study. The applicability of this distribution to hydrologic data was discussed at length by Bobee (1975) and Rao (1980a).

For each station, the Log Pearson Type 3 distribution was fit to warm season and cold season rainfall data by the Method of Mixed Moments-1 (MXM1). The MXM1 method has been found to possess superior statistical properties (Rao 1980, 1983; Arora and Singh 1989). The method was described in detail elsewhere (Rao 1986, 1988).

The maximum seasonal rainfall values for various return periods were taken directly from the Log Pearson fit. However, in the case of minimum values, a theoretical distribution may not always provide a satisfactory fit (Riggs, 1972). For this reason, the minimum values were always plotted on normal probability paper using the Weibul plotting position formula and

compared with the Log Pearson fit. Where the plotted data deviated significantly from the Log Pearson fit, greater weight was given to plotted data in determining low rainfall values for different return periods.

ISOPLUVIAL MAPS

The results of this study are presented as isopluvial maps, i.e., maps showing lines of equal rainfall for the study area (northeast Florida). Drawing isopluvial lines through a field of rainfall frequency data is similar to drawing contour maps for a land surface area from topographic survey data. In developing these maps, the isopluvial lines were initially drawn by a Tektronix plotter using the District-developed MCONTOUR computer program. The Tektronix plots were manually smoothed and extended and/or adjusted where necessary to produce the final isopluvial maps.

This report presents the following isopluvial maps:

- o Annual normal rainfall (Fig. 4)
- o Annual maximum rainfall for return periods $T = 5$ yr, 10 yr, 25 yr, 50 yr, and 100 yr (Figs. 5-9)
- o Annual minimum rainfall for return periods $T = 5$ yr, 10 yr, 25 yr, 50 yr, and 100 yr (Figs. 10-14)
- o Warm season normal rainfall (Fig. 15)
- o Warm season maximum rainfall for return periods $T = 5$ yr, 10 yr, 25 yr, 50 yr, and 100 yr (Figs. 16-20)
- o Warm season minimum rainfall for return periods $T = 5$ yr, 10 yr, 25 yr, 50 yr, and 100 yr (Figs. 21-25)
- o Cold season normal rainfall (Fig. 26)
- o Cold season maximum rainfall for return periods $T = 5$ yr, 10 yr, 25 yr, 50 yr, and 100 yr (Figs. 27-31)

- o Cold season minimum rainfall for return periods $T = 5$ yr, 10 yr, 25 yr, 50 yr, and 100 yr (Figs. 32-36)

The normal rainfall, which is revised for each decade, is an accepted standard for comparing the current rainfall conditions. For the decade of 1981-1990, the average for 1951-1980 is the normal. The normal rainfall charts (Figs. 4, 5, and 26) and the other T-yr seasonal rainfall maps presented in this report provide a means for determining how dry (or how wet) the rainfall conditions of a given season (or a year) are. Other seasonal values like 5-yr or 10-yr minimum rainfalls give a quantitative indication of the expected rainfall deficits so that farmers may design their irrigation systems for appropriate crop protection.

REFERENCES

- Arora, K., and V. P. Singh. 1989. A comparative evaluation of the estimators of the Log Pearson Type (LP) 3 distribution. Journal of Hydrology, 105: 19-37.
- Bobee, B. 1975. The Log Pearson Type 3 distribution and its application in hydrology. Water Resources Research, 11 (5): 681-689.
- Chow, V. T. 1964. Statistical and probability analysis of hydrologic data, Part I, frequency analysis. Handbook of Applied Hydrology, pp. 8-1 to 8-42. New York, NY: McGraw-Hill.
- Gumbel, E. J. 1958. Statistics of Extremes. New York, NY: Columbia University Press.
- Hershfield, D. M. 1961. Rainfall atlas of the United States. Weather Bureau Technical Paper No. 40. Washington D. C.: U. S. Dept. of Commerce.
- Houghton, J. C. 1978. Birth of a parent: The Wakeby distribution for modeling flood flows. Water Resources Research, 14 (6): 1105-1115.
- Jenab, S. A., D. V. Rao, and D. Clapp. 1986. Rainfall analysis for northeast Florida, Part II: Summary of monthly and annual rainfall data. St. Johns River Water Management District Technical Publication SJ 86-4. Palatka, Fla.
- Lettenmaier, D. P., and S. J. Burges. 1982. Gumbel's extreme value I distribution: A new look. Journal of the Hydraulics Division, ASCE, 108 (HY4): 502-514.
- Markovic, R. D. 1965. Probability functions of best fit to distributions of annual precipitation and runoff. Hydrology Papers No. 8. Fort Collins, Co.: Colorado State University.
- Matalas, N. C. 1963. Probability distribution of low flows. U. S. Geological Survey Professional Paper 434-A. Washington, D. C.
- Miller, J. F. 1964. Two-to-ten day precipitation for return periods of 2 to 100 years in the contiguous United States. Weather Bureau Technical Paper No. 49. Washington, D. C.: U. S. Dept. of Commerce.

- Rao, D. V. 1980a. Log Pearson Type 3 distribution: A generalized evaluation. Journal of the Hydraulics Division, ASCE, 16 (HY5): 853-872.
- Rao, D. V. 1980b. Log Pearson Type 3 distribution: Method of mixed moments. Journal of the Hydraulics Division, ASCE, 106 (HY6): 999-1019.
- Rao, D. V. 1981. Predicting precipitation events: Gumbel vs. Log Pearson. Fourth Conference on Hydrometeorology, Oct. 7-9. Reno, Nev. 56-63.
- Rao, D. V. 1983. Estimating Log Pearson parameters by mixed moments. Journal of Hydraulic Engineering, ASCE, 109 (8) 1118-1132.
- Rao, D. V. 1986. Magnitude and frequency of flood discharges in northeast Florida. St. Johns River Water Management District Technical Publication SJ 86-2. Palatka, Fla.
- Rao, D. V. 1988. Estimating extreme events: Log Pearson Type 3 distribution. Civil Engineering Practice. Chapter 9, Vol. 5. Lancaster, Pa.: Technomic Publishing.
- Rao, D. V., S. A. Jenab, and D. A. Clapp 1989. Rainfall analysis for northeast Florida, Part III: Seasonal rainfall data. St. Johns River Water Management District Technical Publication SJ 89-1. Palatka, Fla.
- Riggs, H. C. 1972. Low flow investigations. Techniques of water resources investigations of the U.S. Geological Survey. Ch. B1, Bk. 4. Washington, D. C.: U.S. Government Printing Office.

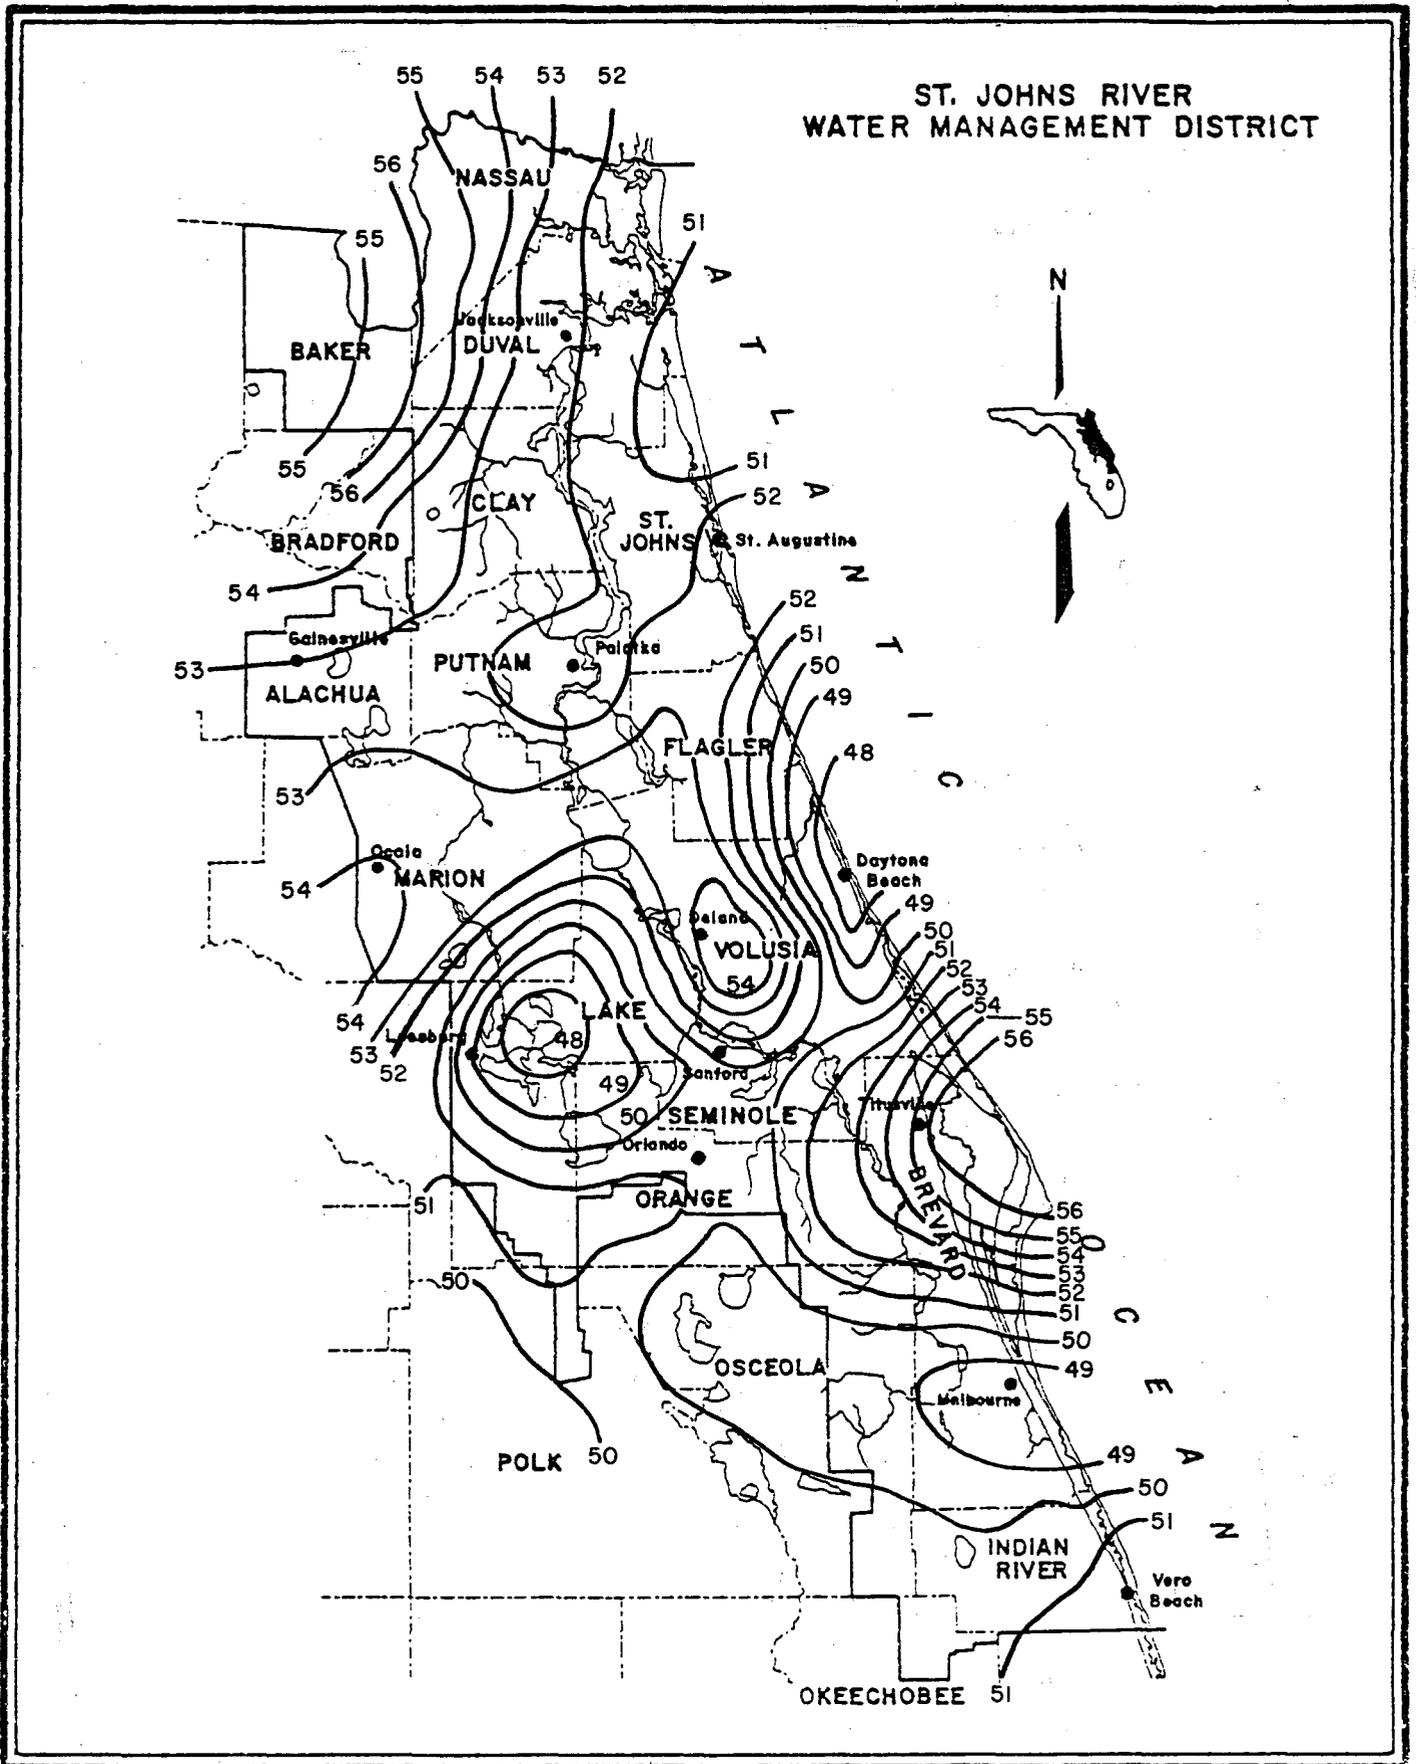


Figure 4. Annual normal rainfall, inches

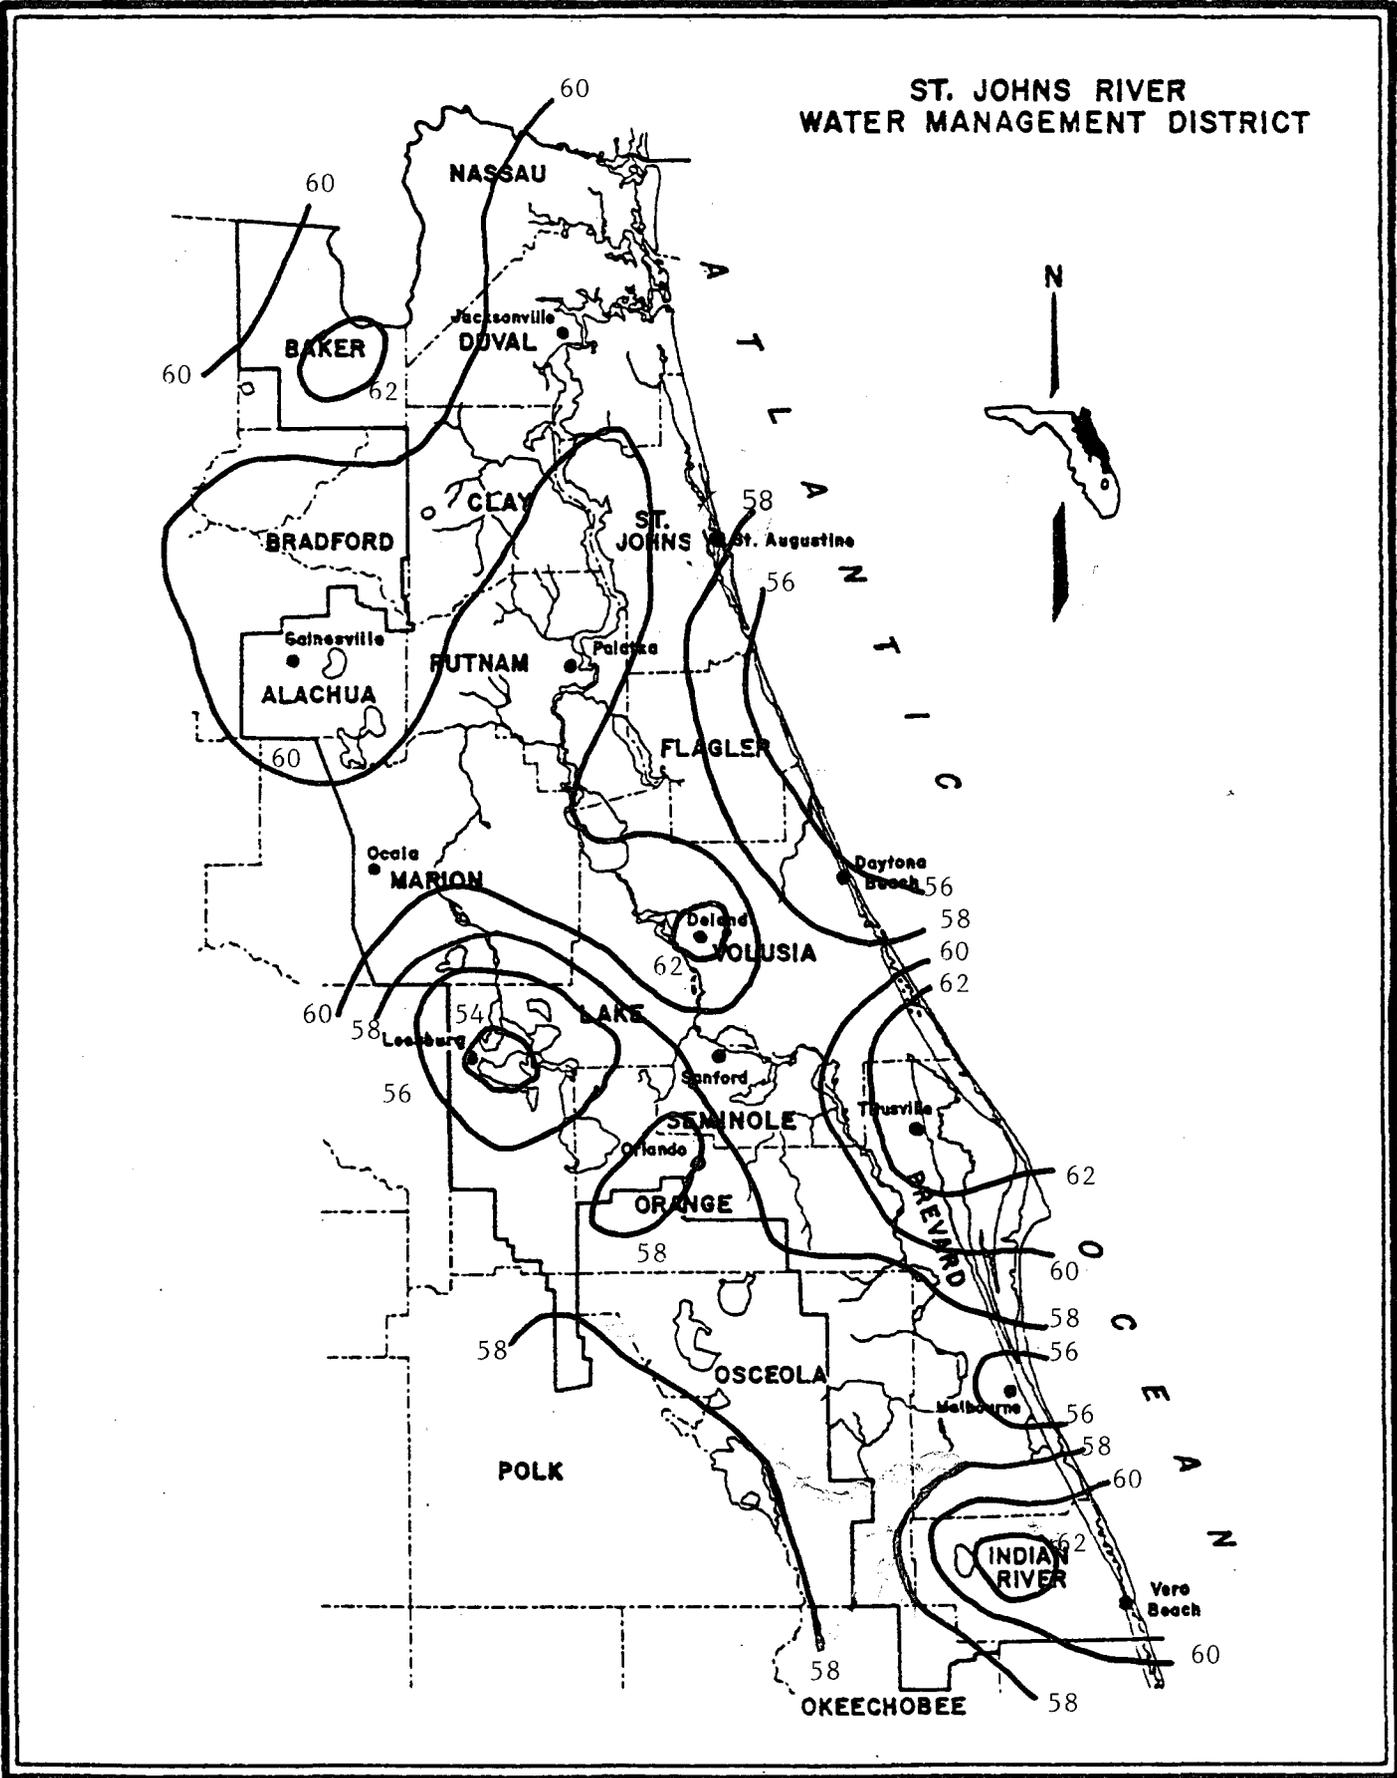


Figure 5. Annual maximum rainfall, inches, T = 5 yr

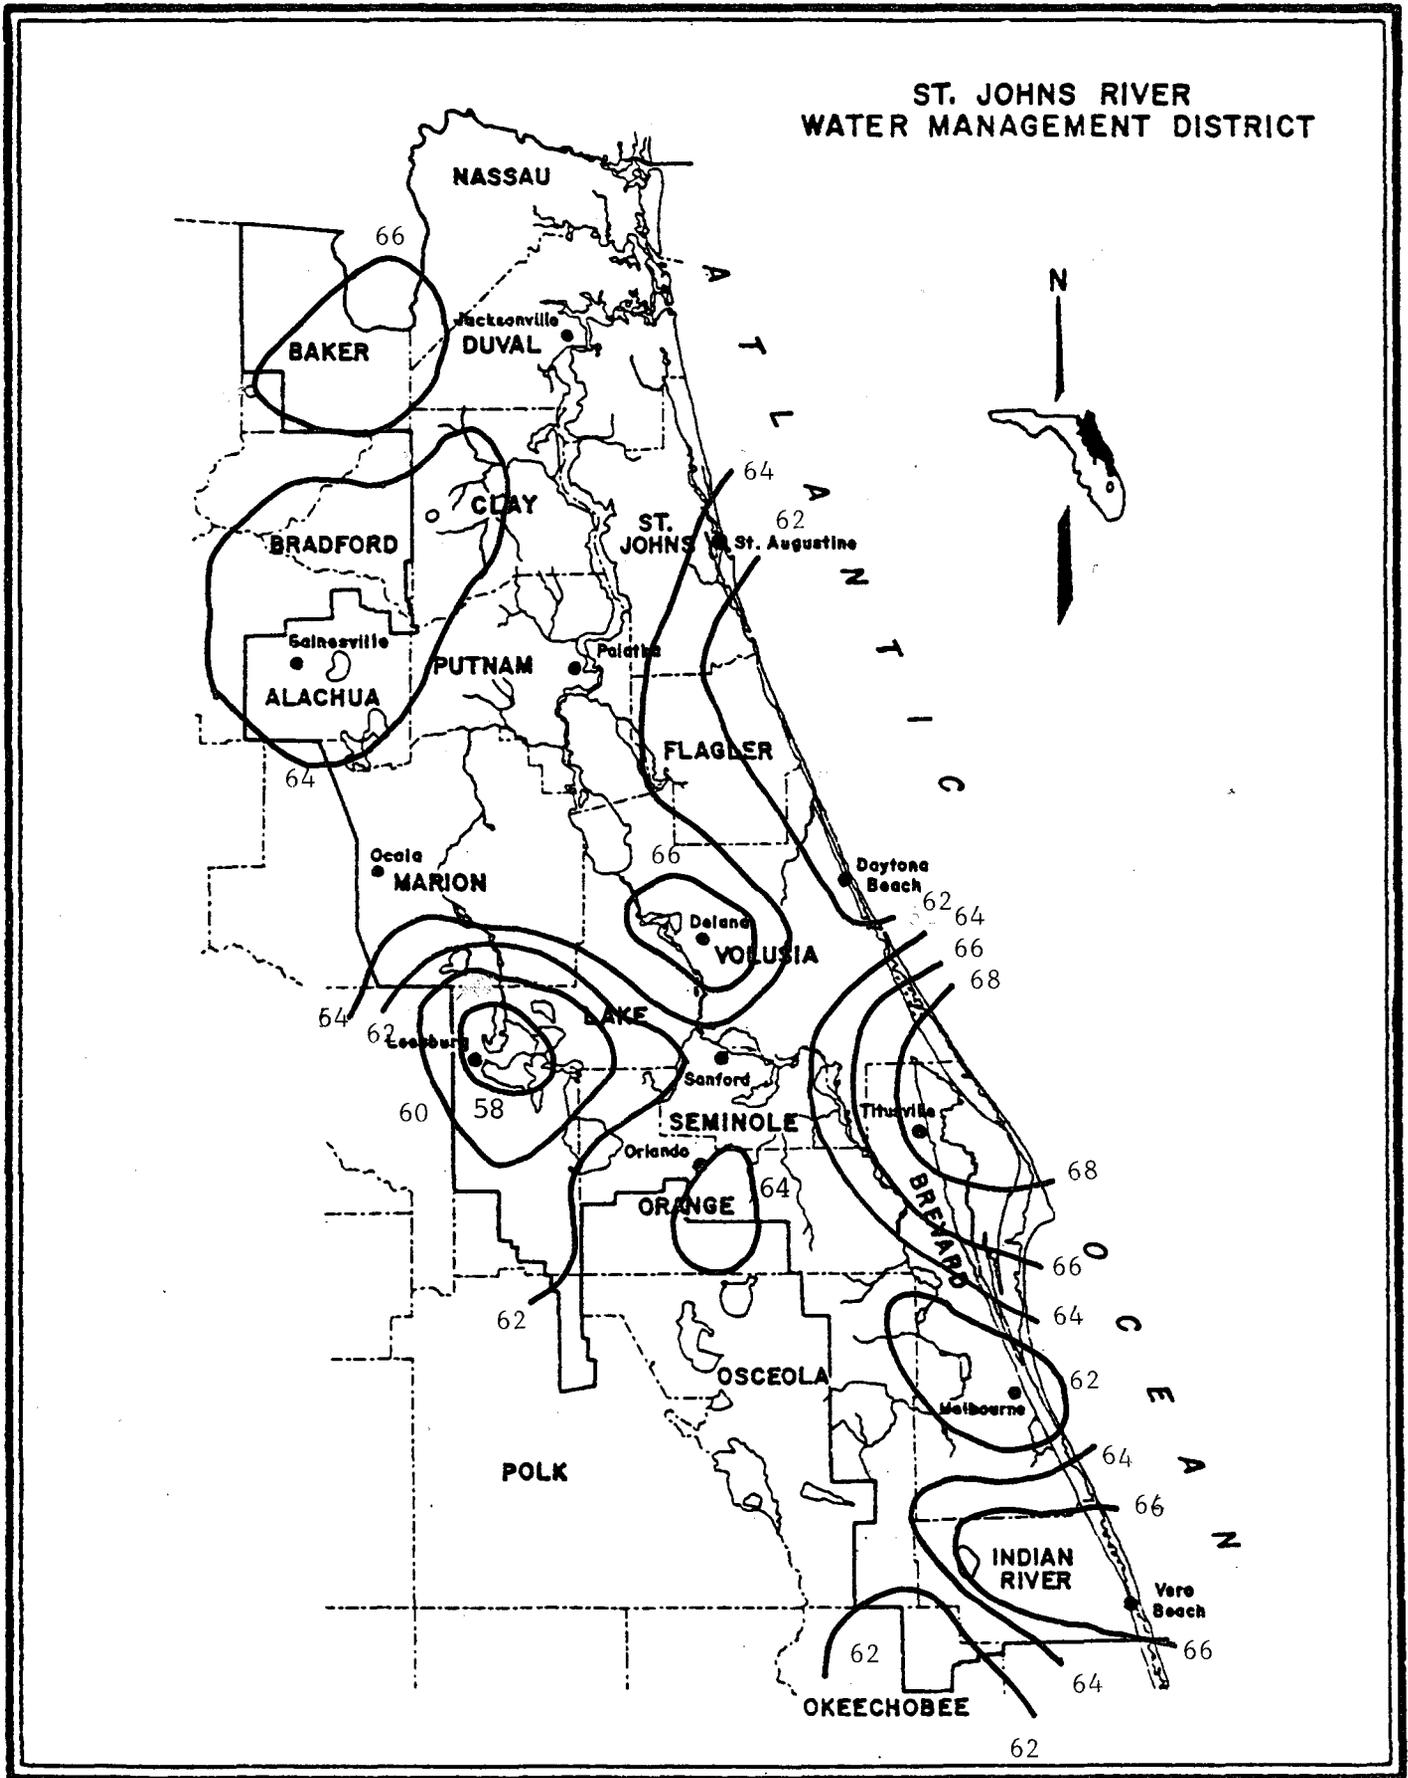


Figure 6. Annual maximum rainfall, inches, T = 10 yr

ST. JOHNS RIVER WATER MANAGEMENT DISTRICT

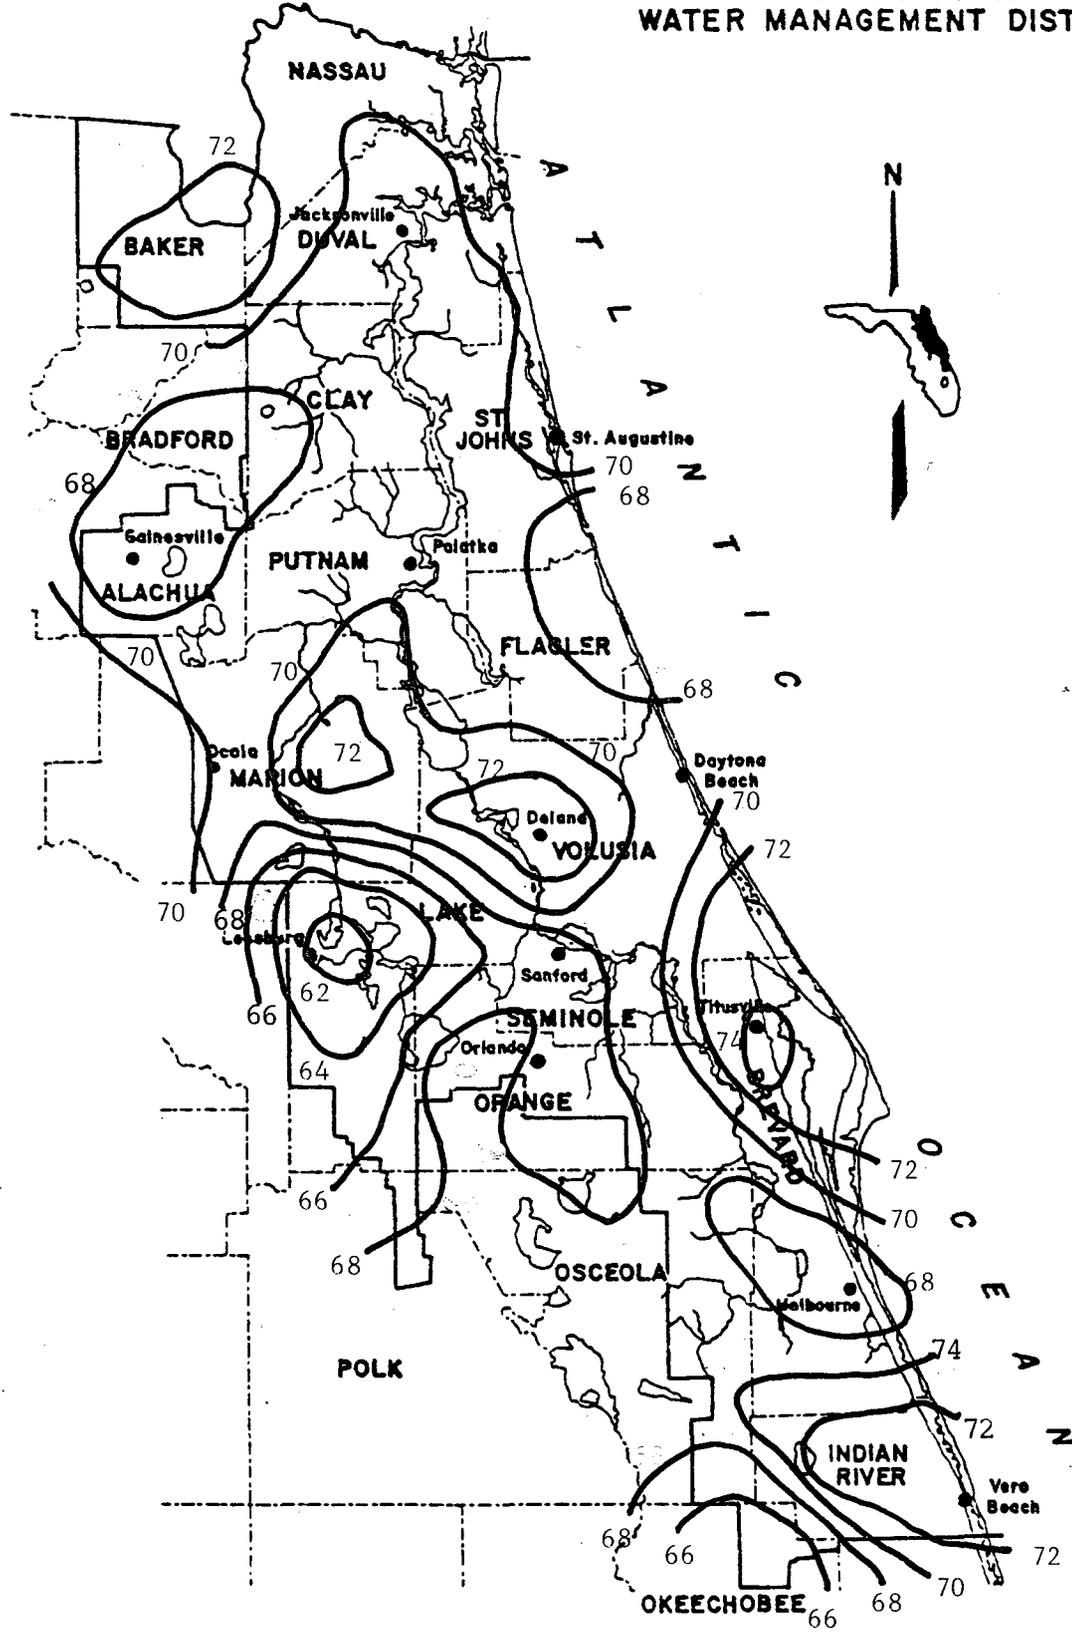


Figure 7.- Annual maximum rainfall, inches, T = 25 yr.

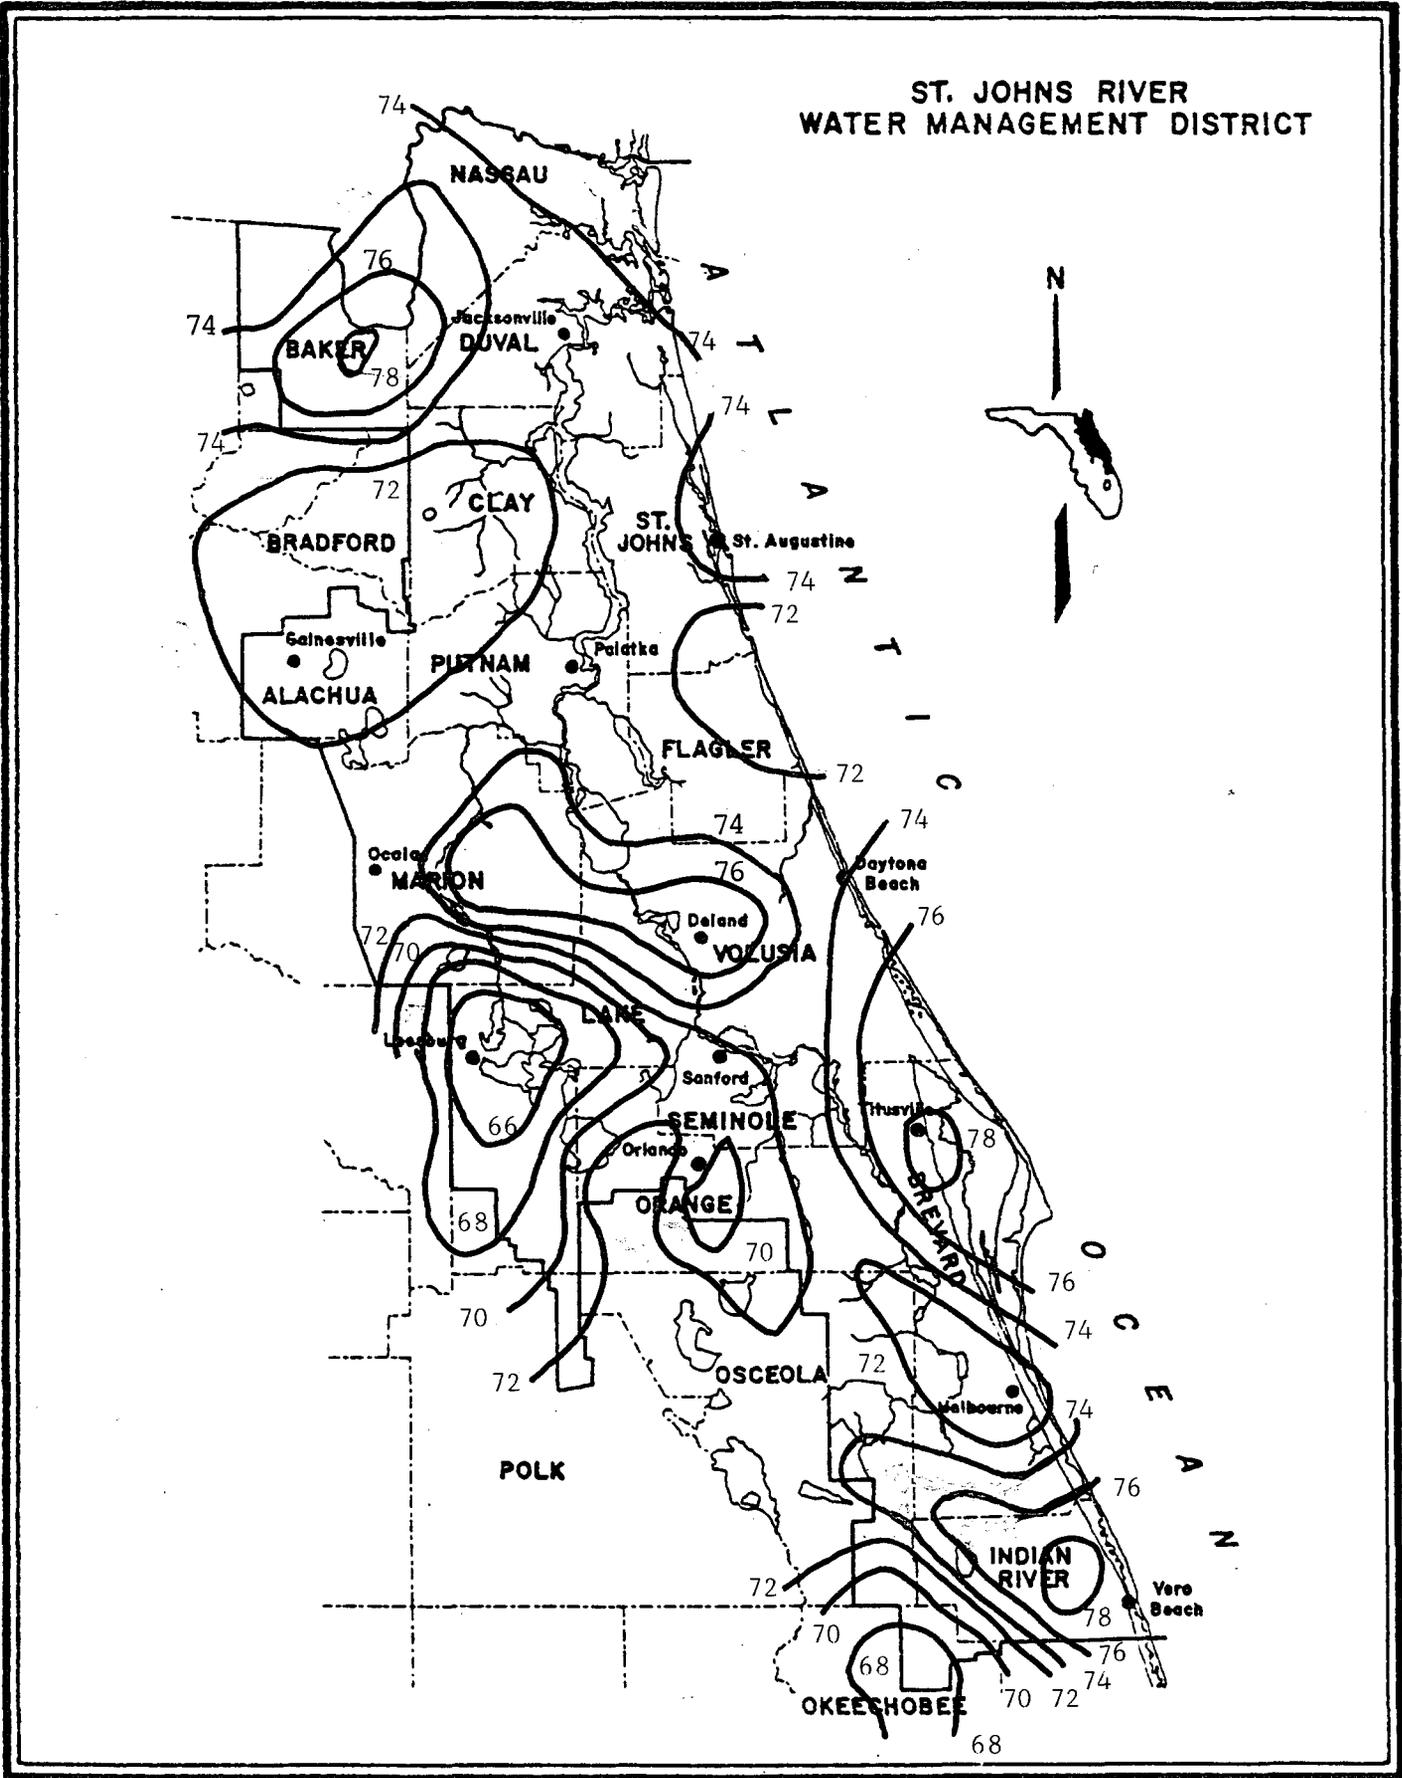


Figure 8. Annual maximum rainfall, inches, T = 50 yr.

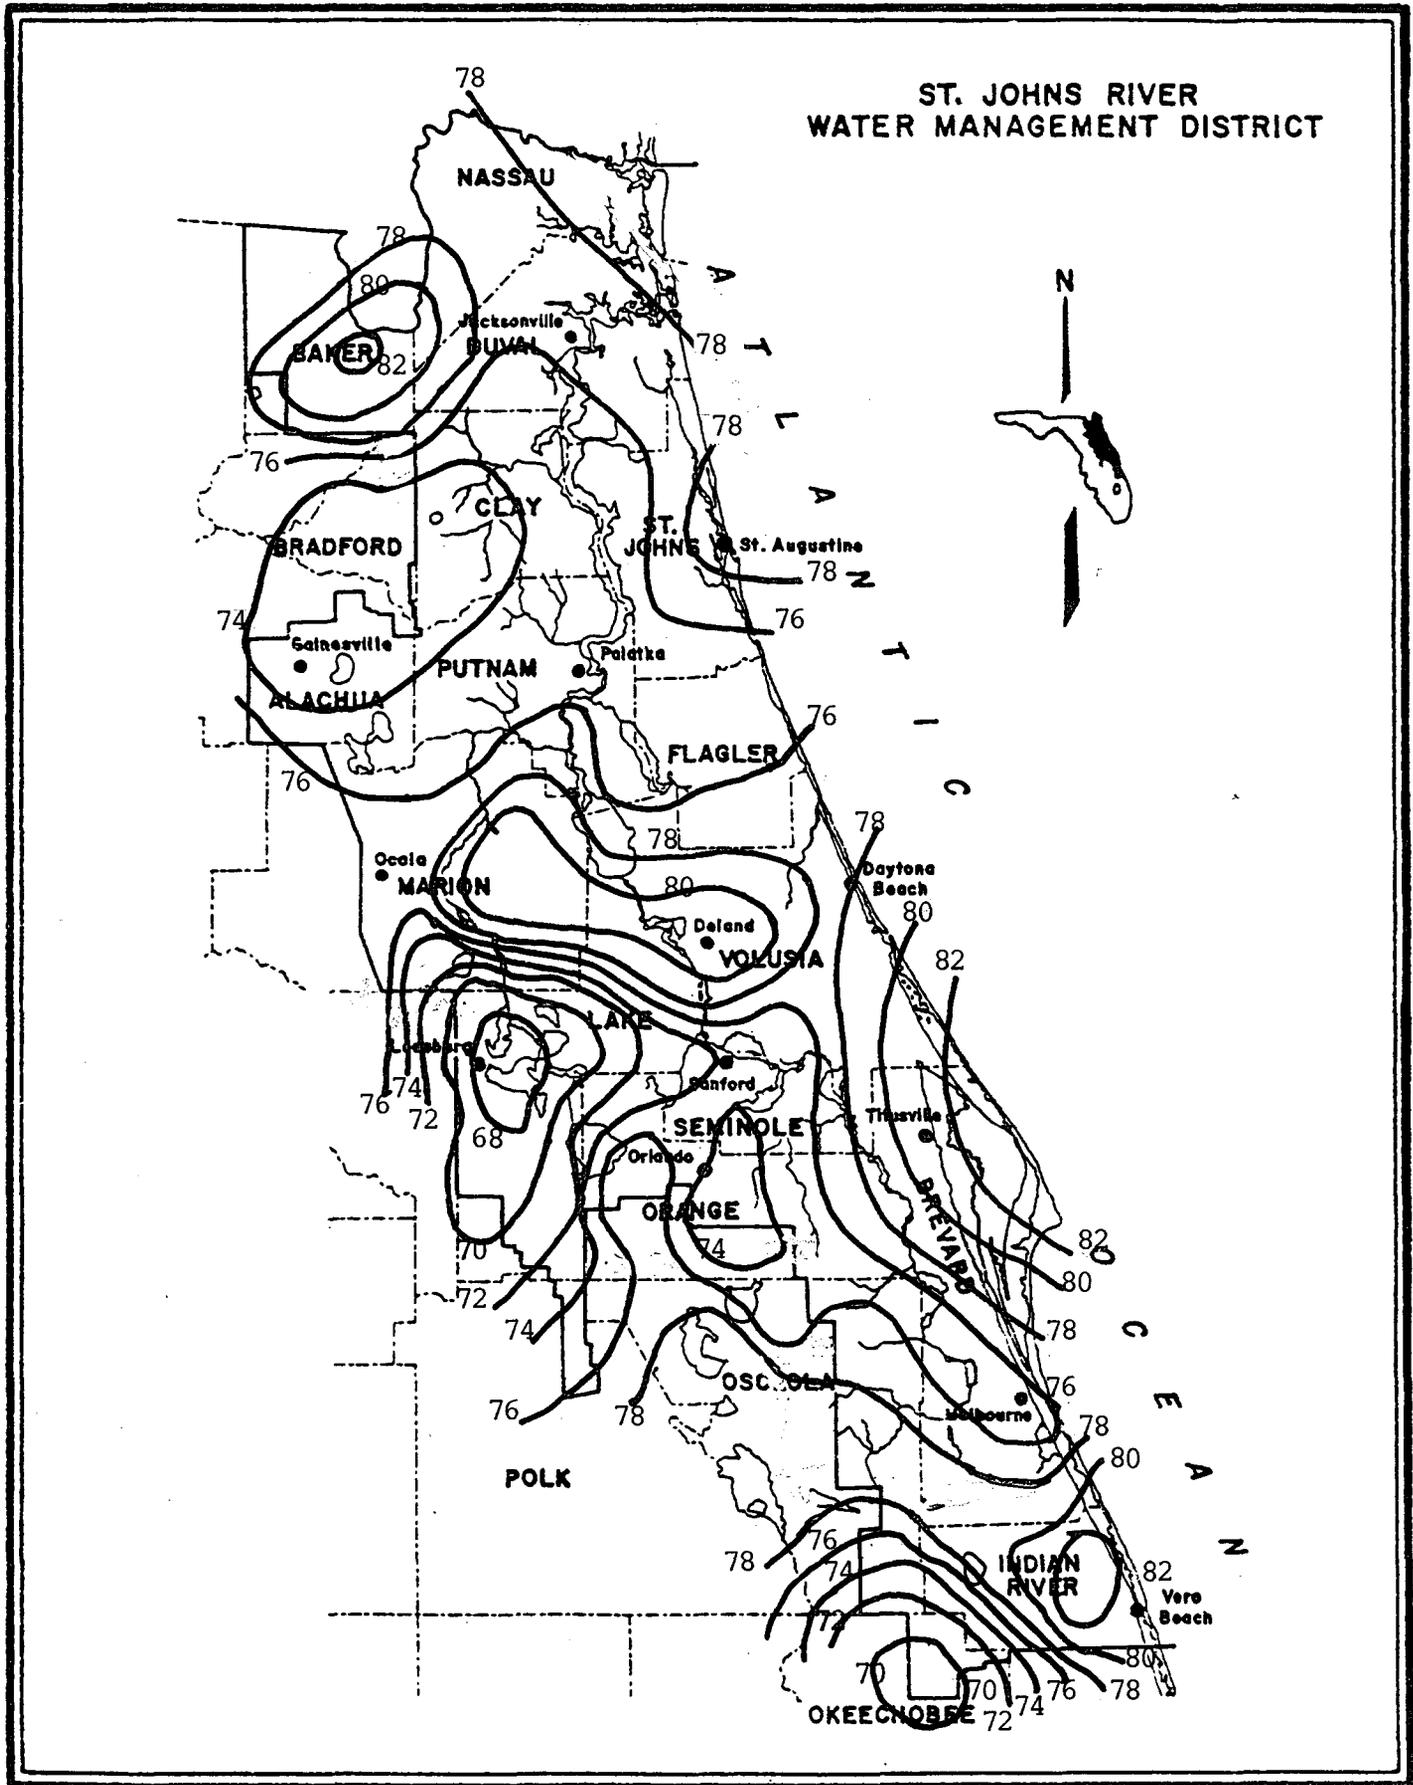


Figure 9. Annual maximum rainfall, inches, T = 100 yr

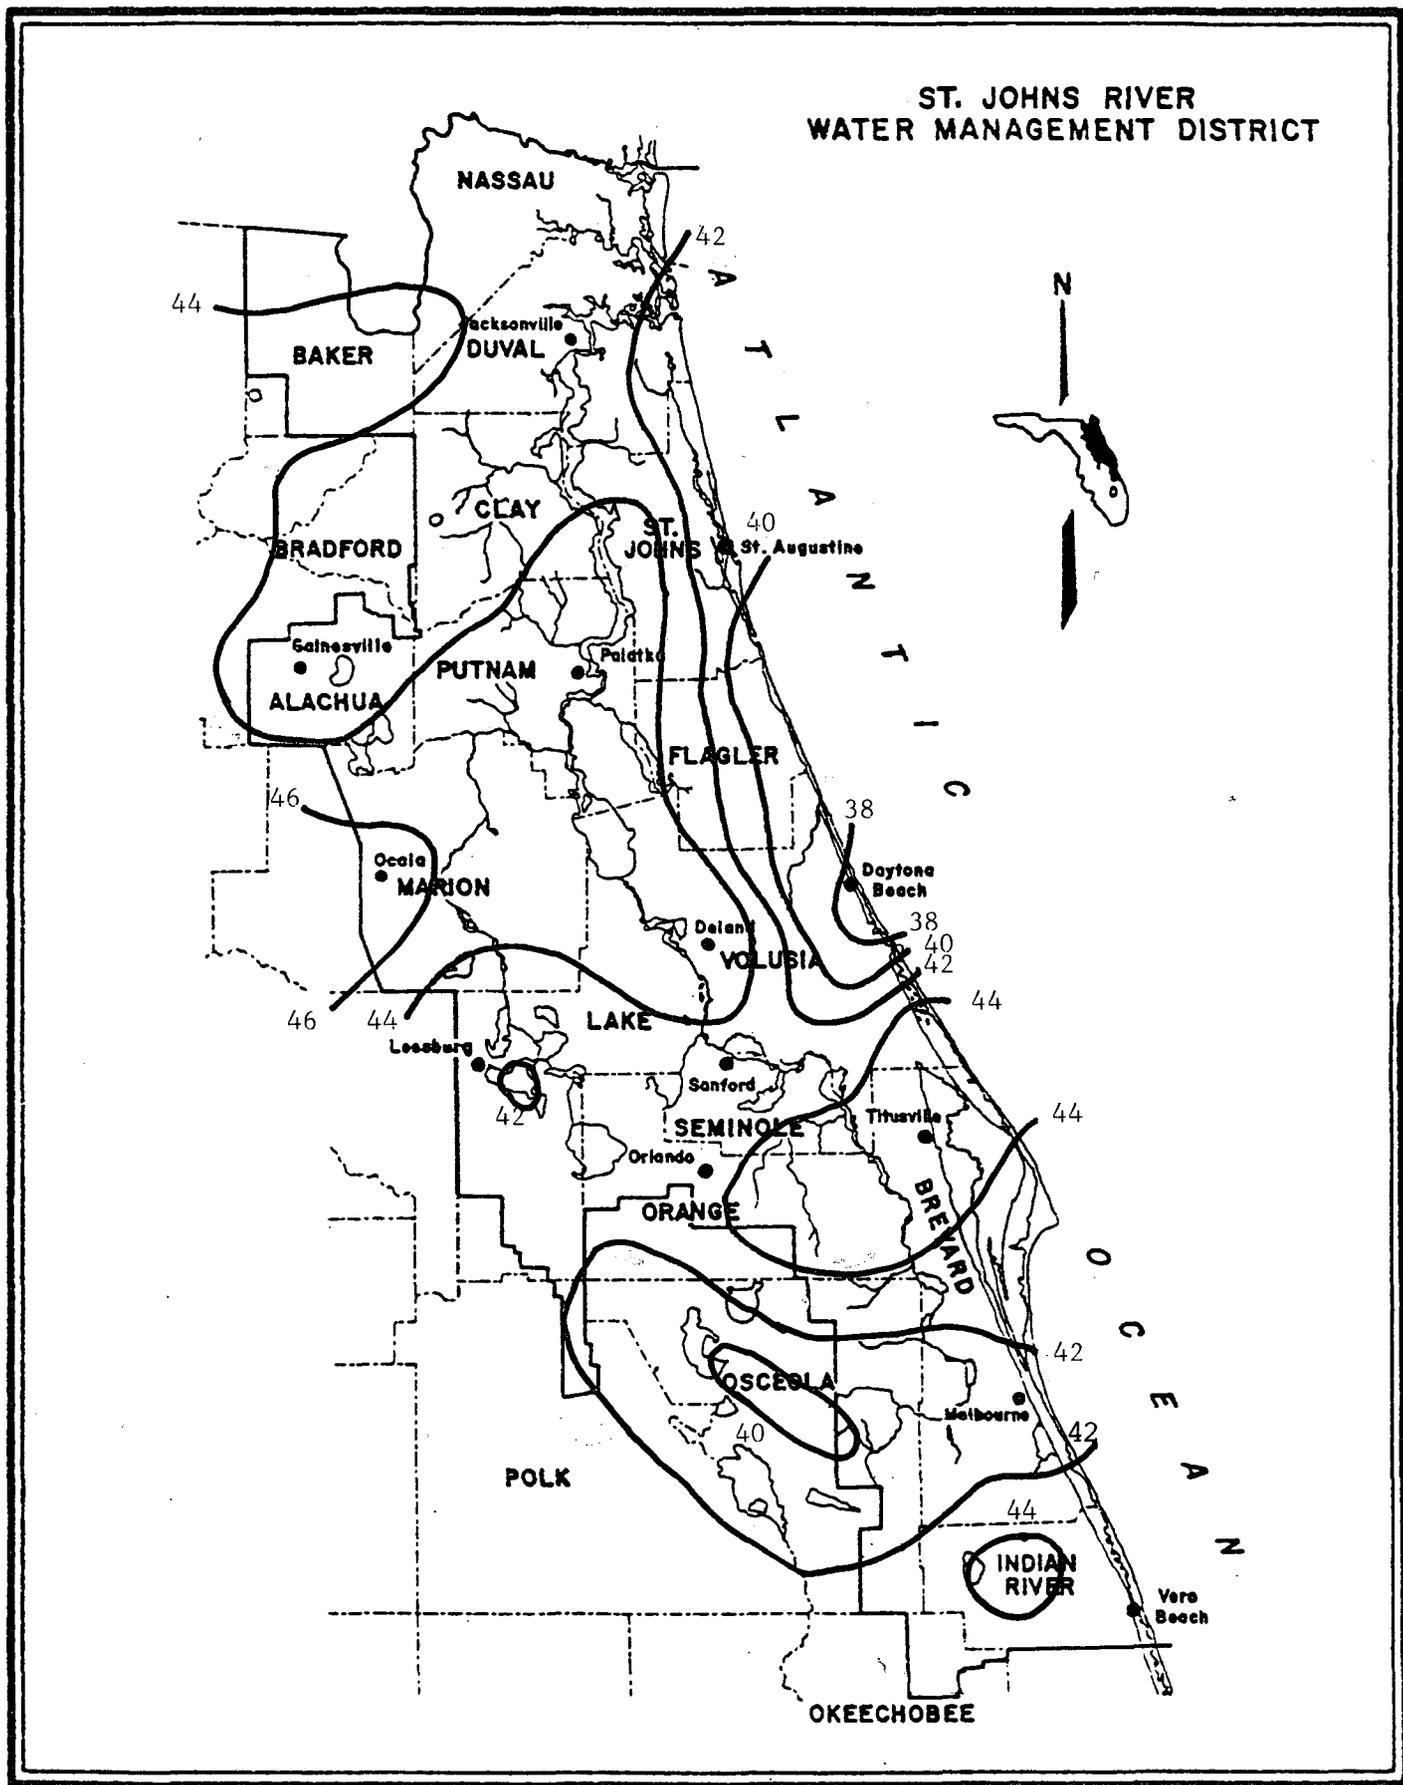


Figure 10. Annual minimum rainfall, inches, T = 5 yr

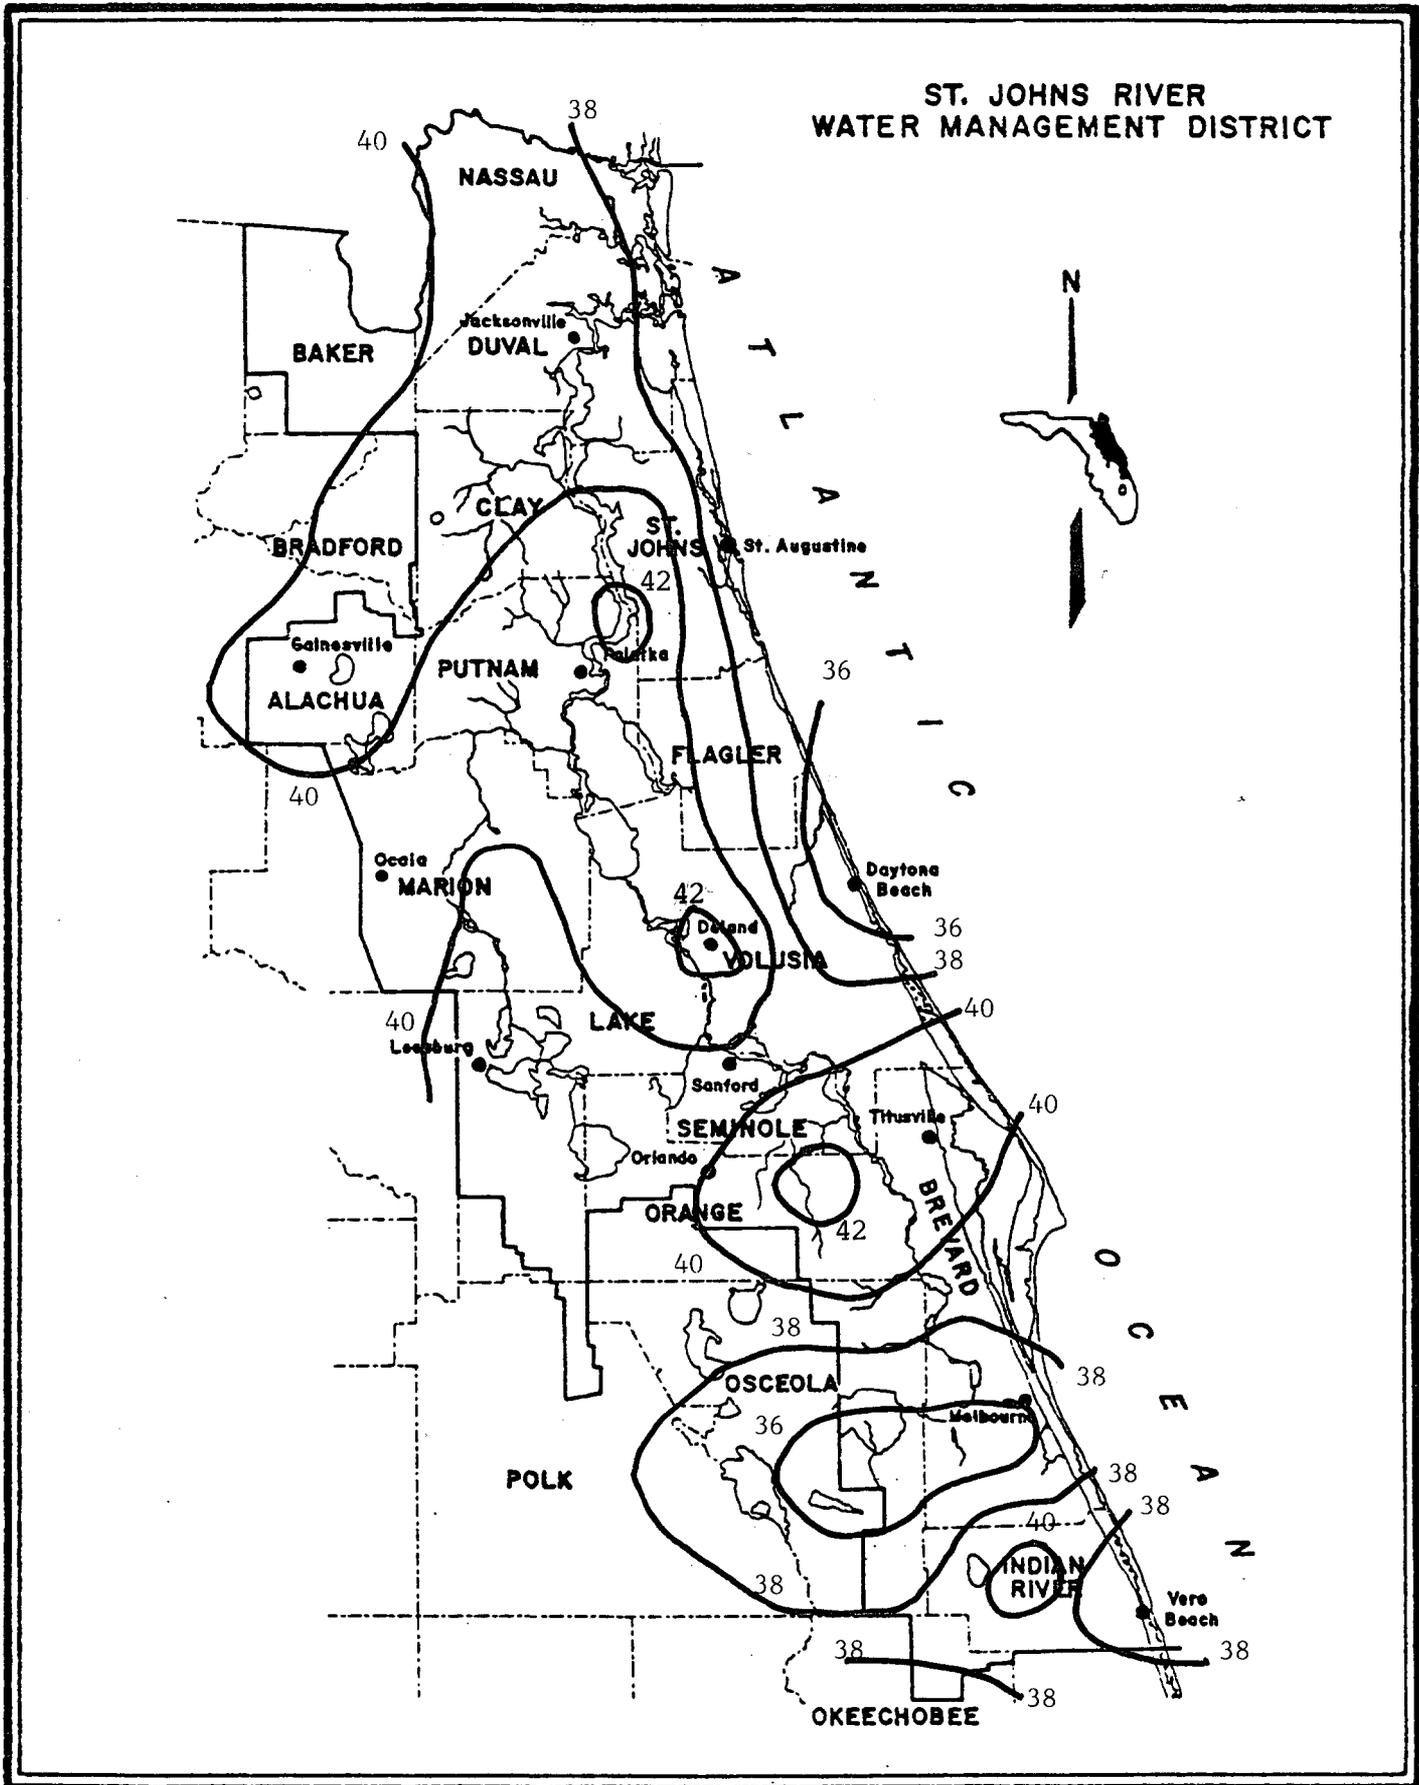


Figure 11. Annual minimum rainfall, inches, T = 10 yr

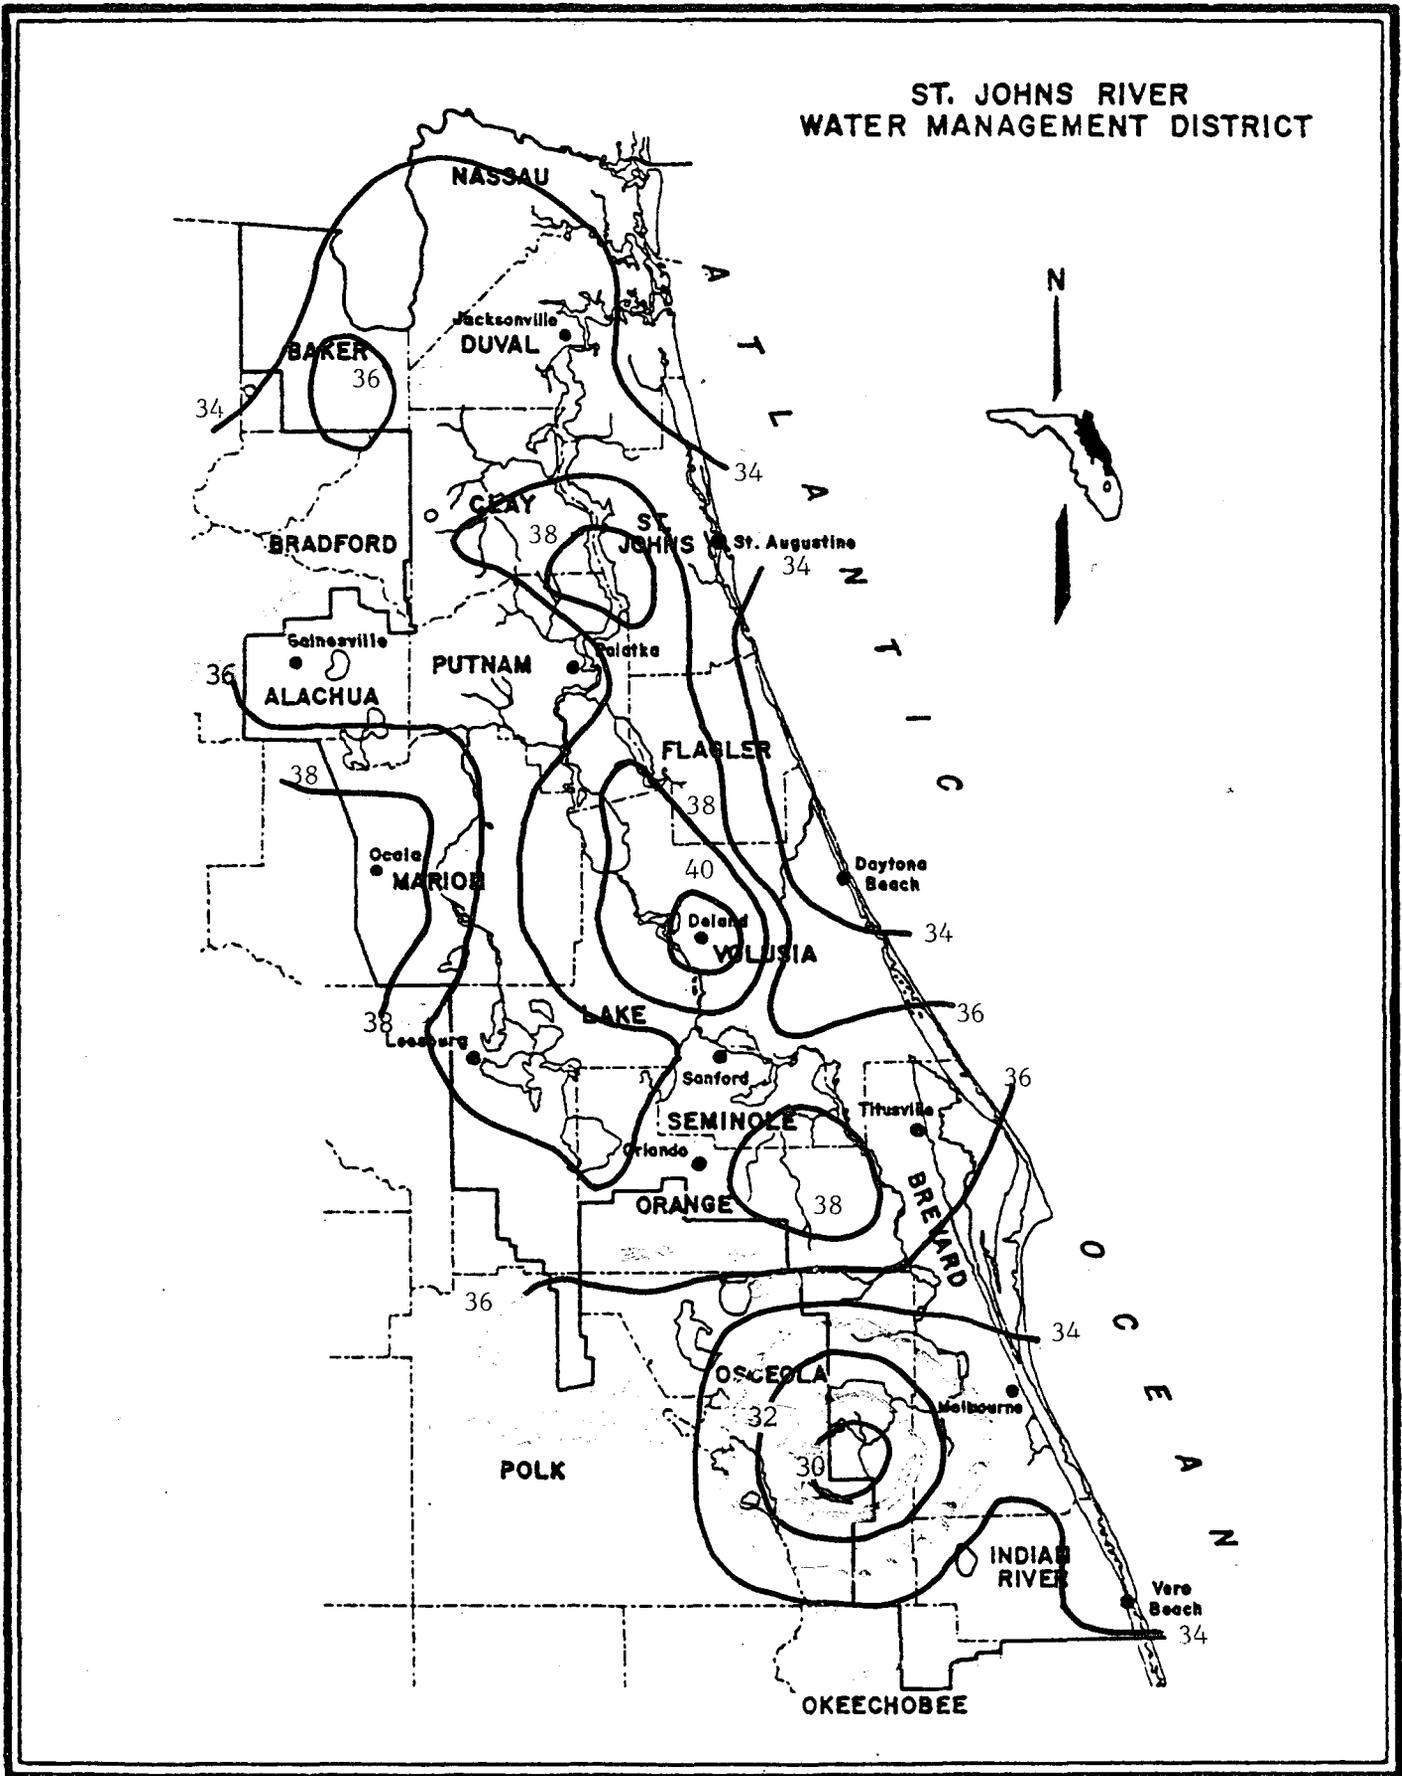


Figure 12. Annual minimum rainfall, inches, T = 25 yr

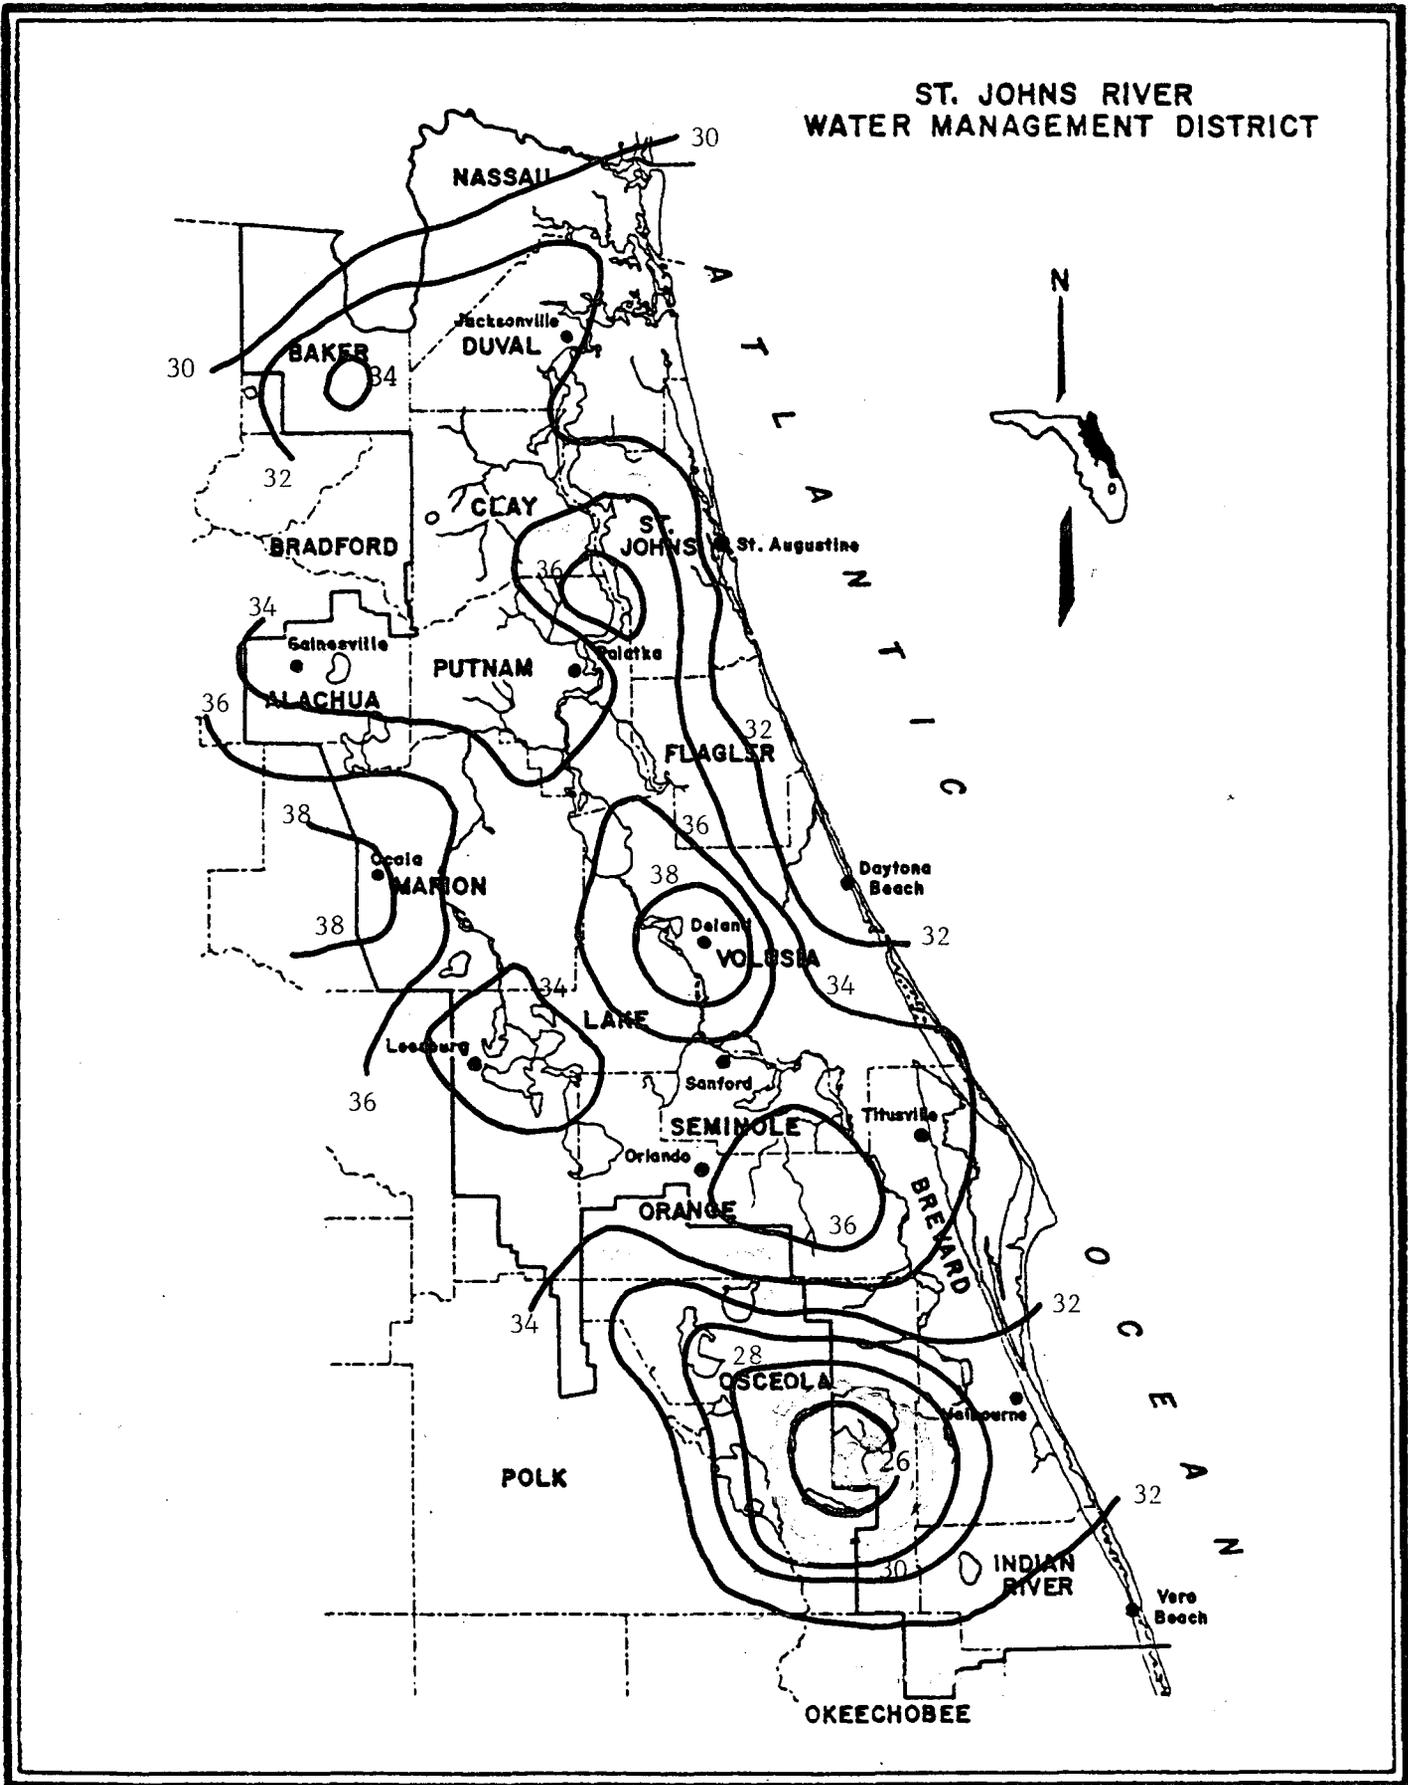


Figure 13. Annual minimum rainfall, inches, T = 50 yr

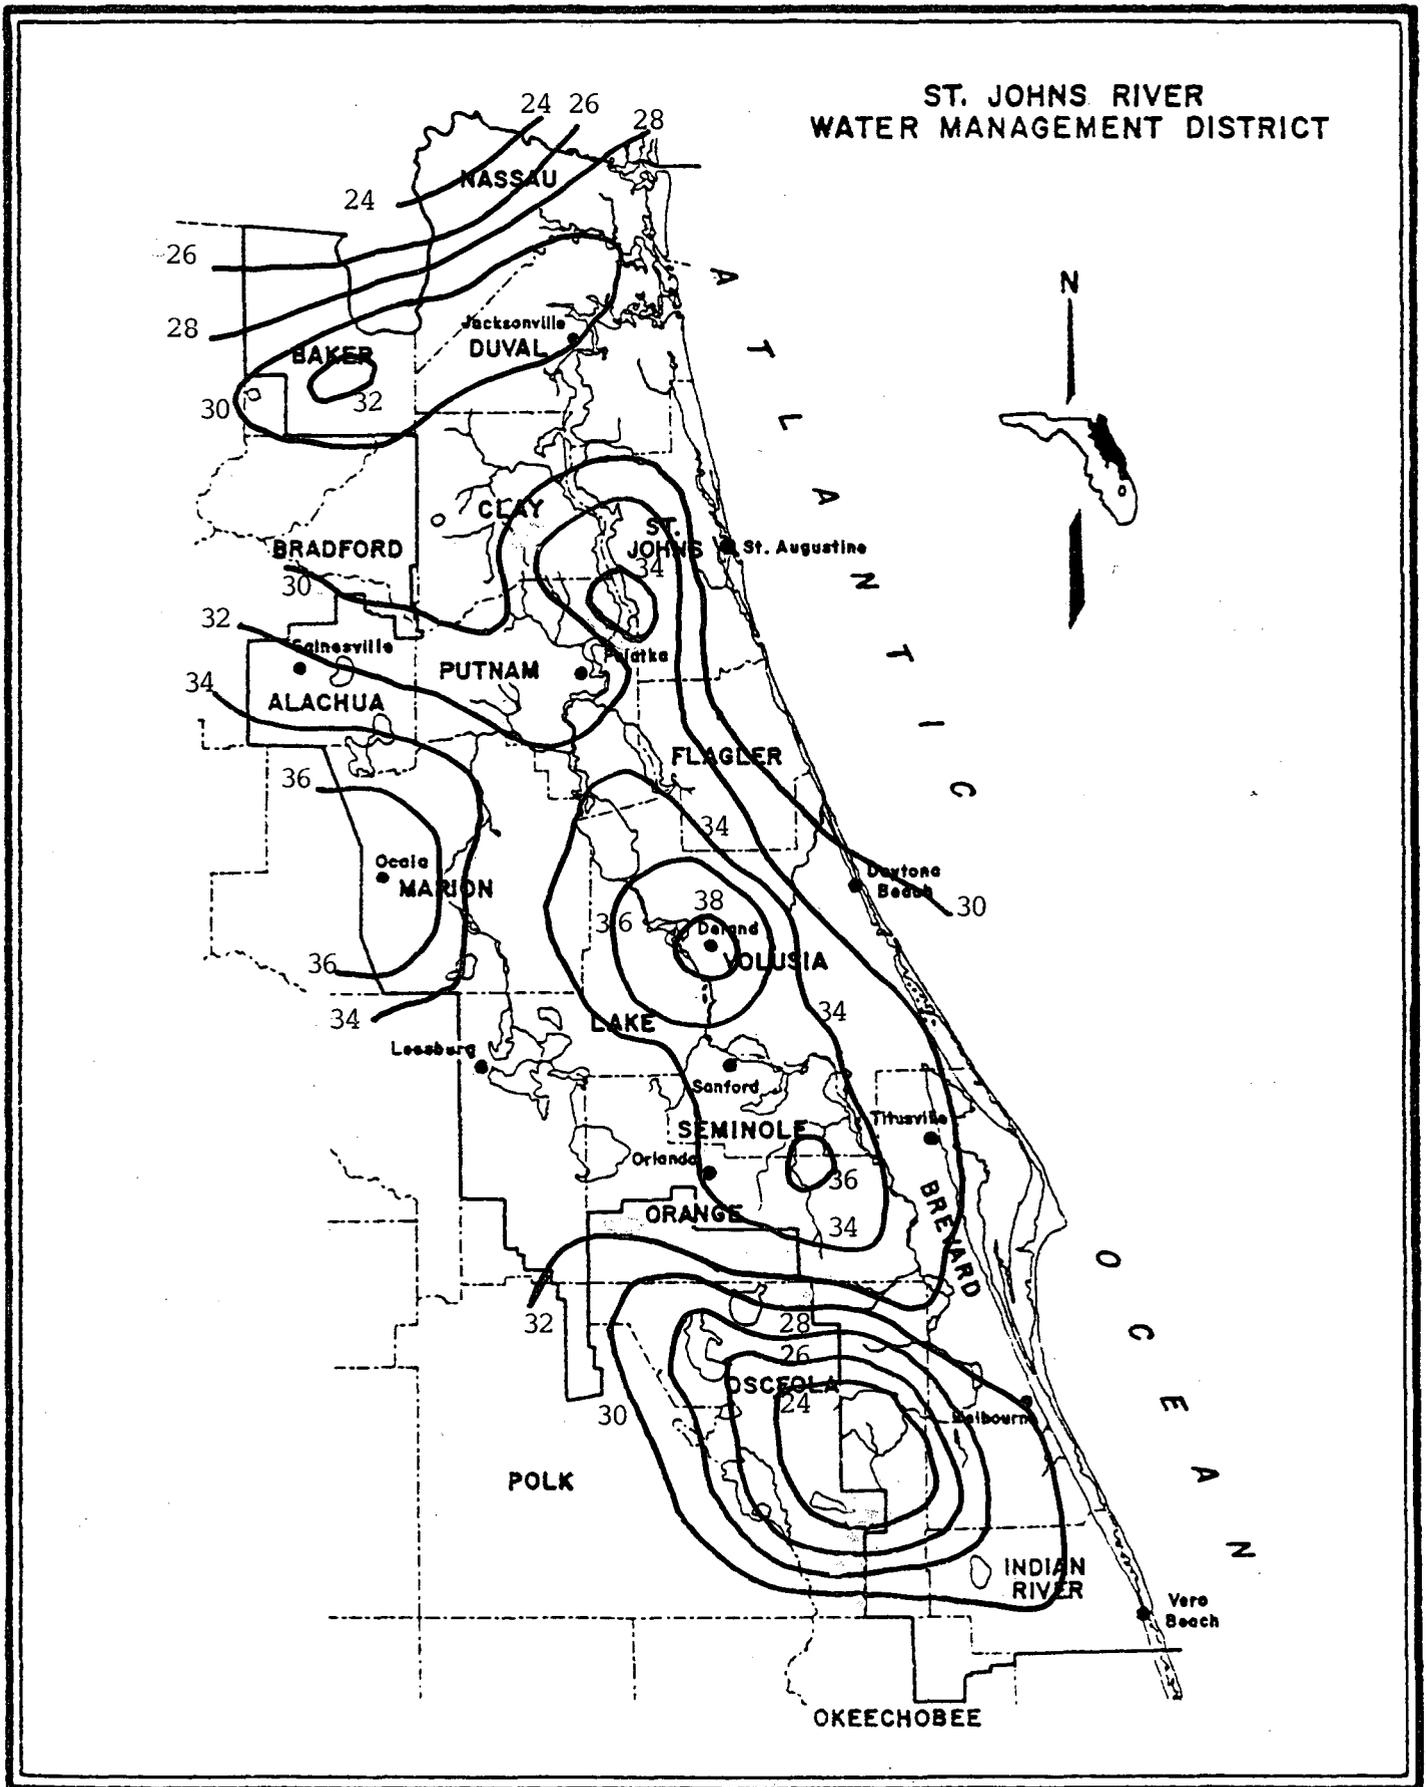


Figure 14. Annual minimum rainfall, inches, T = 100 yr.

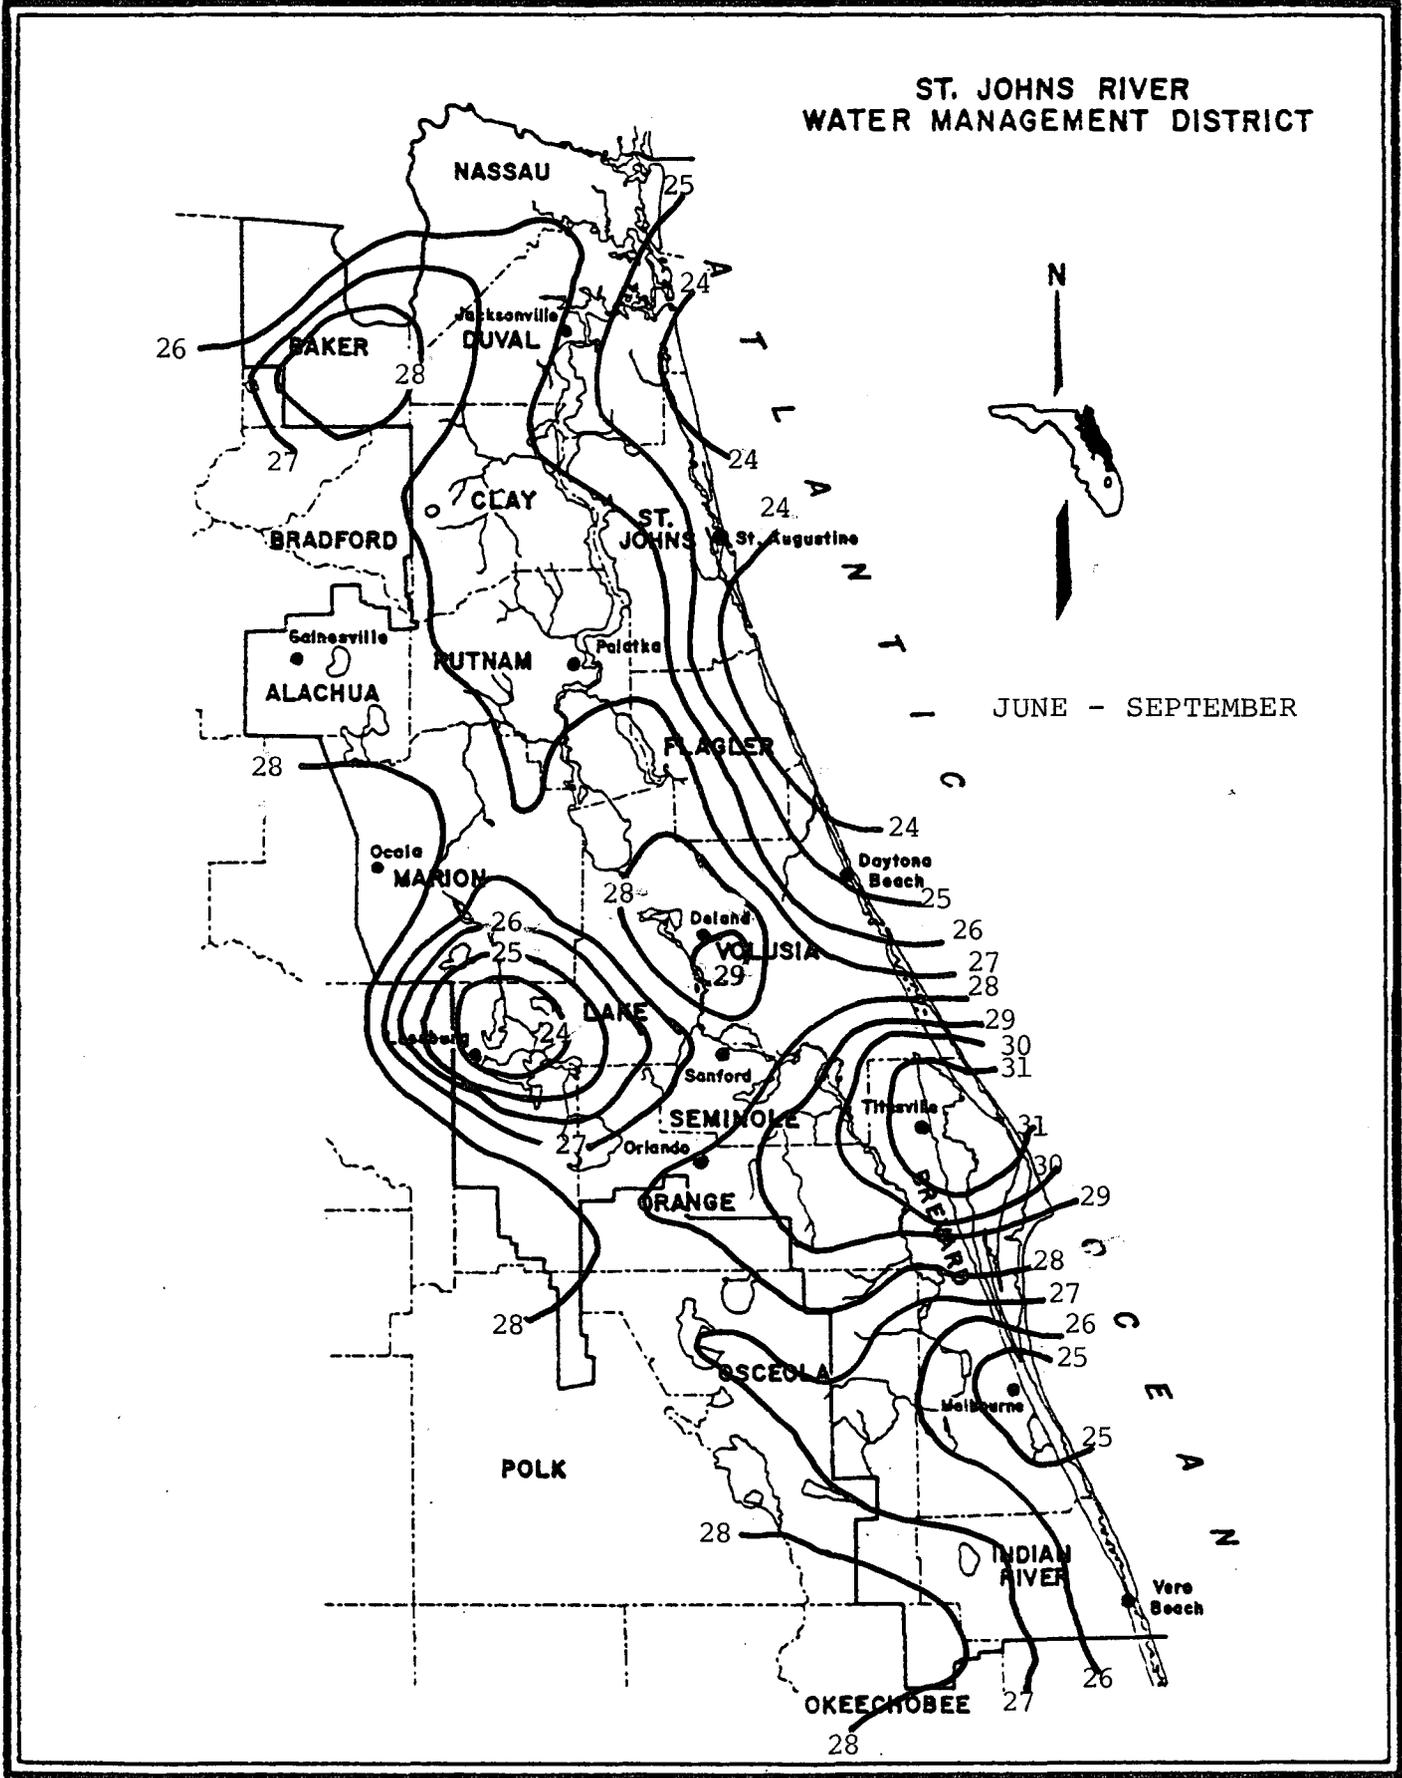


Figure 15. Warm season normal rainfall, inches

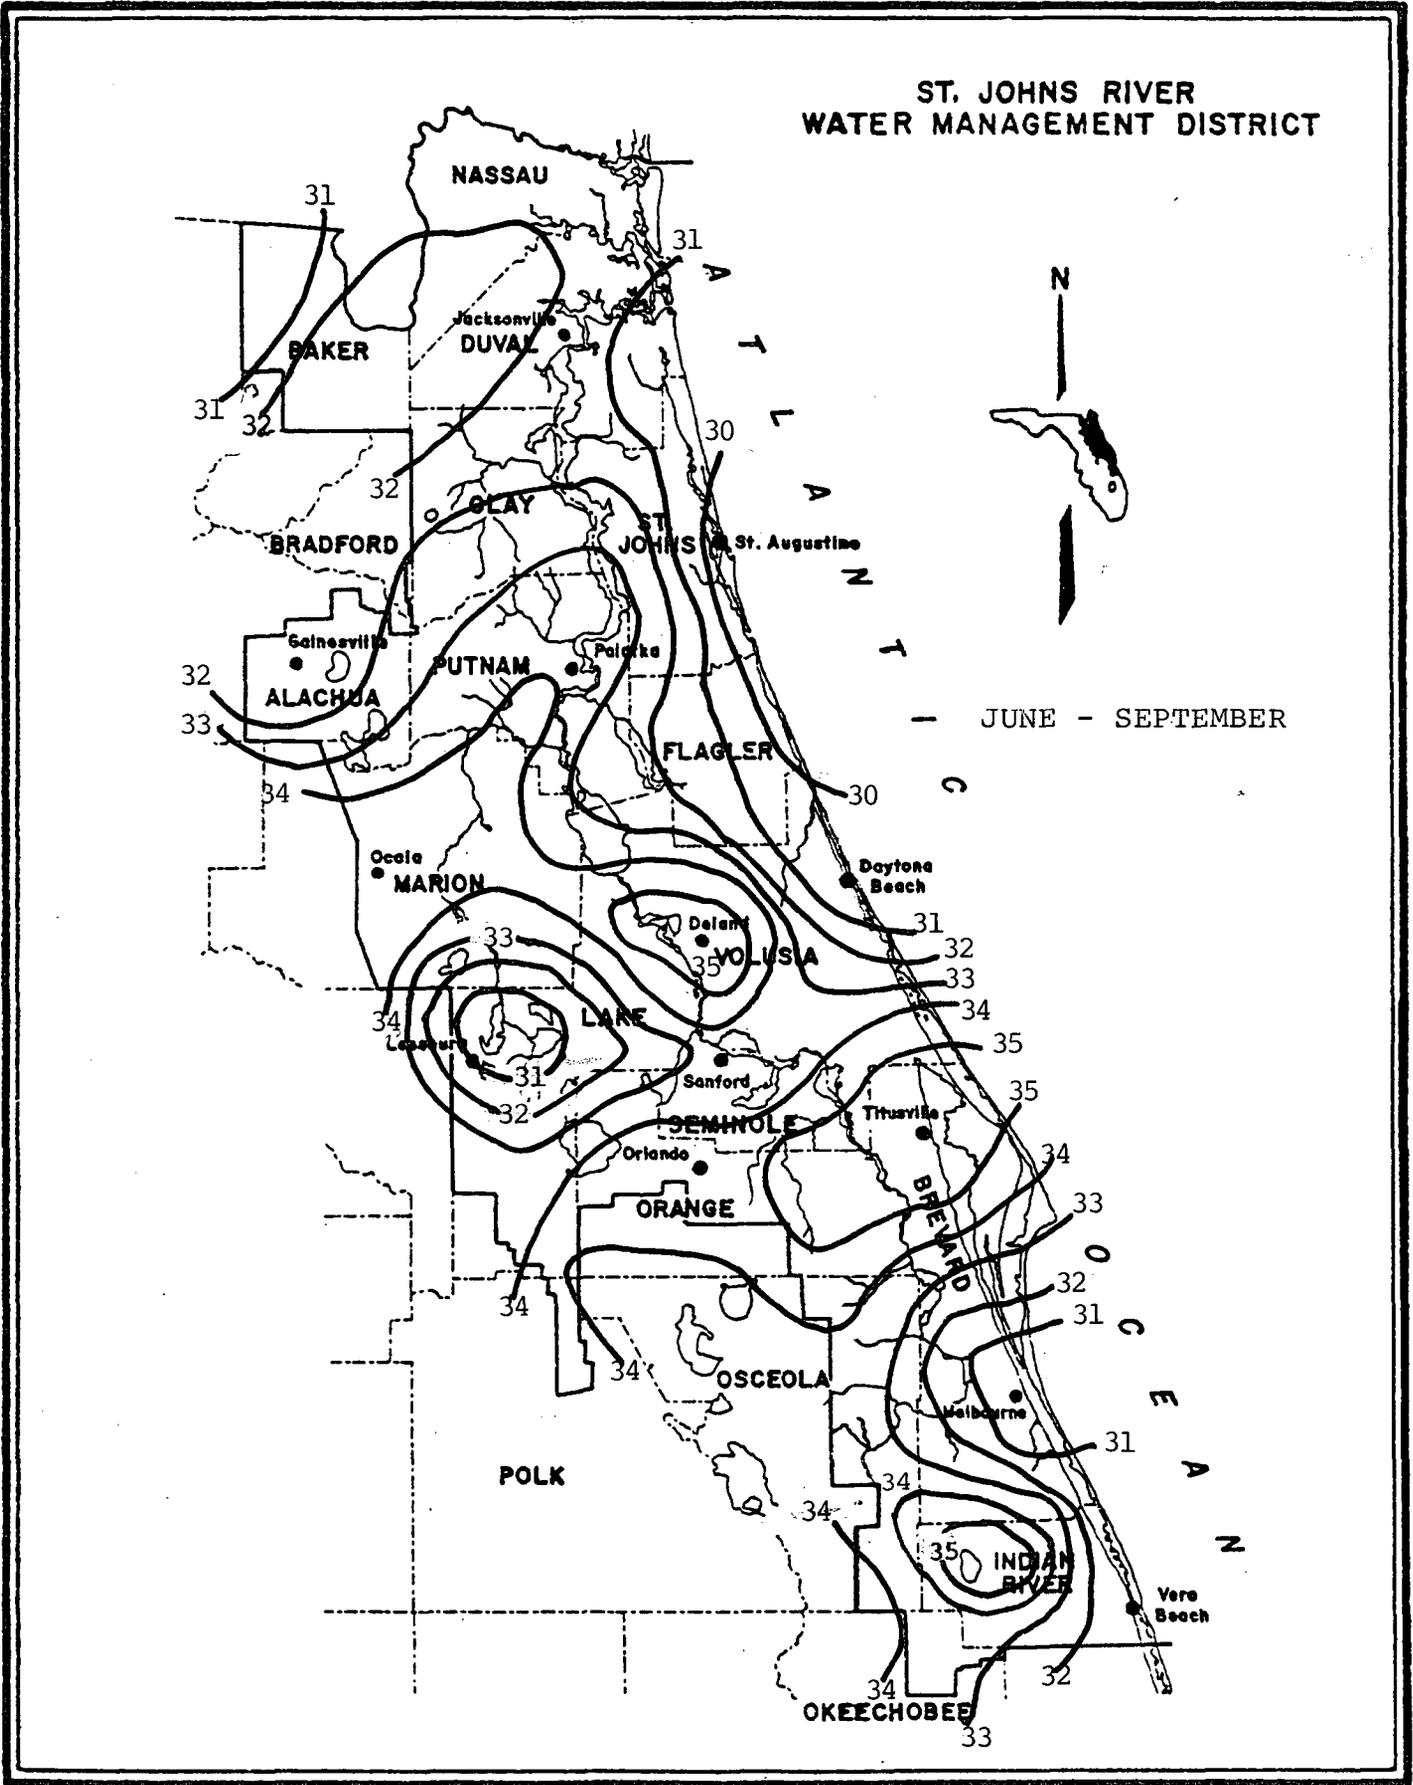


Figure 16. Warm season maximum rainfall, inches, T = 5 yr

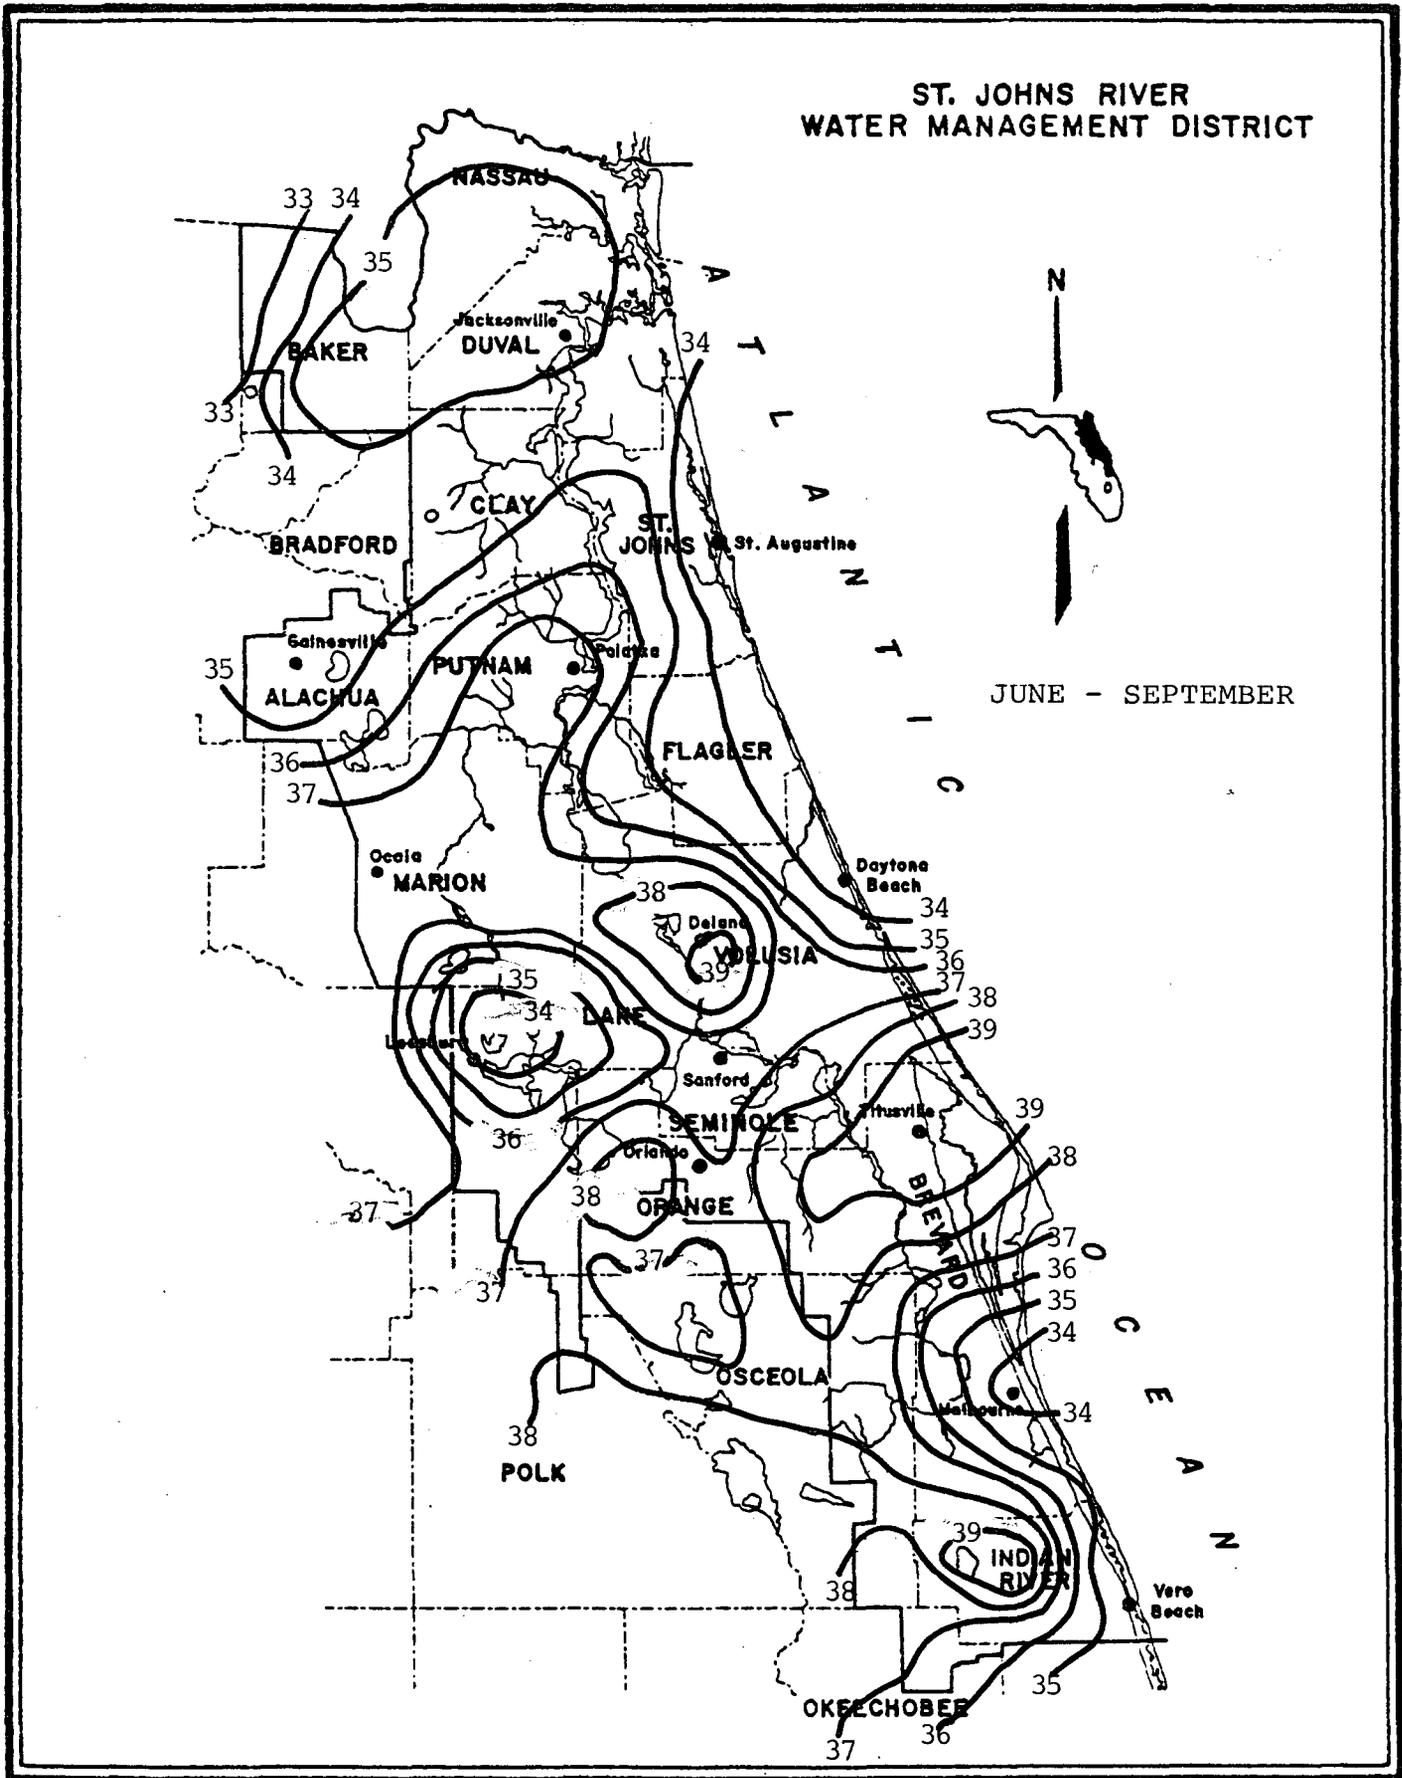


Figure 17. Warm season maximum rainfall, inches, T = 10-yr

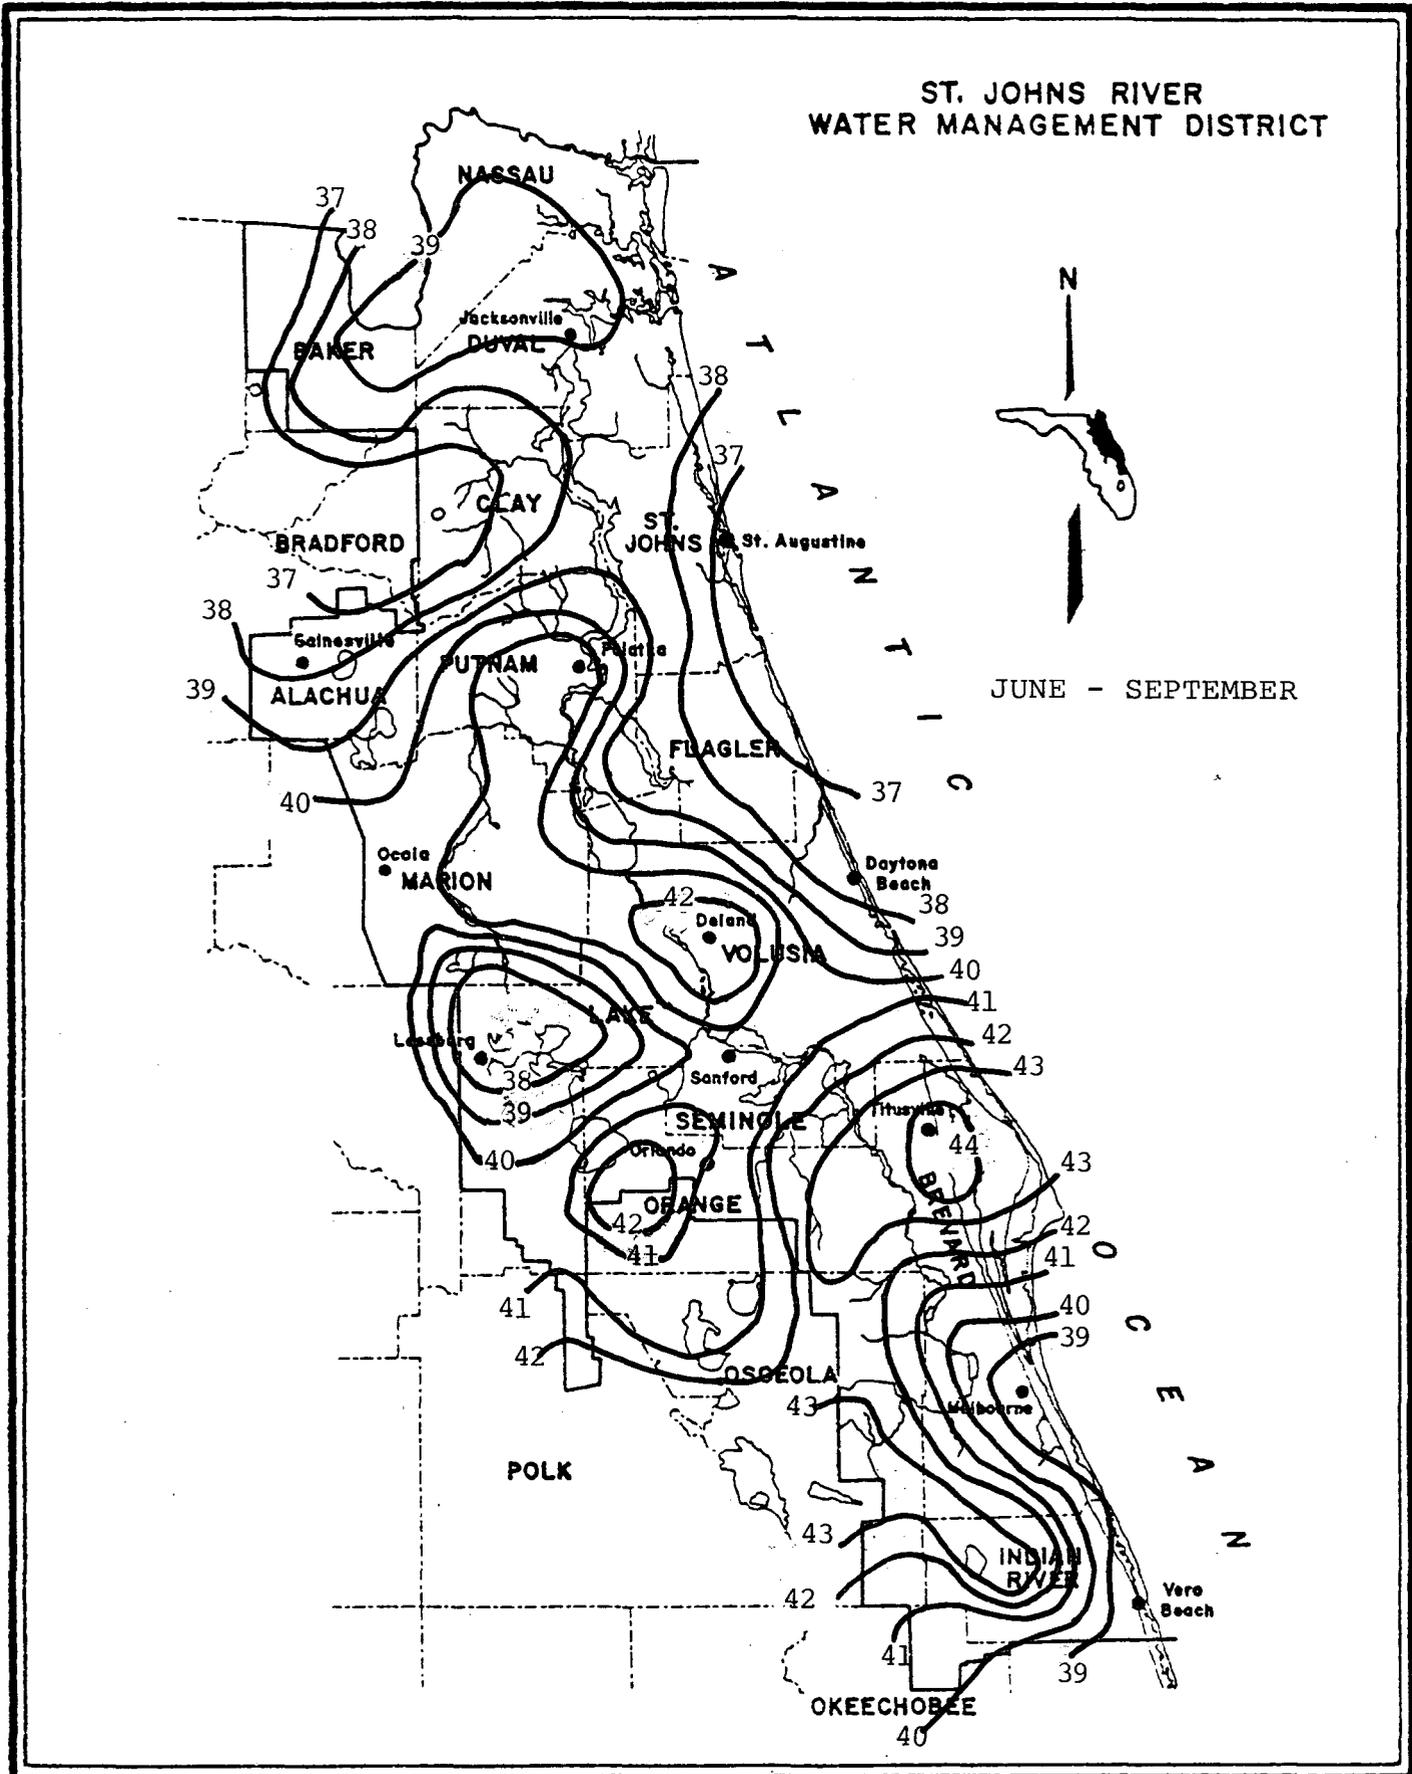


Figure 18. Warm season maximum rainfall, inches, T = 25 yr

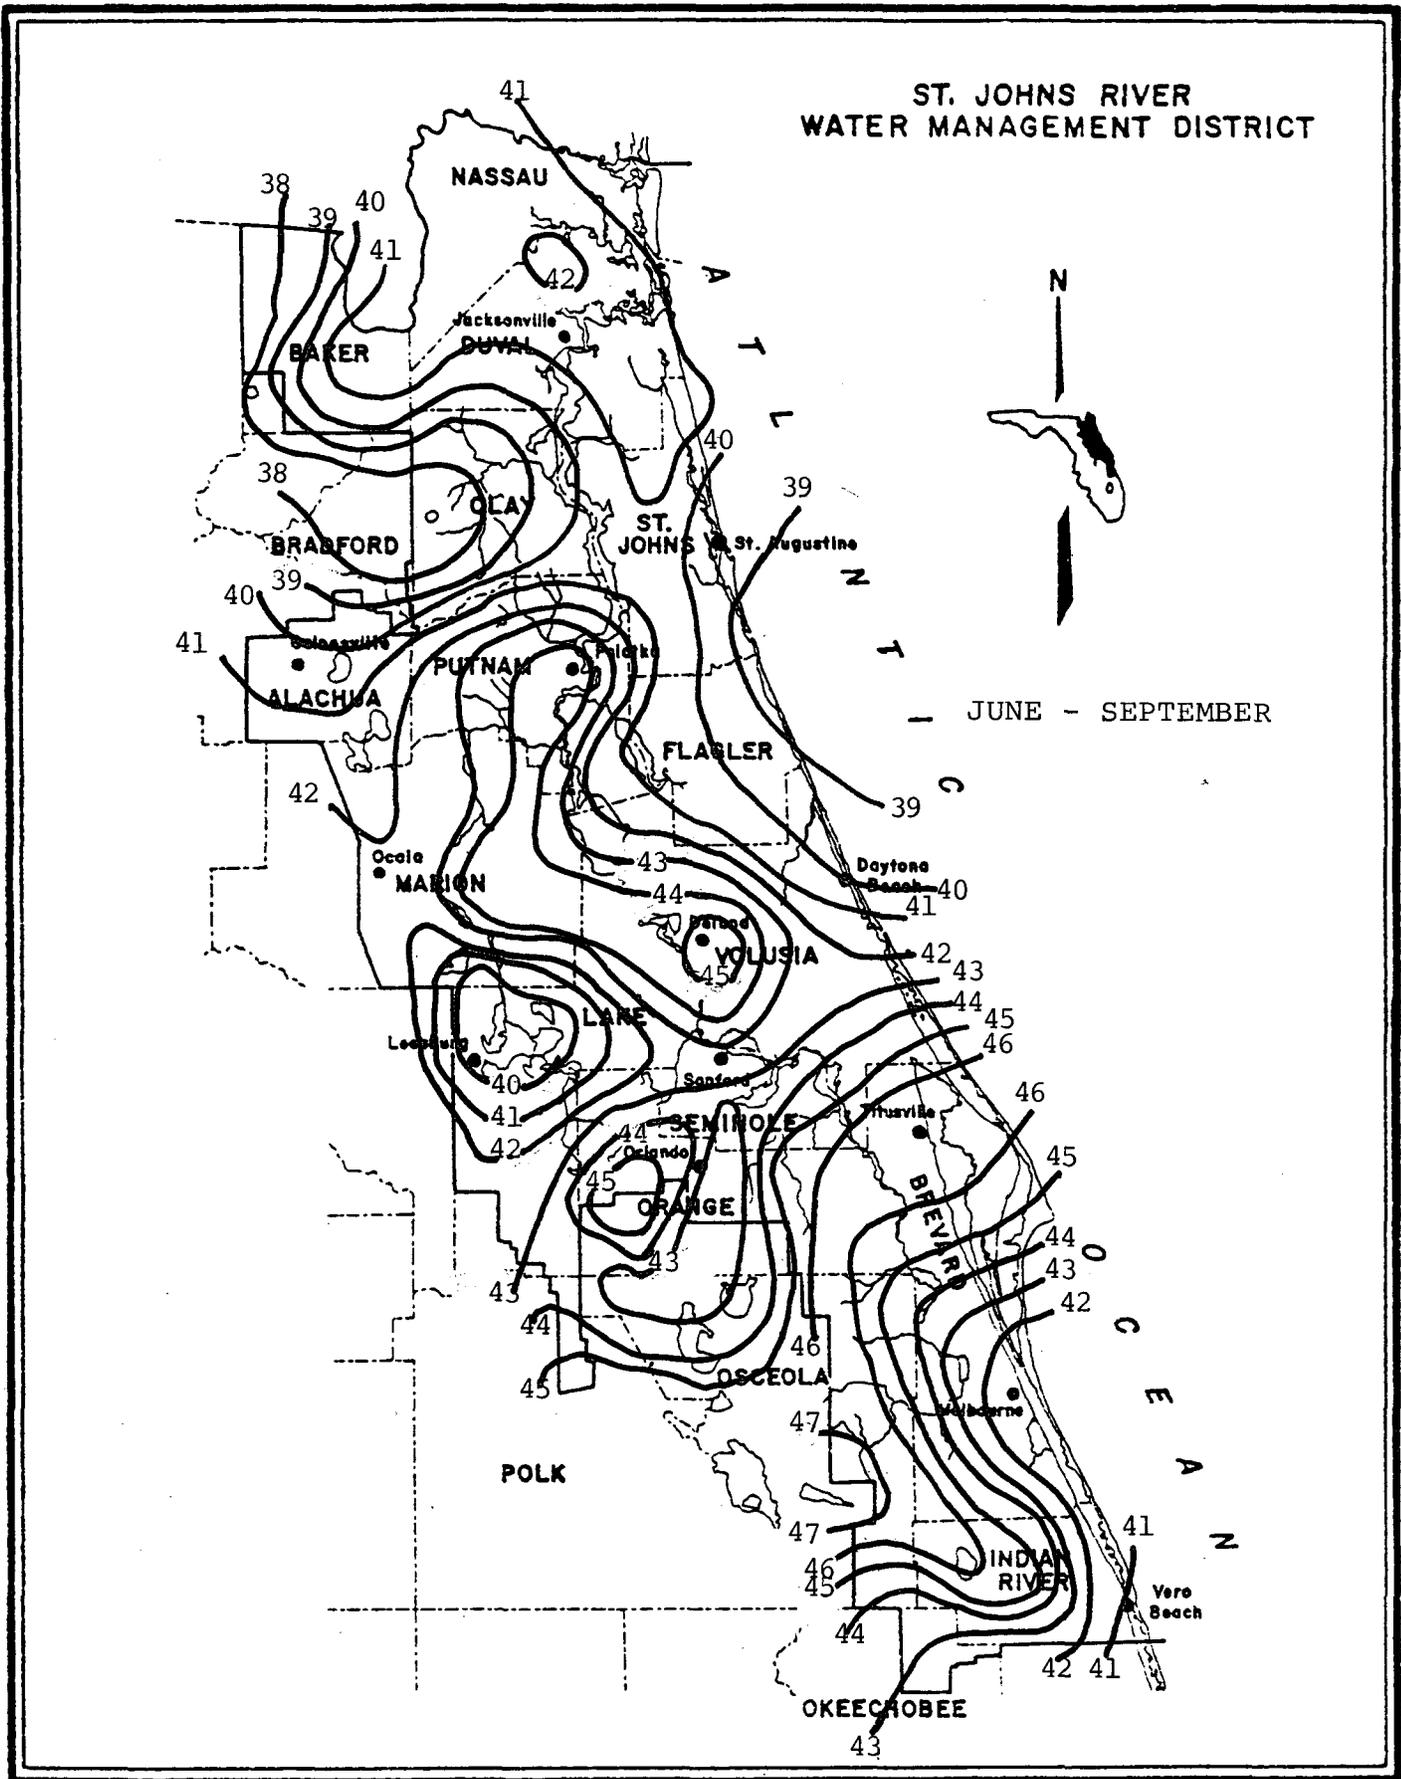


Figure 19. Warm season maximum rainfall, inches, T = 50 yr

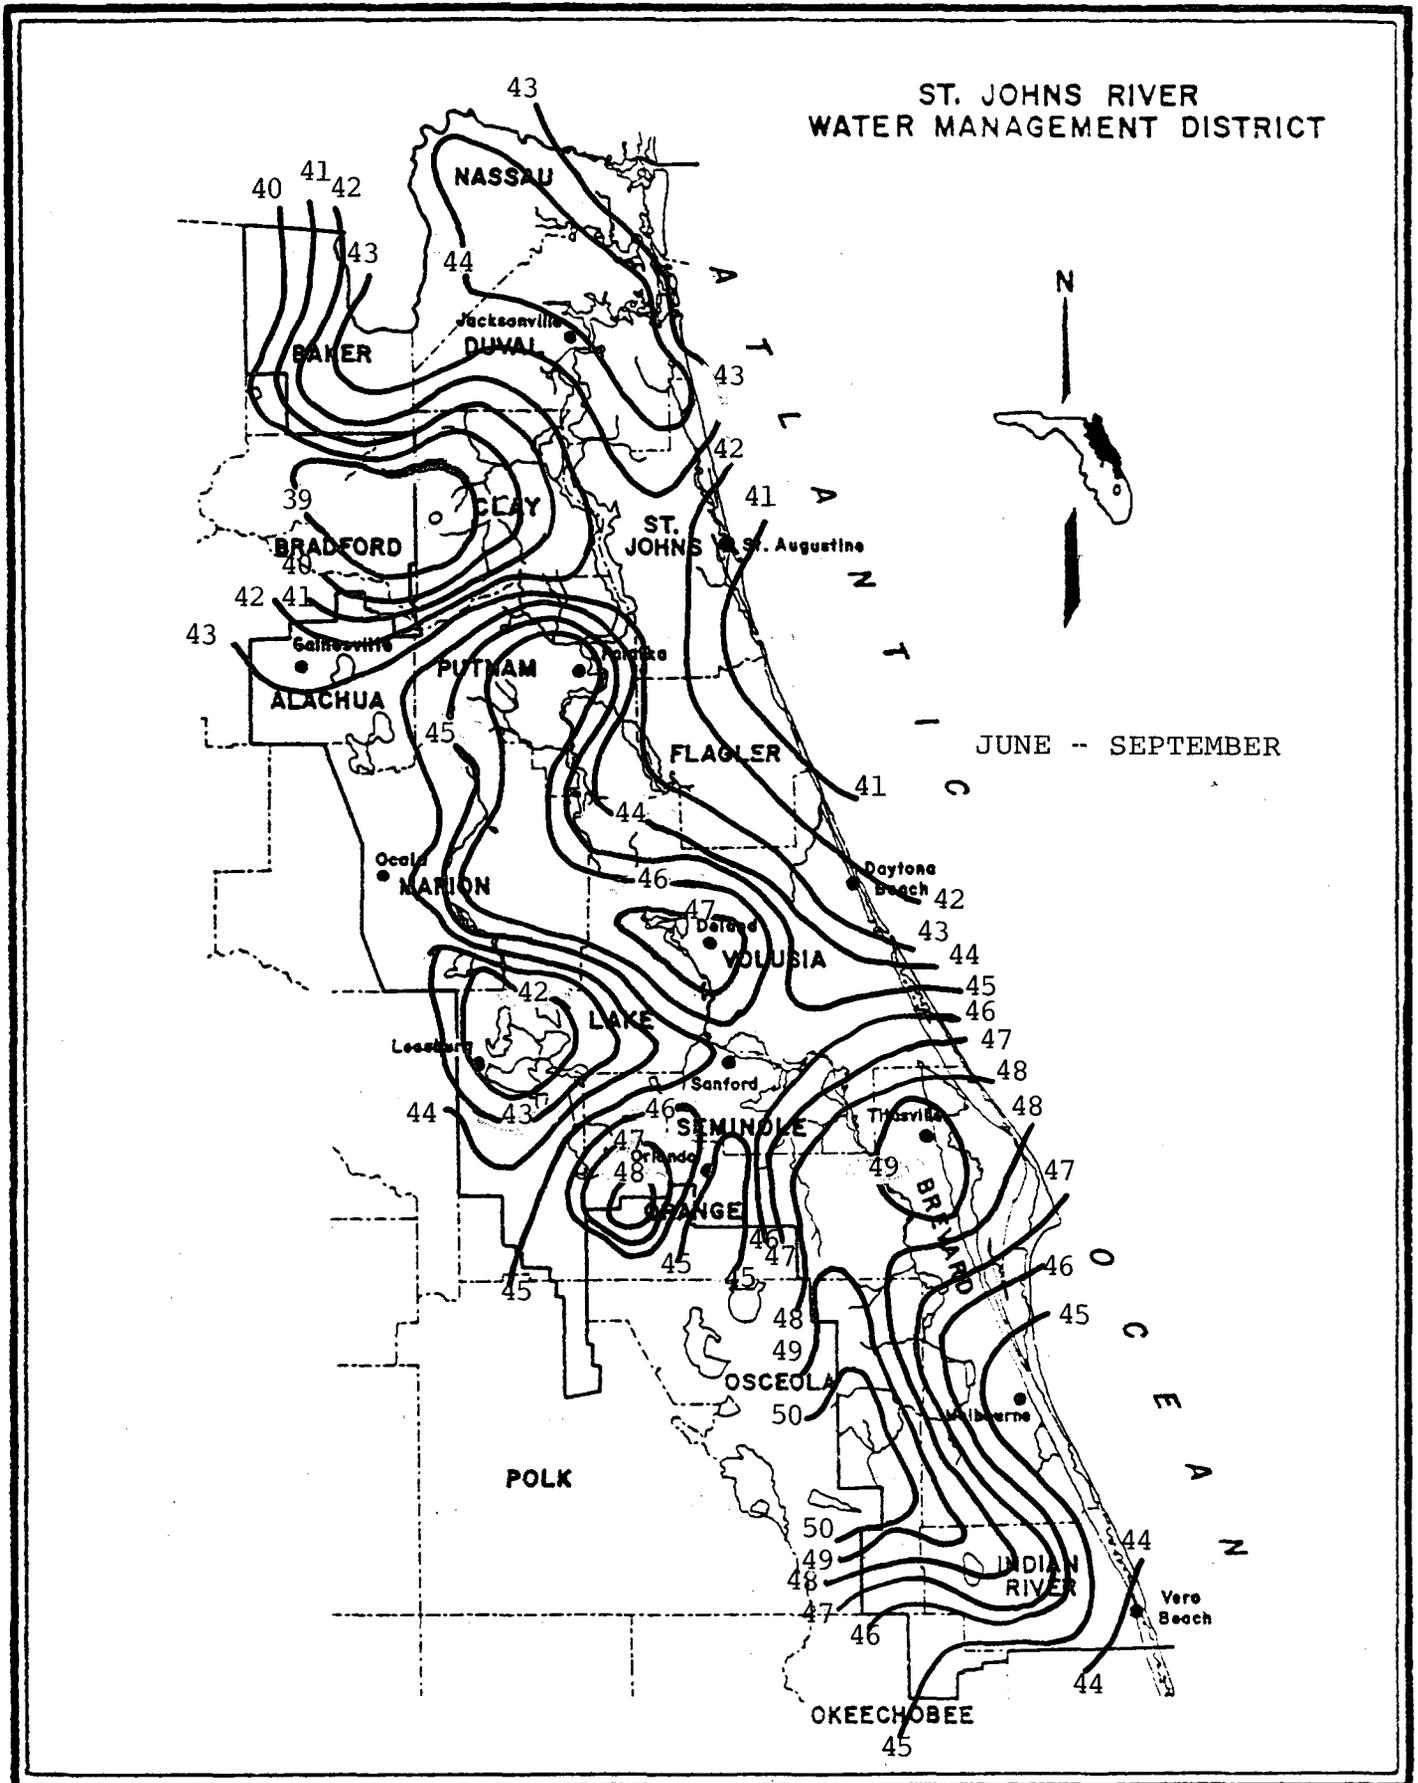


Figure 20. Warm season maximum rainfall, inches, T = 100 yr

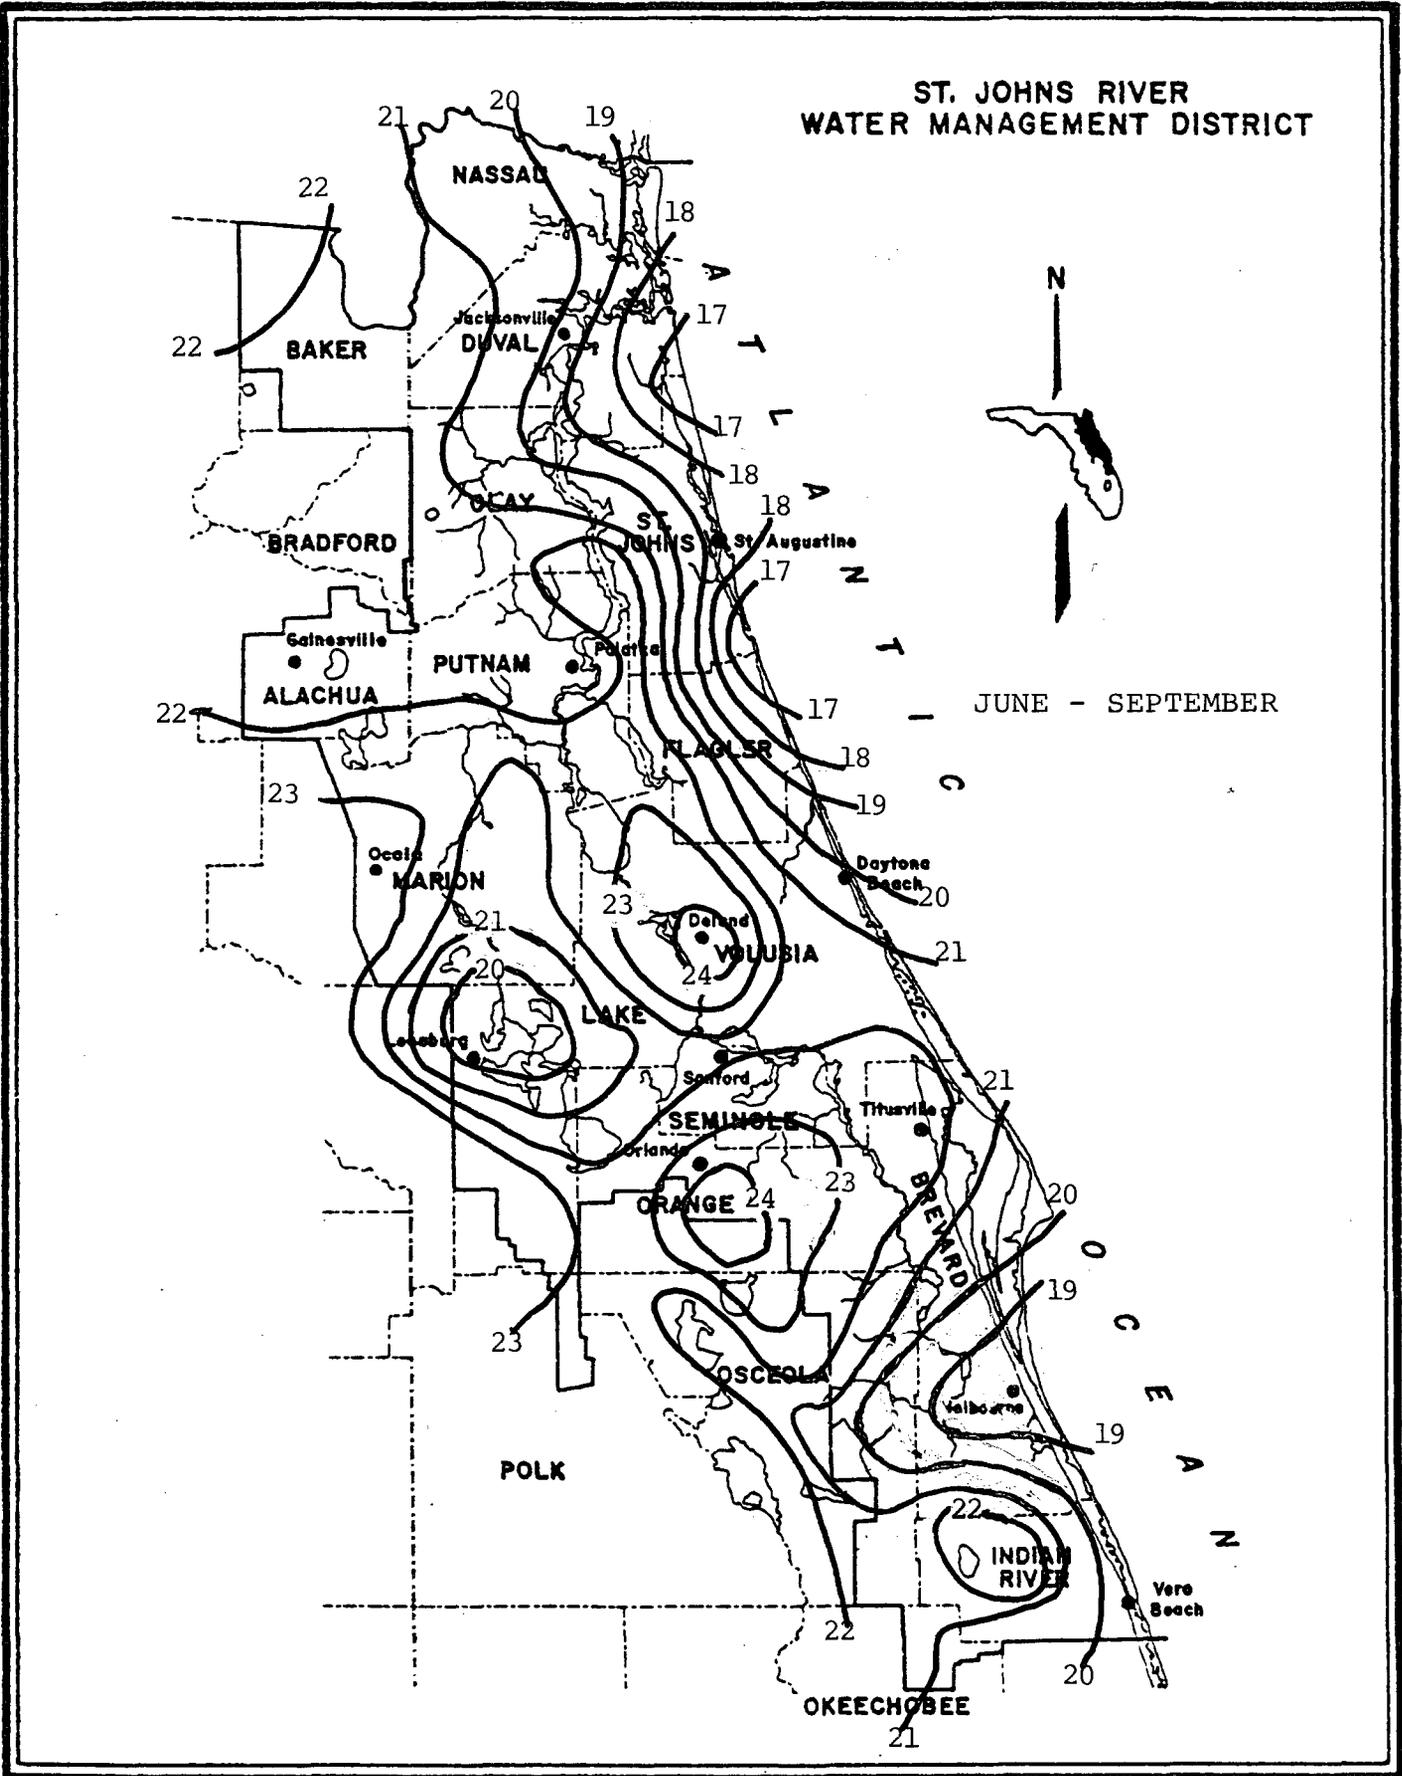


Figure 21. Warm season minimum rainfall, inches, T = 5 yr

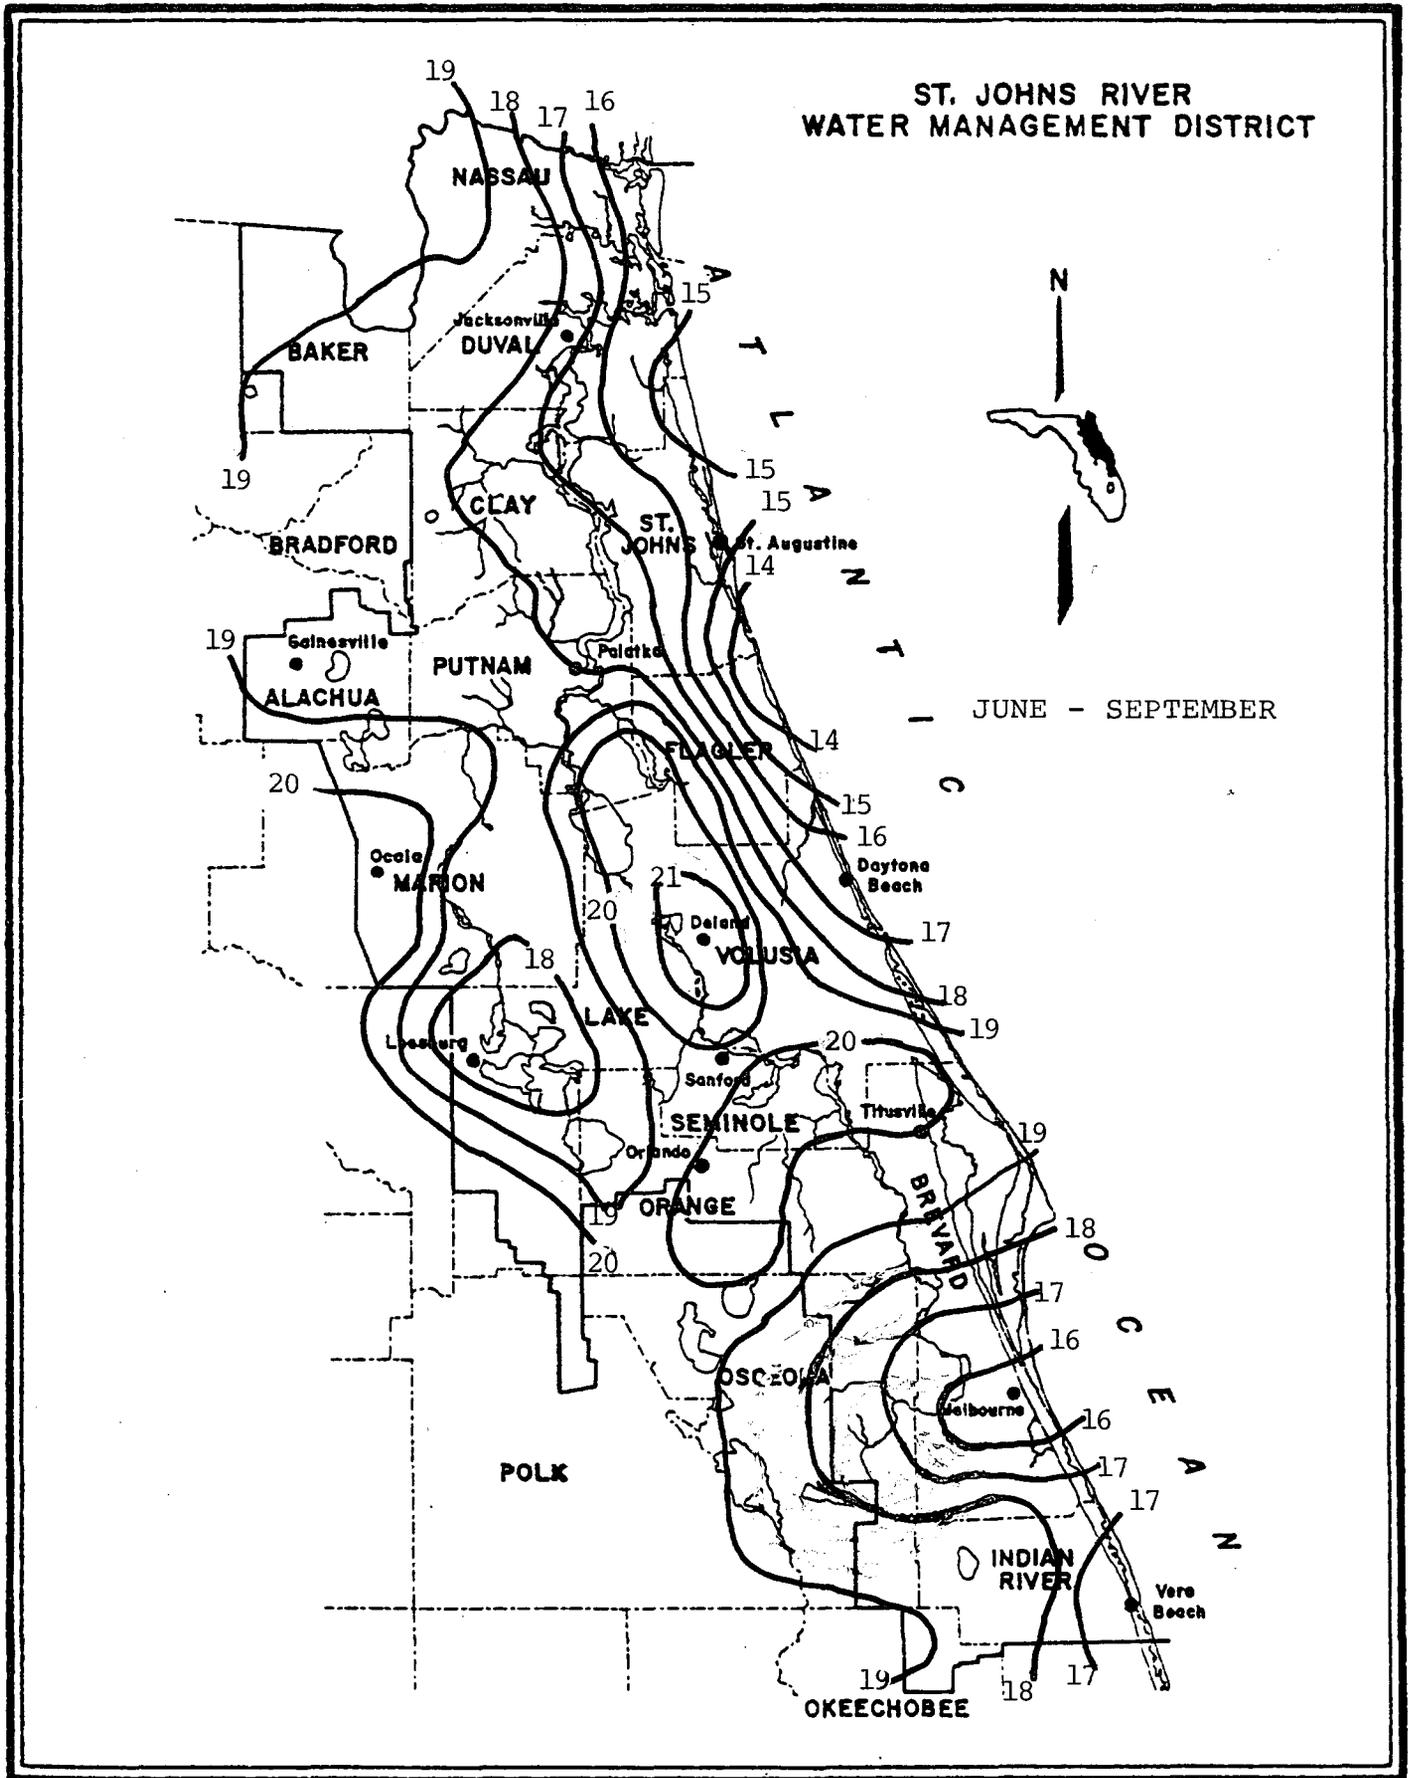


Figure 22. Warm season minimum rainfall, inches, T = 10 yr

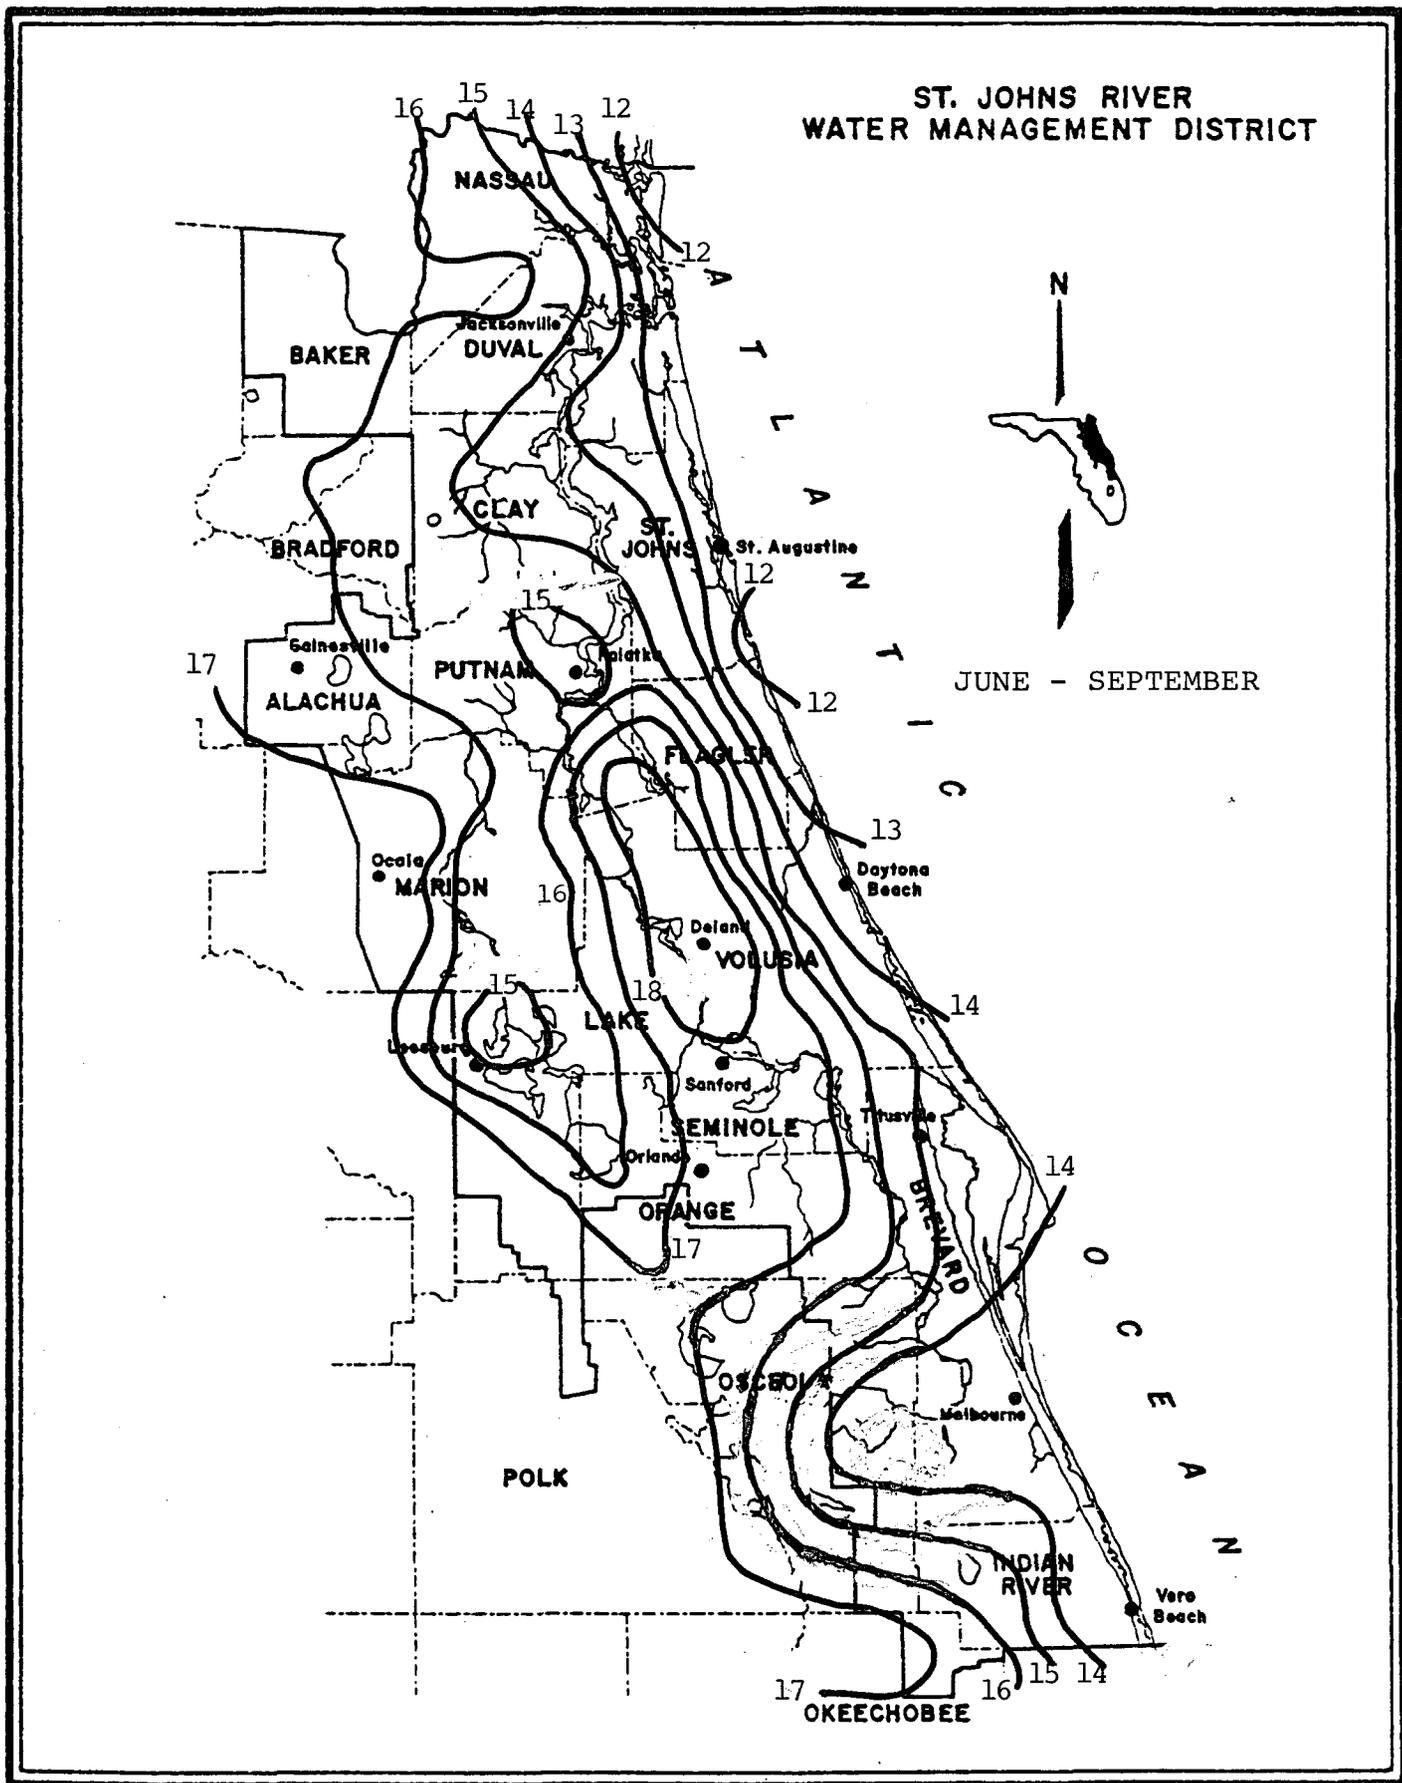


Figure 23. Warm season minimum rainfall, inches, T = 25 yr

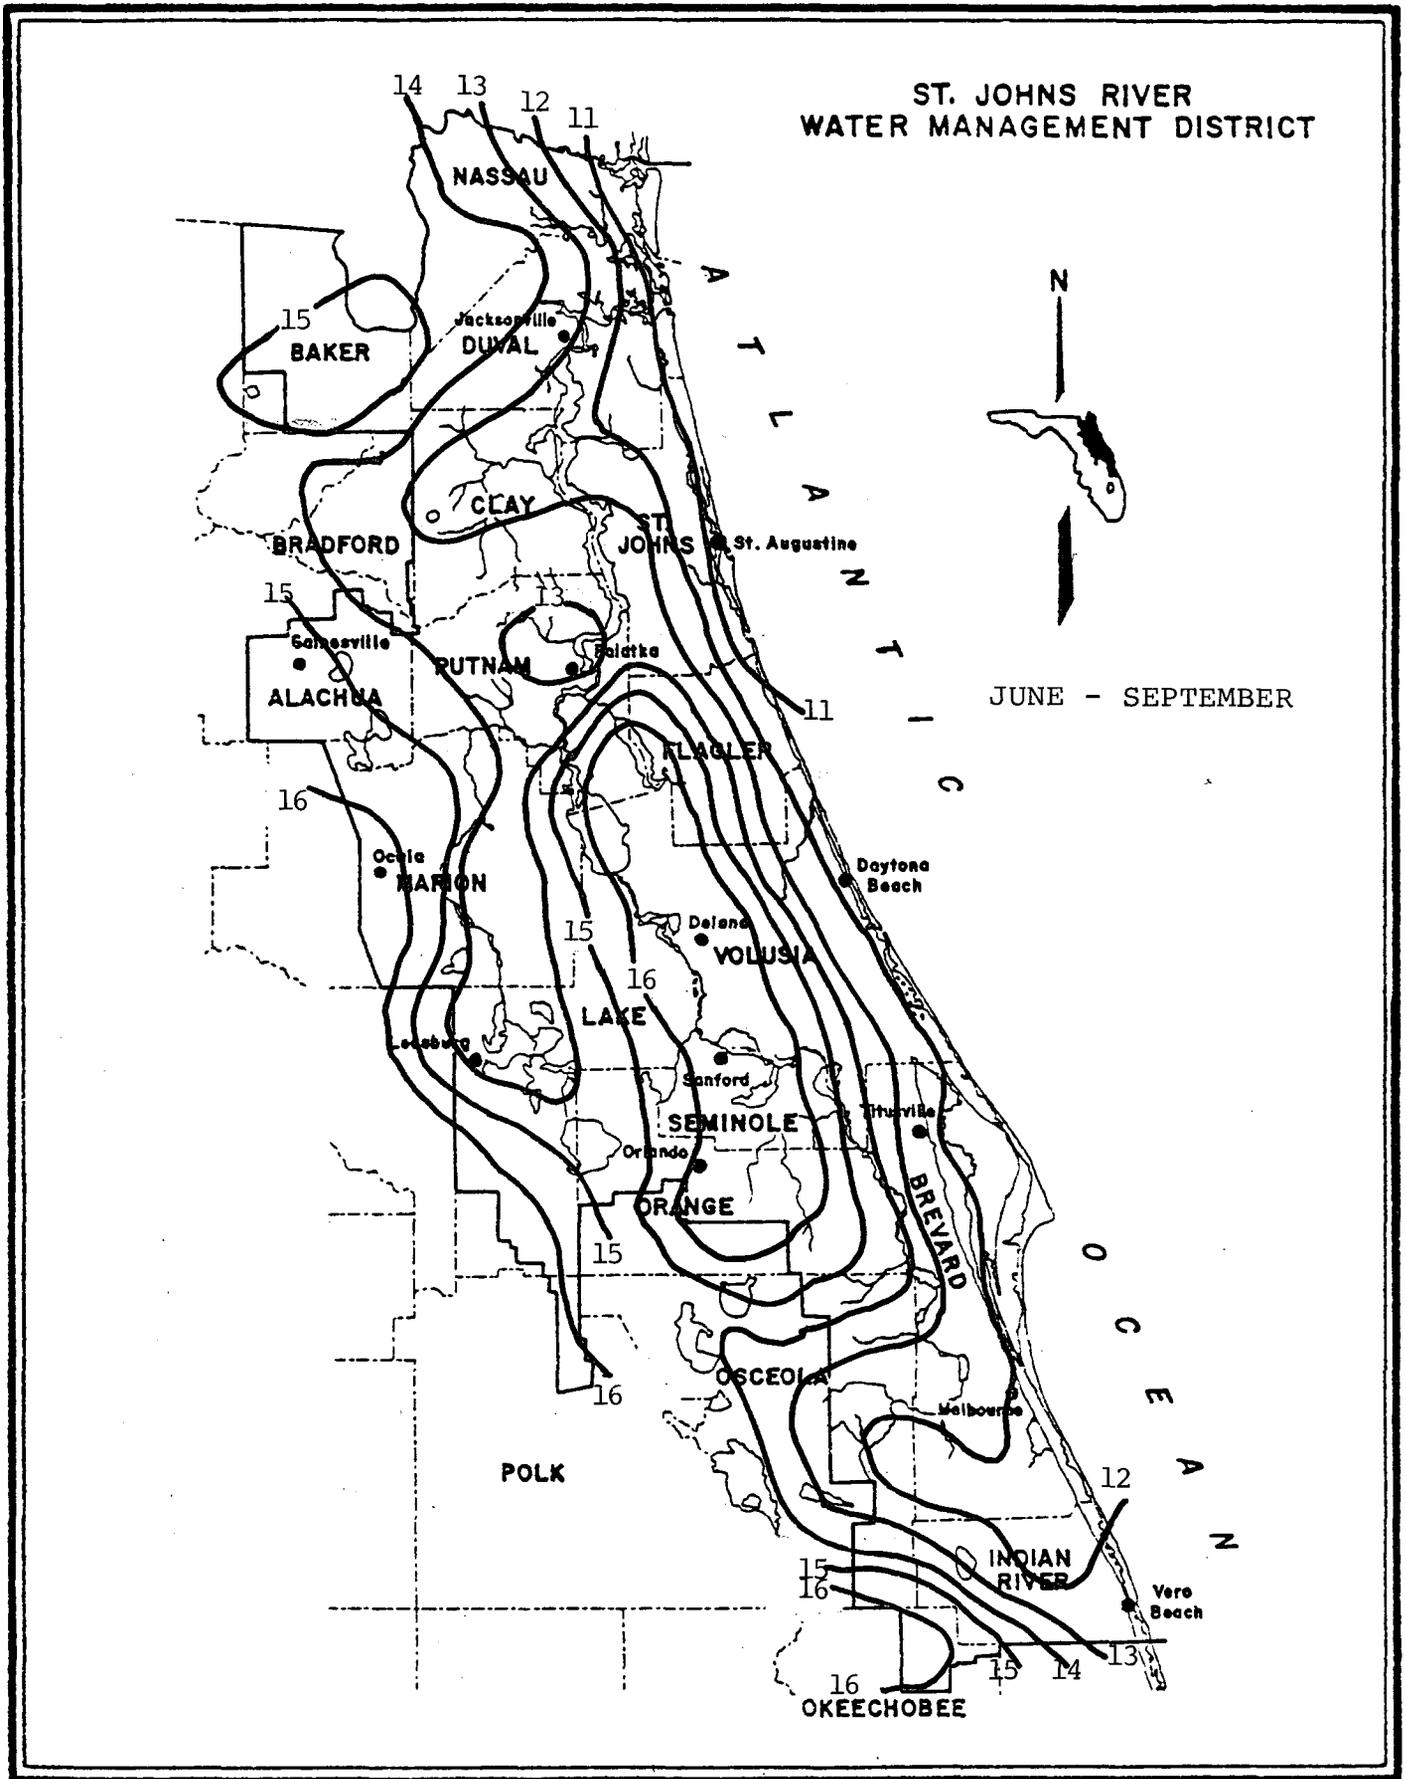


Figure 24. Warm season minimum rainfall, inches, T = 50 yr

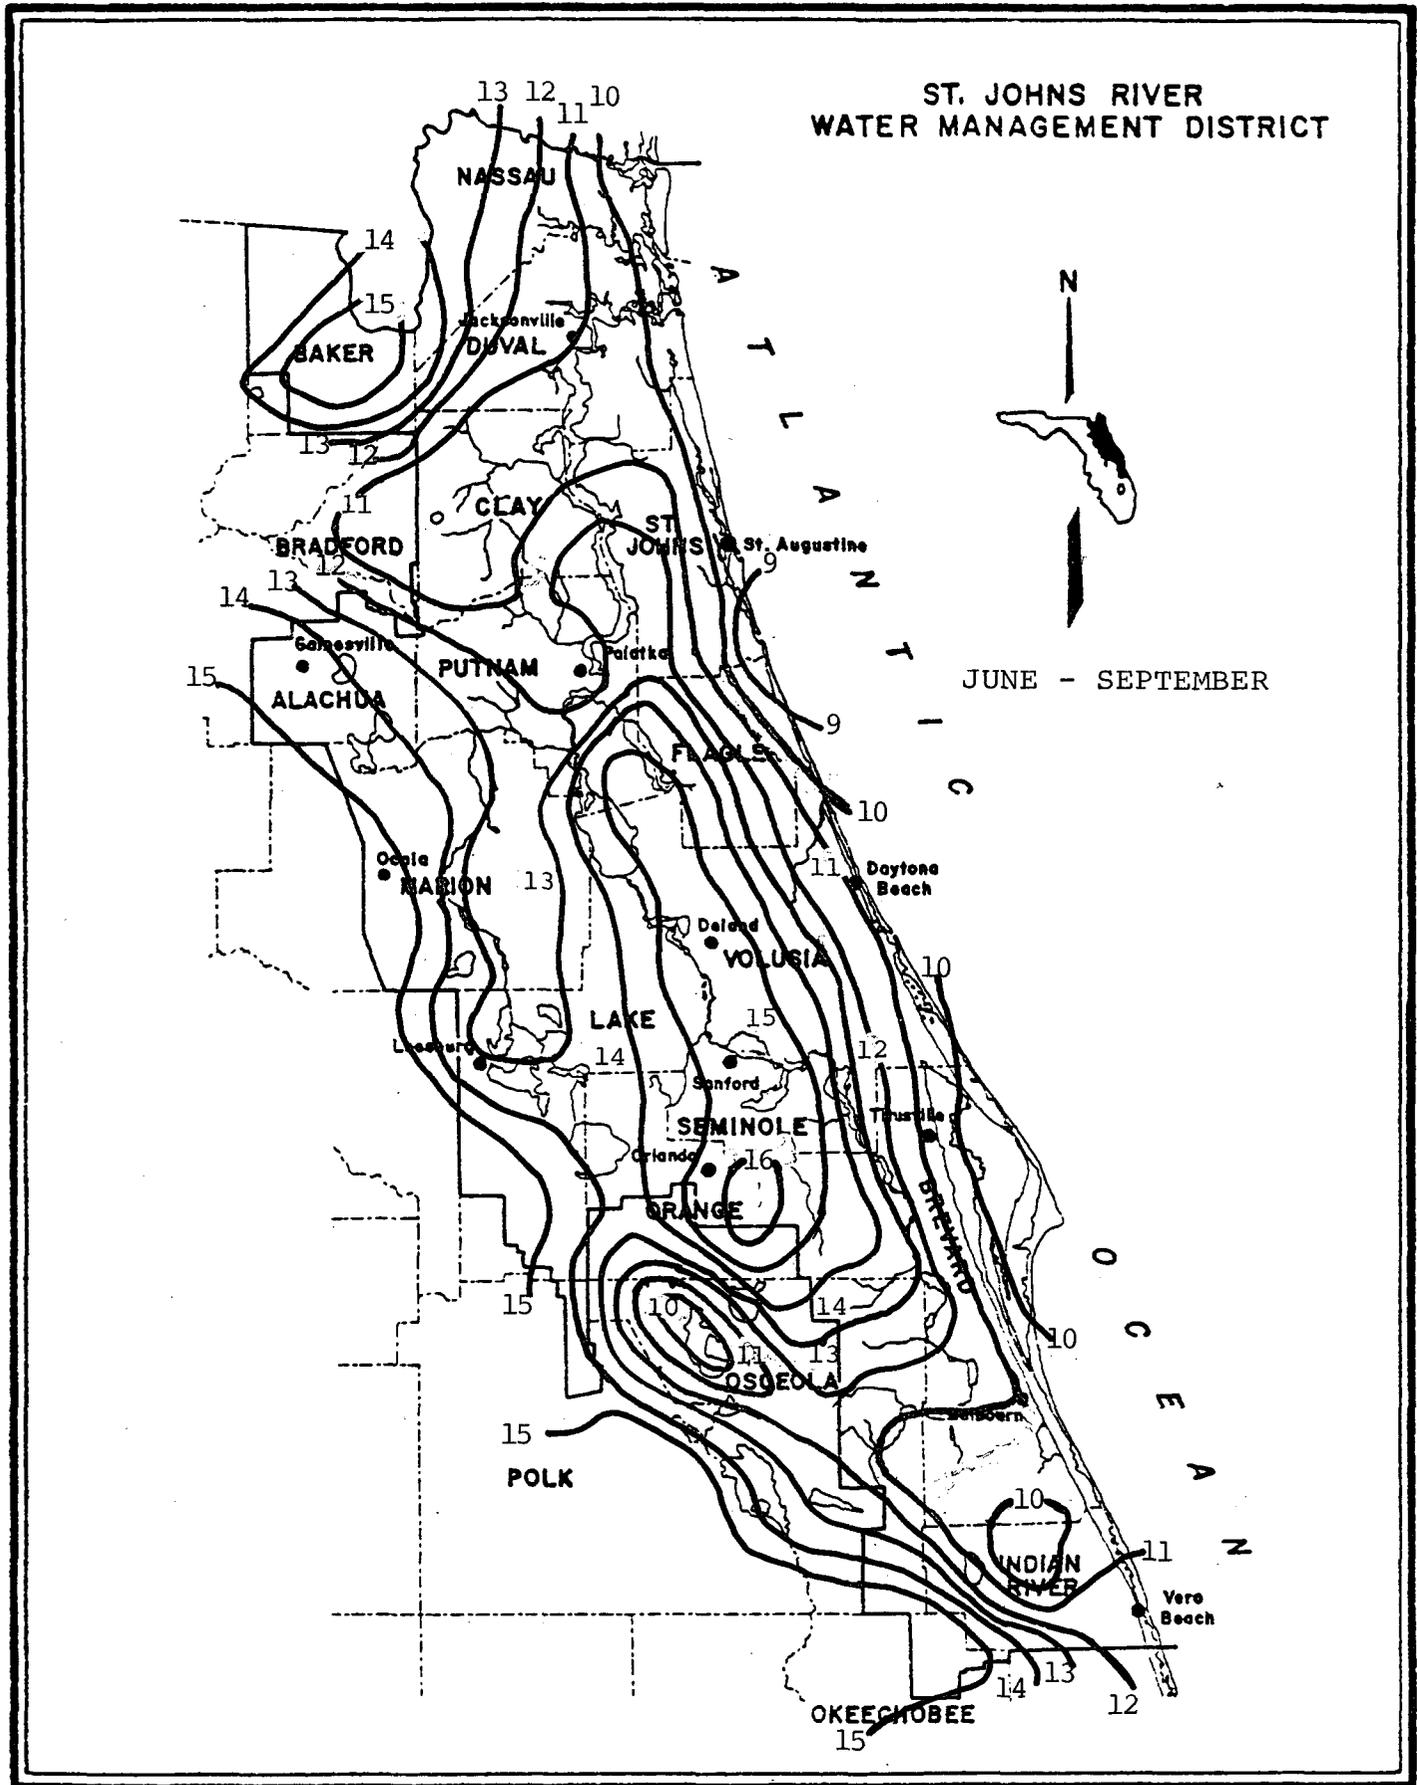


Figure 25. Warm season minimum rainfall, inches, T = 100 yr

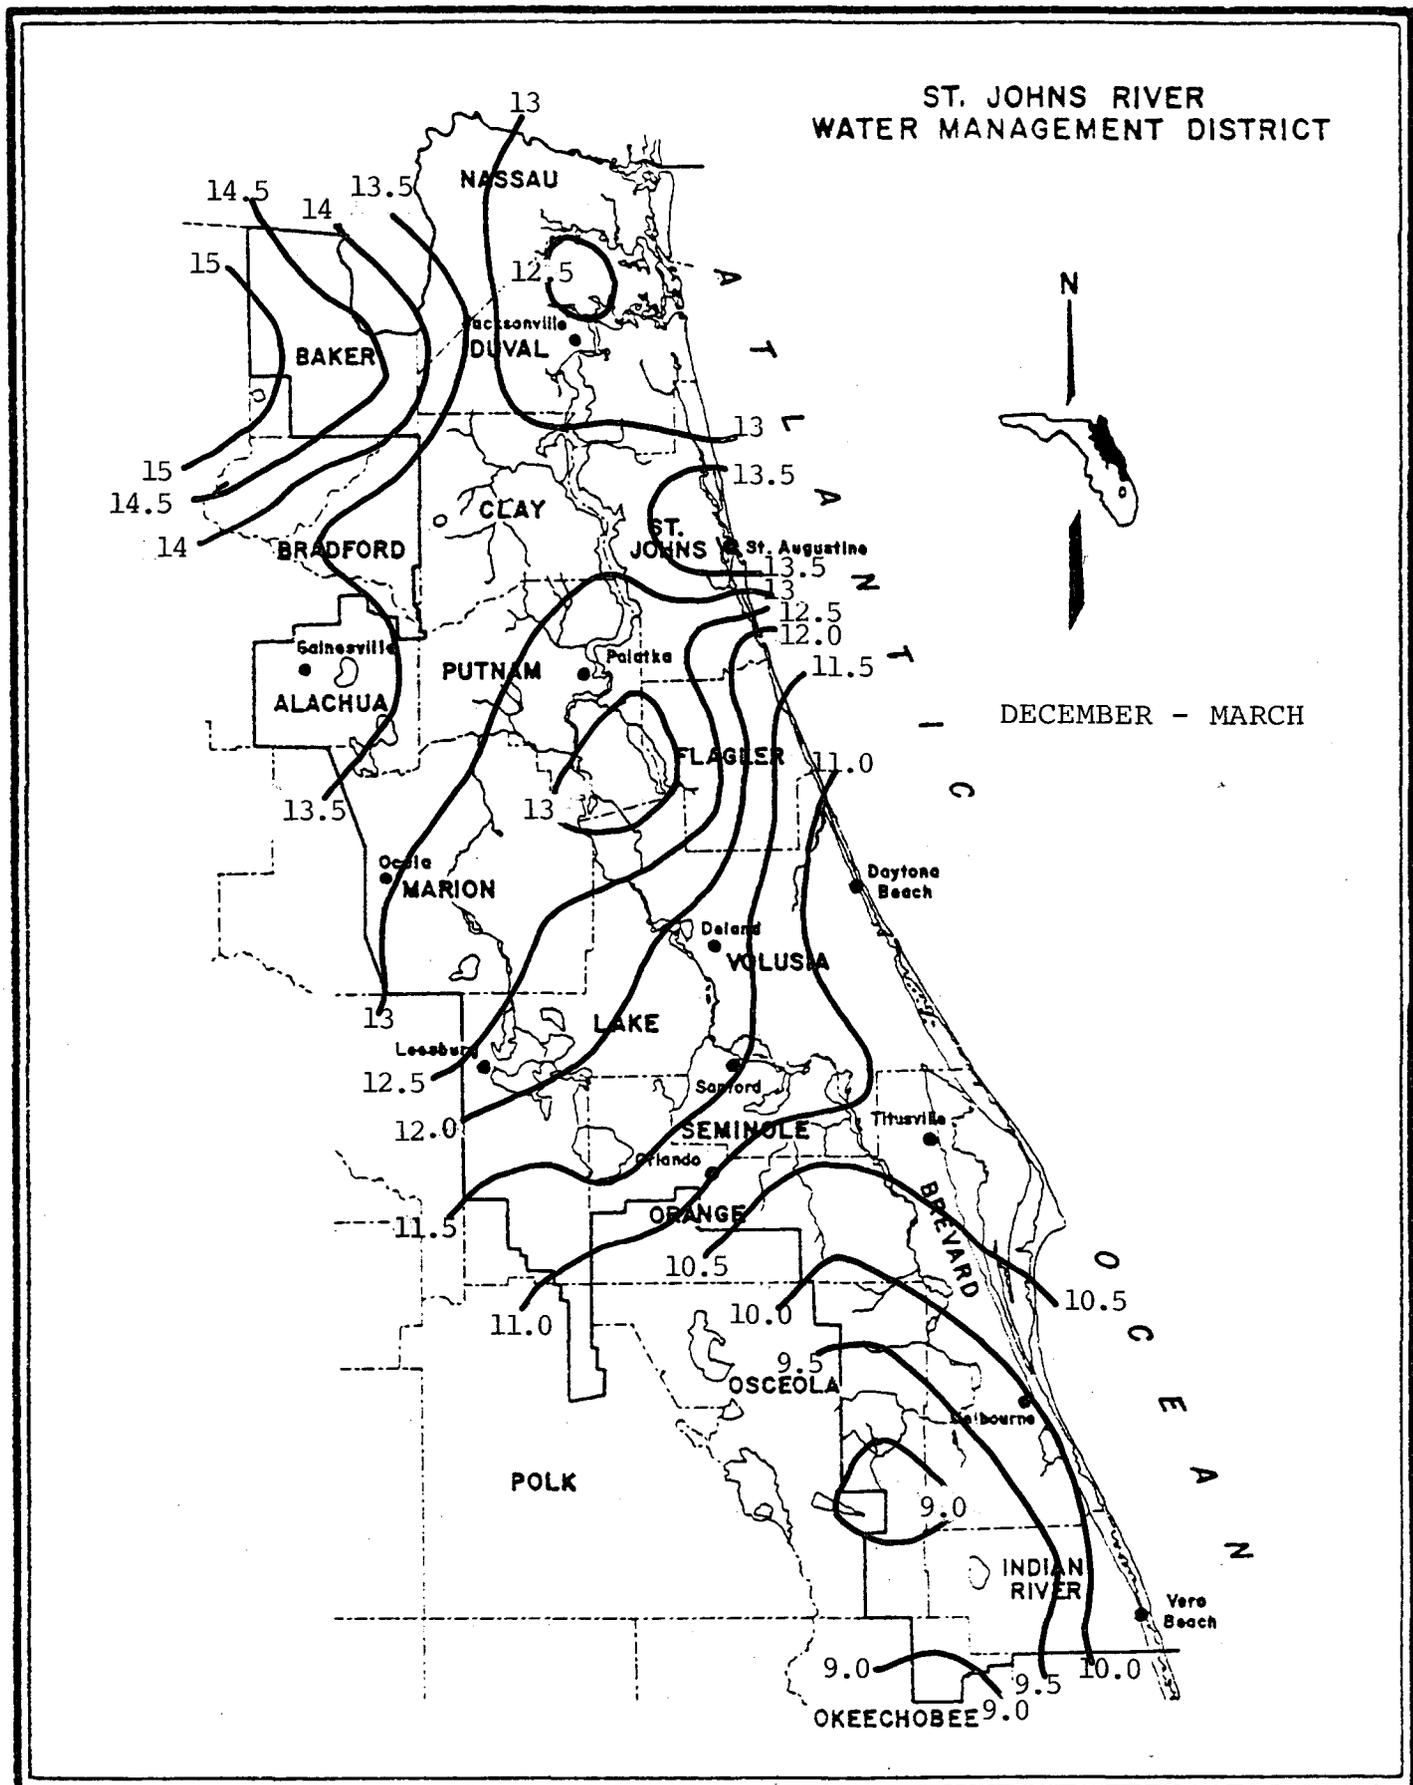


Figure 26. Cold season normal rainfall, inches

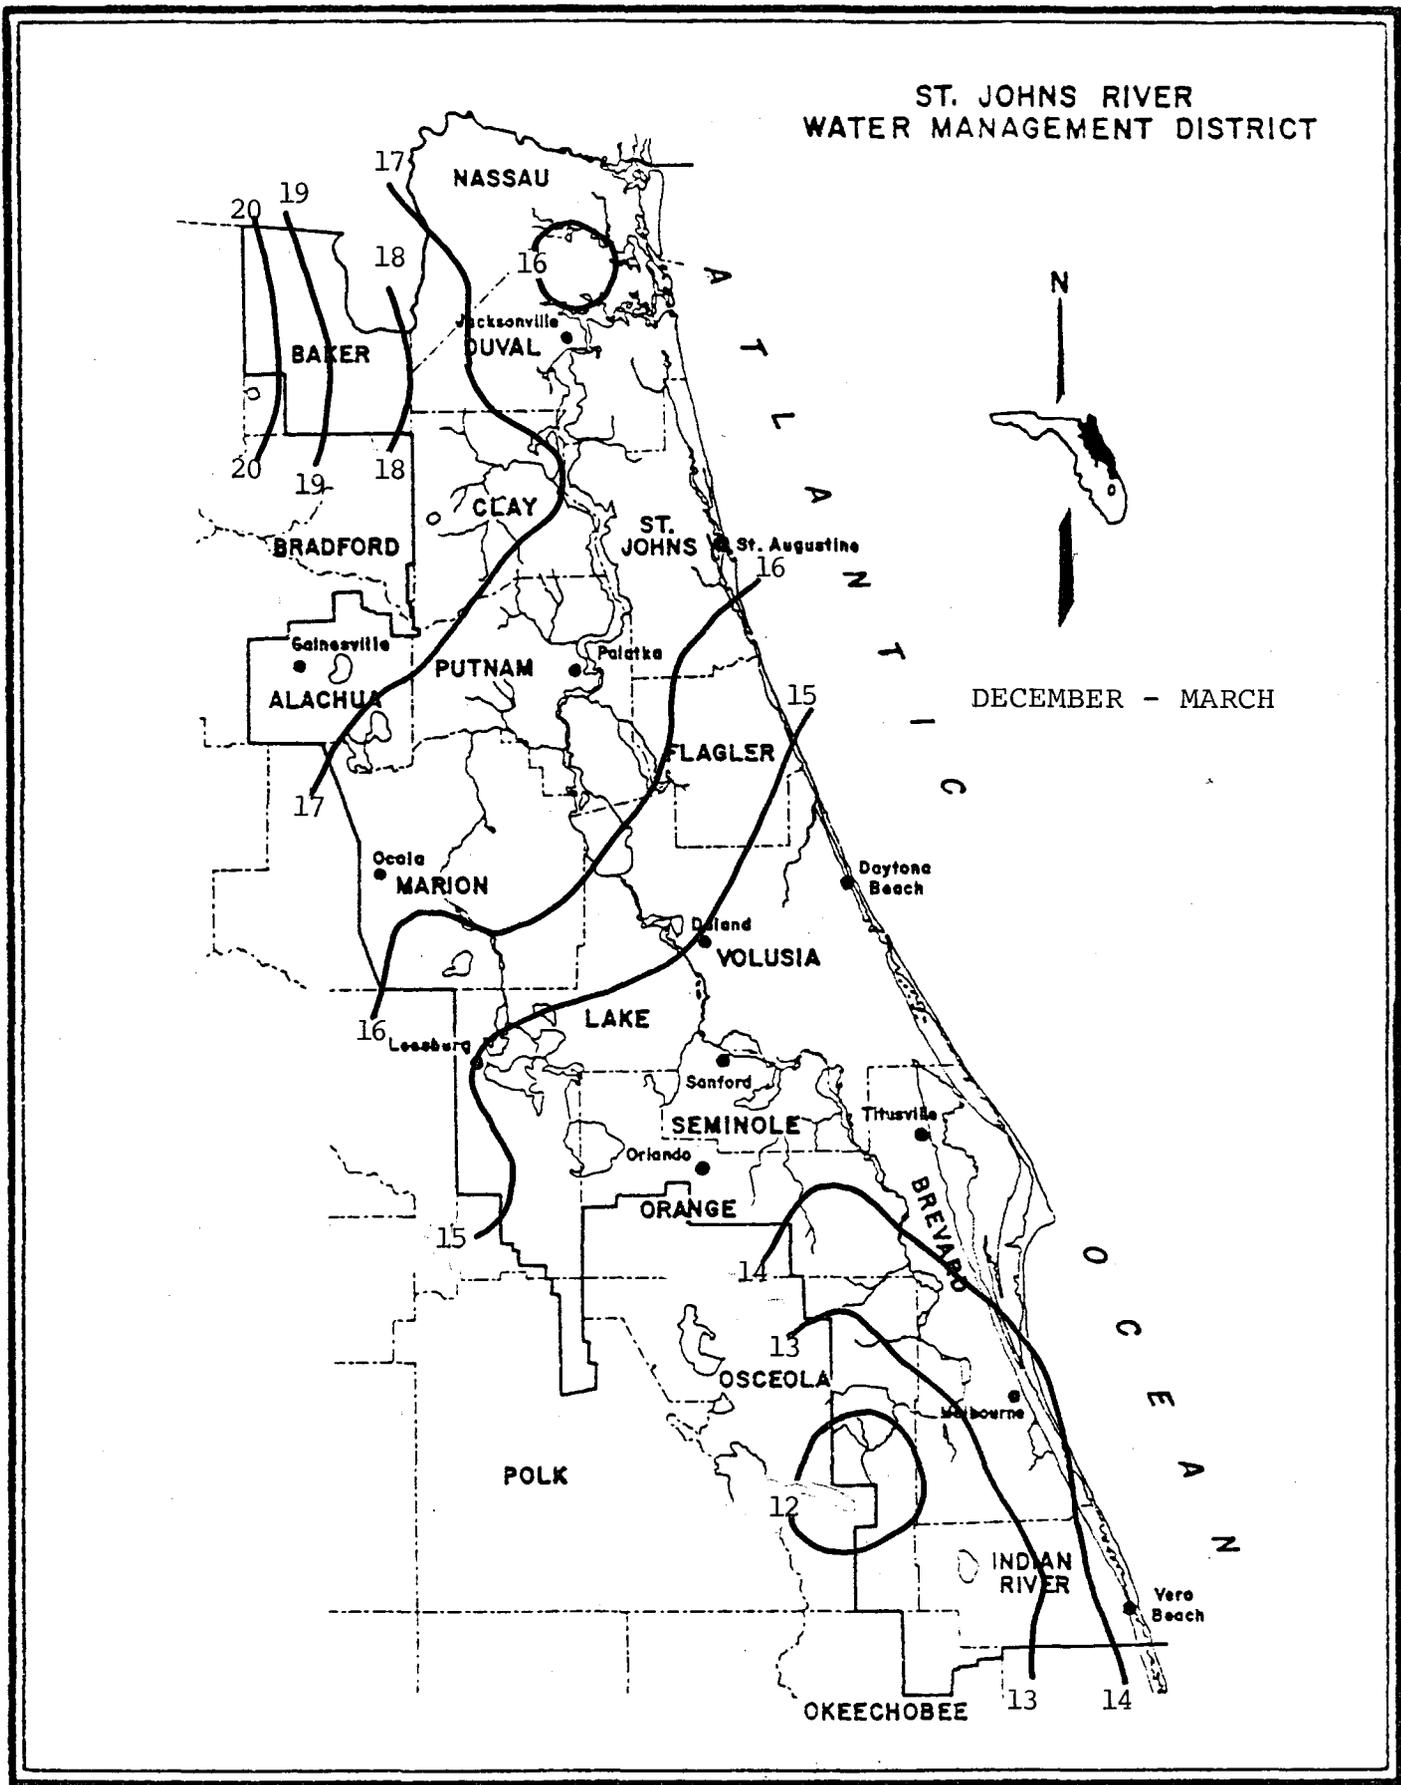


Figure 27. Cold season maximum rainfall, inches, $T = 5$ yr

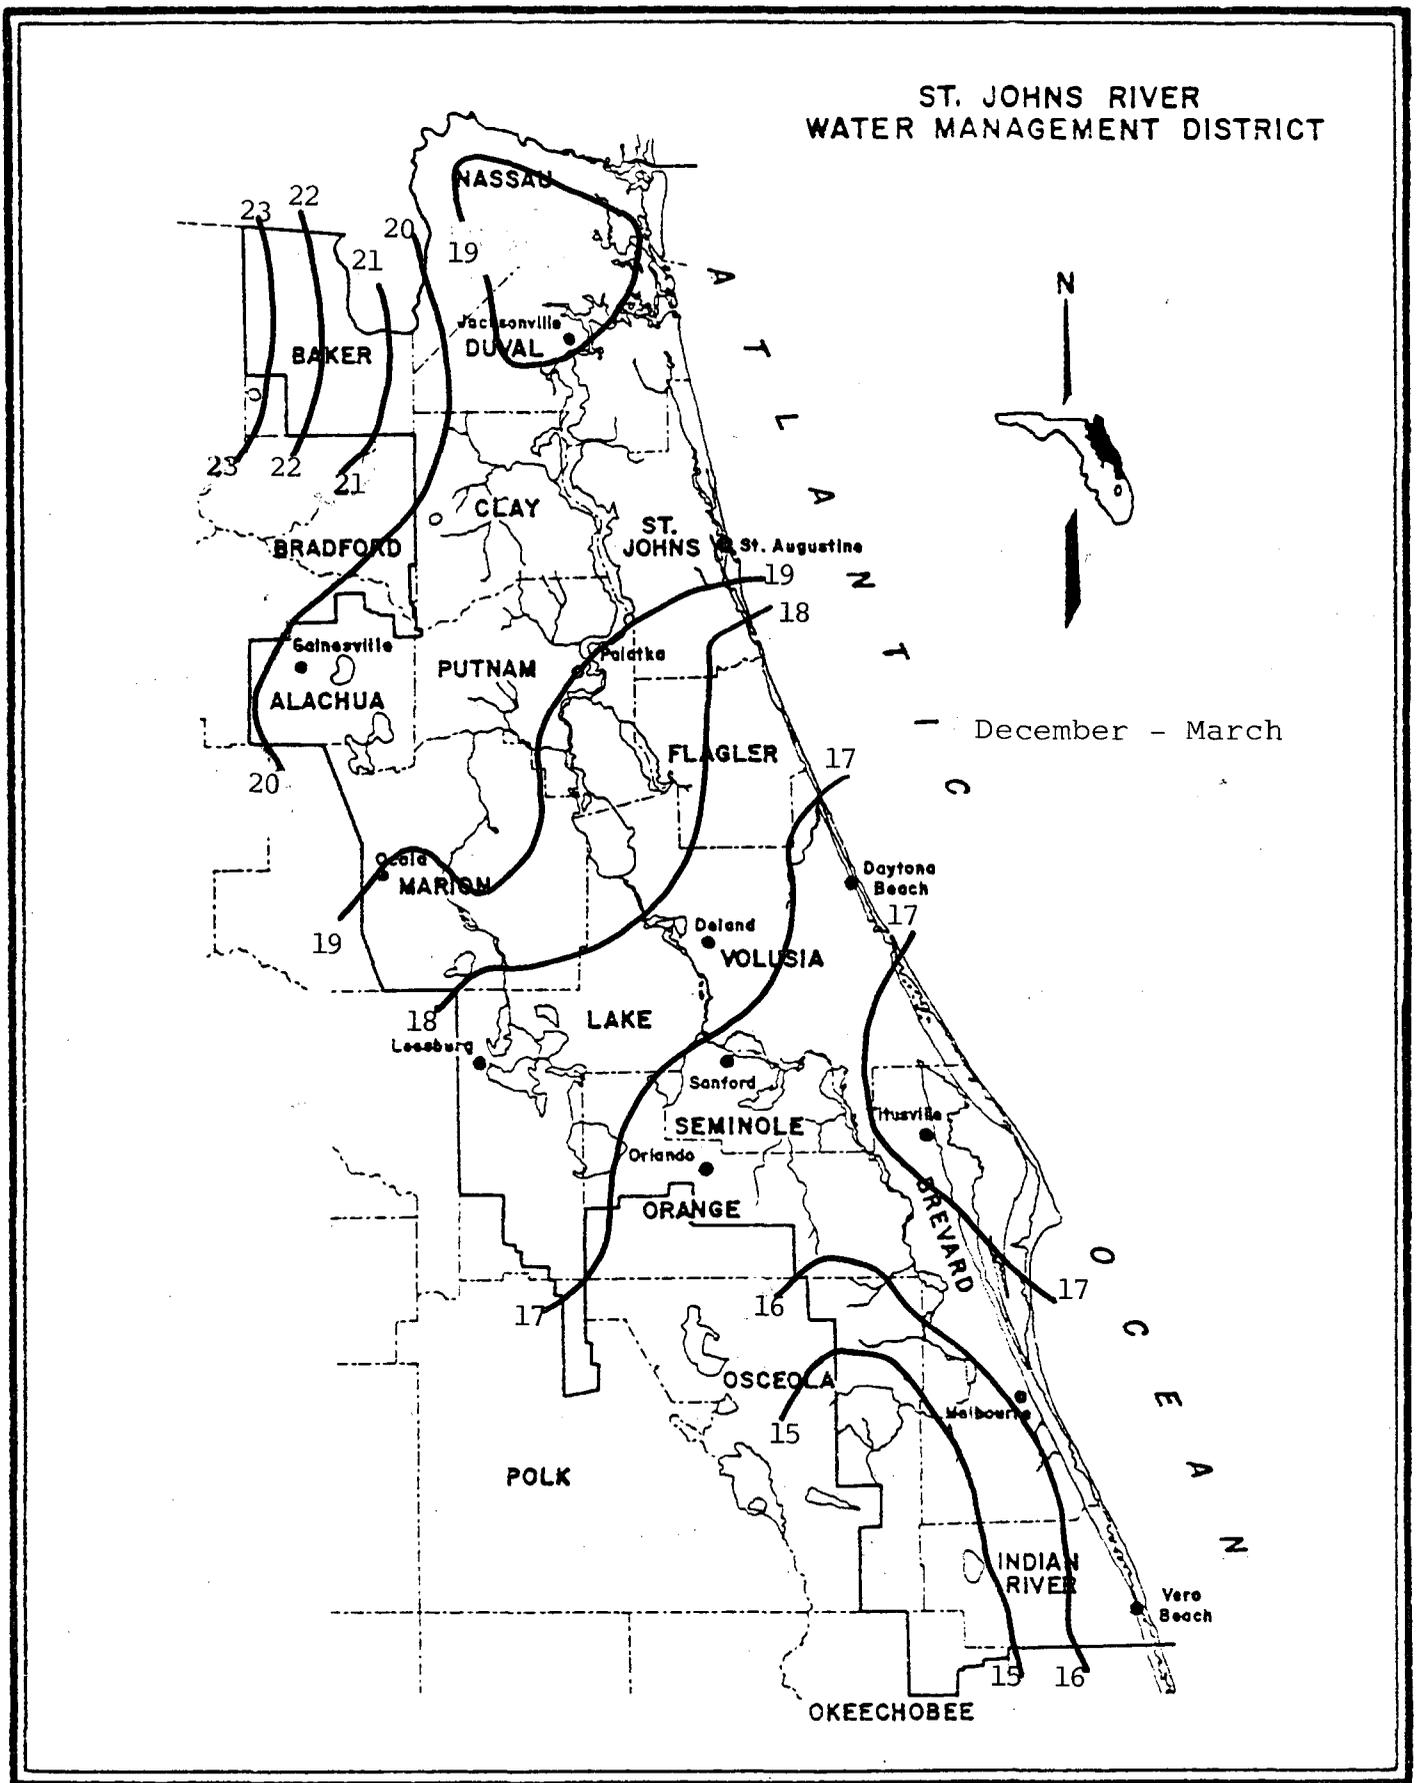


Figure 28. Cold season maximum rainfall, inches, T = 10 yr

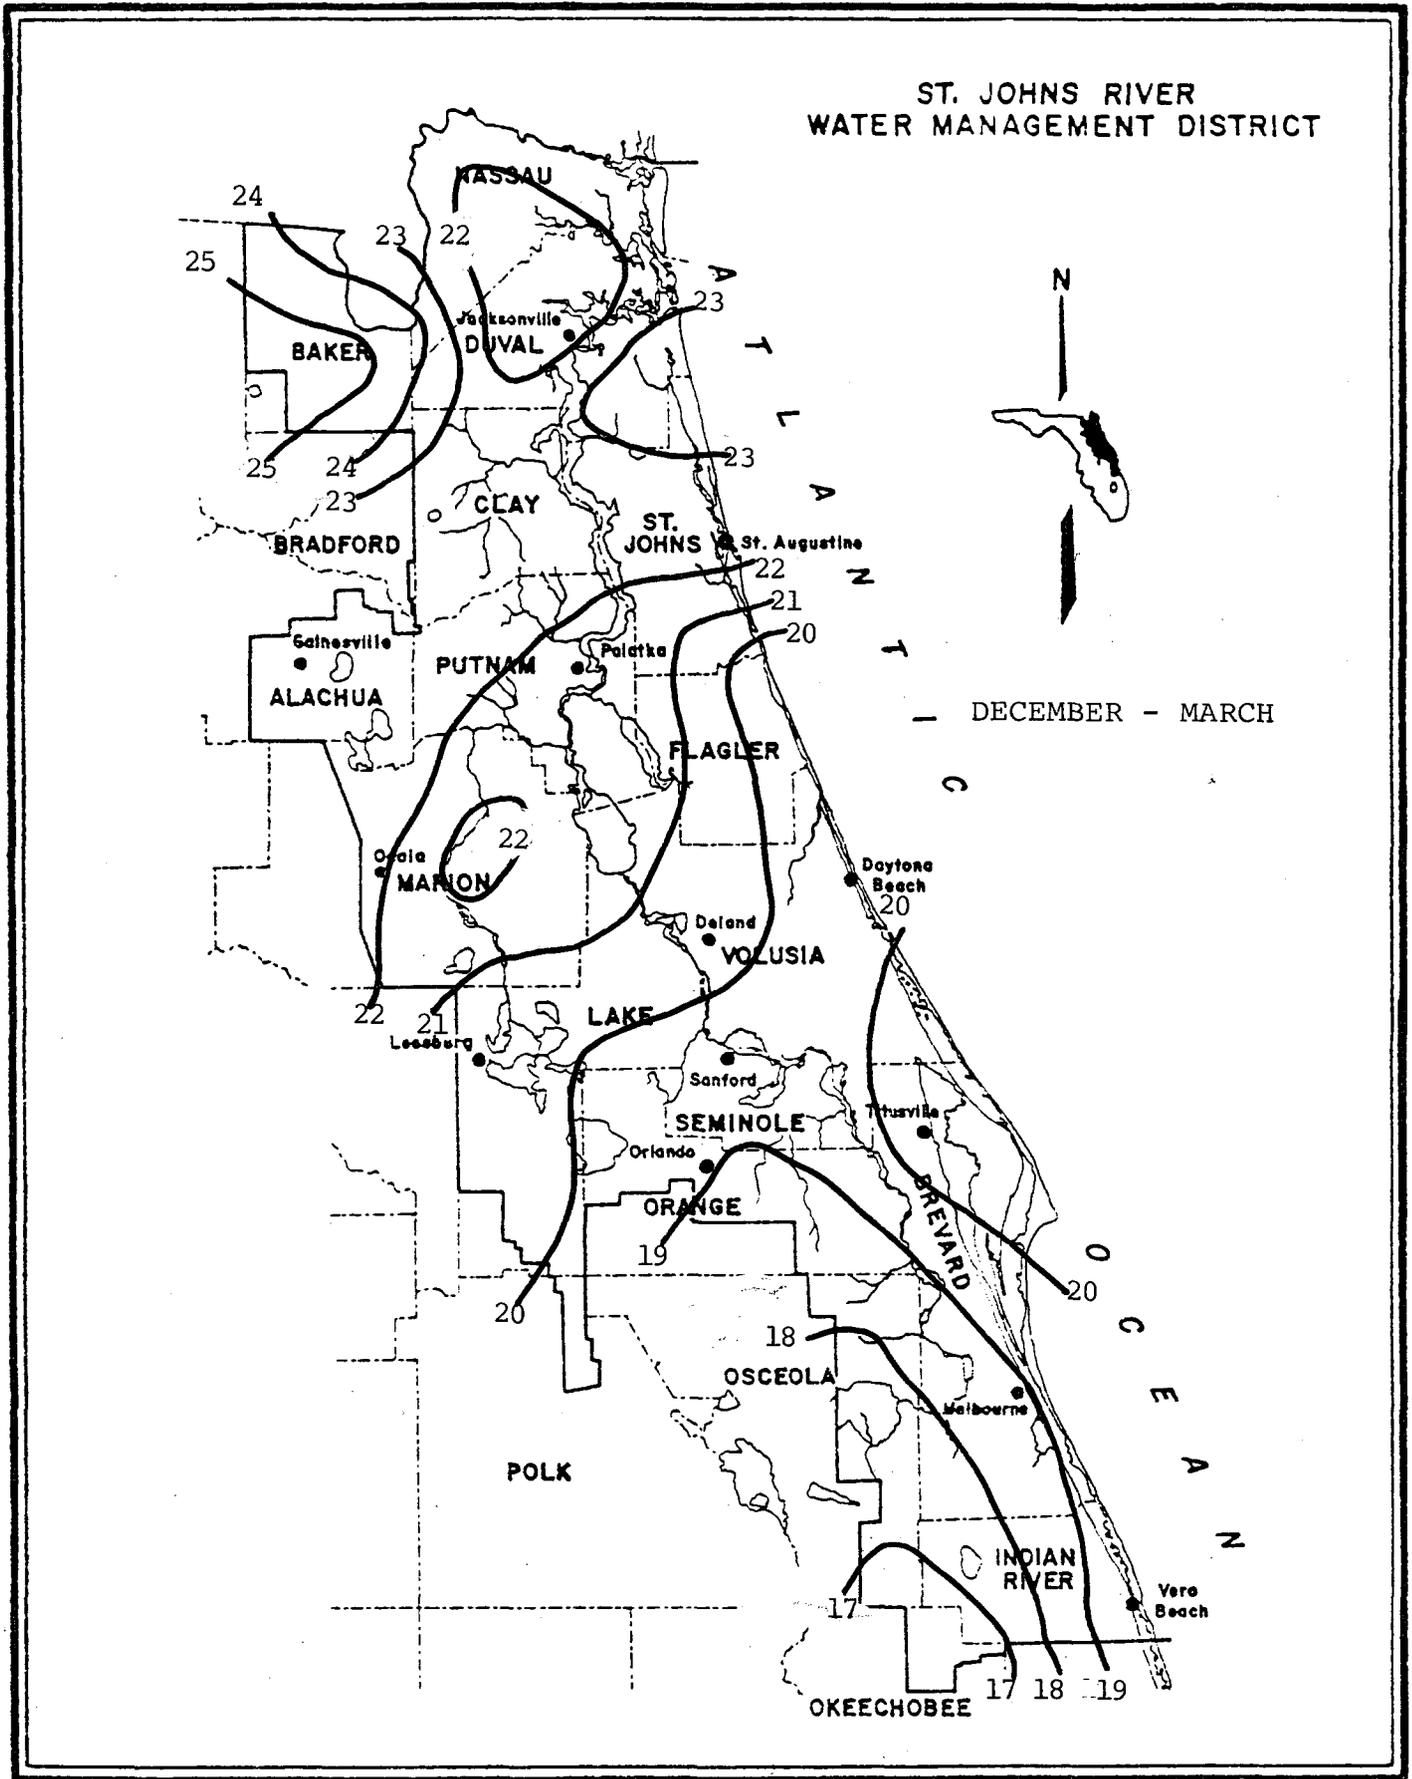


Figure 29. Cold season maximum rainfall, inches, T = 25 yr

ST. JOHNS RIVER
WATER MANAGEMENT DISTRICT

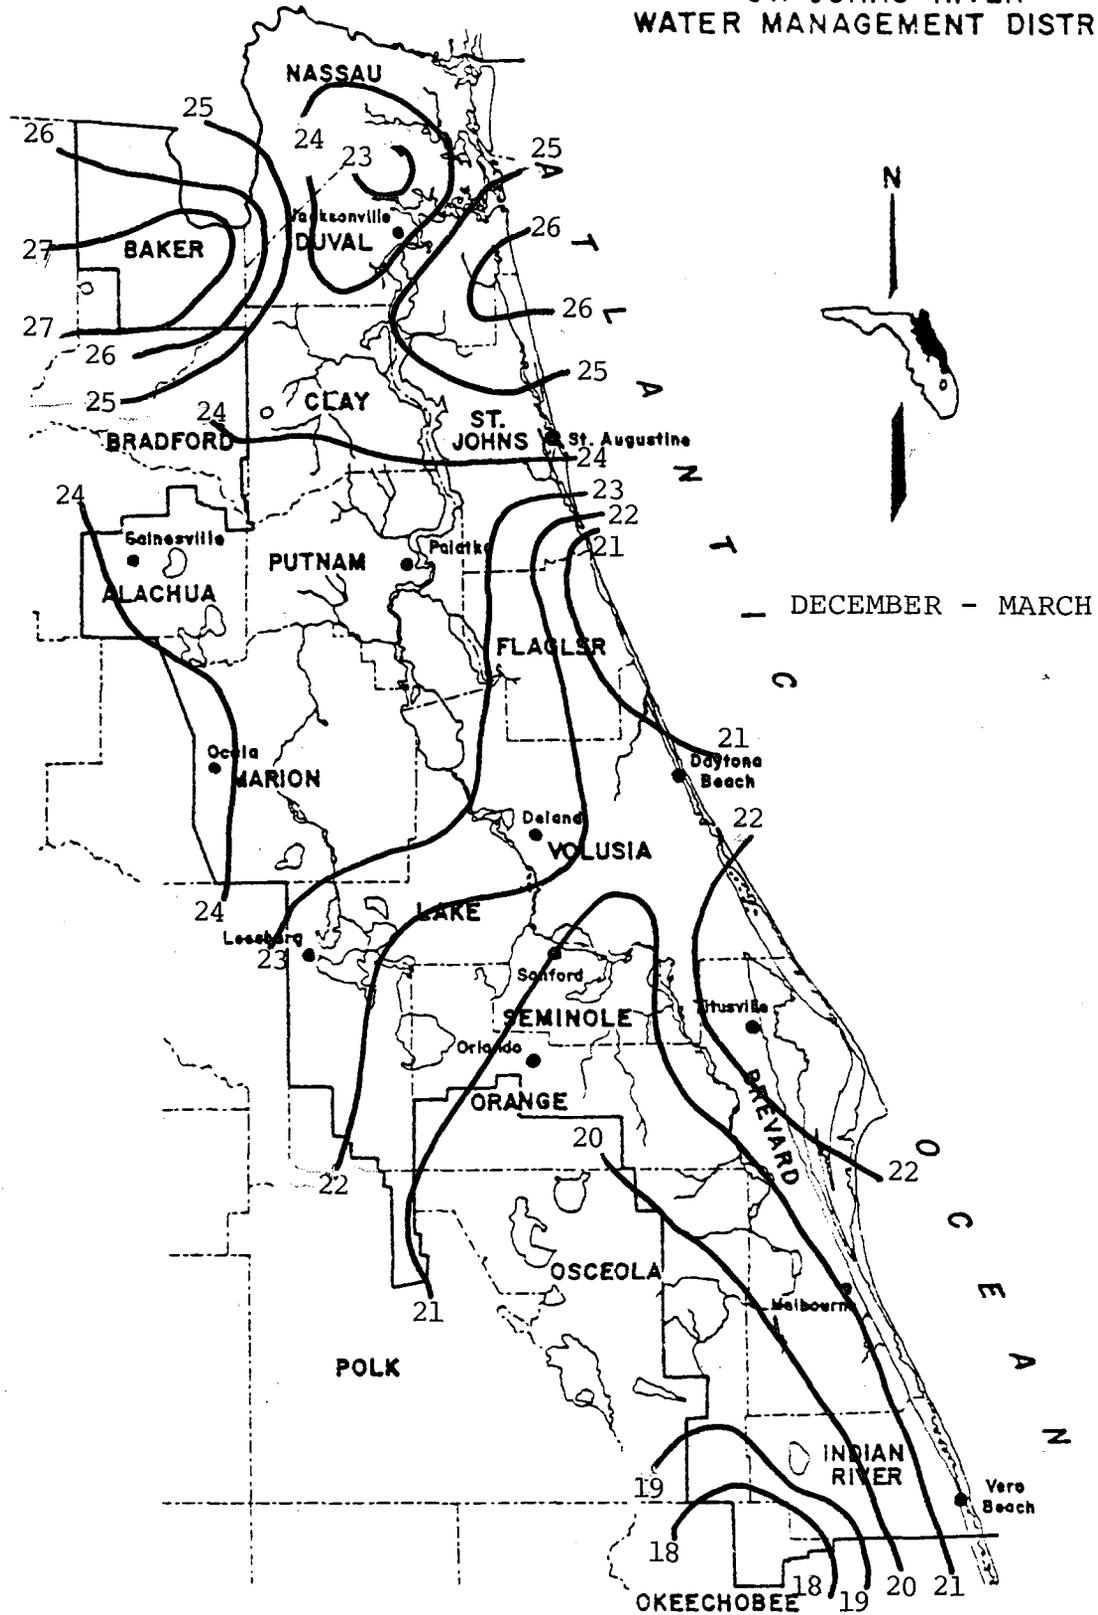


Figure 30. Cold season maximum rainfall, inches, T = 50 yr

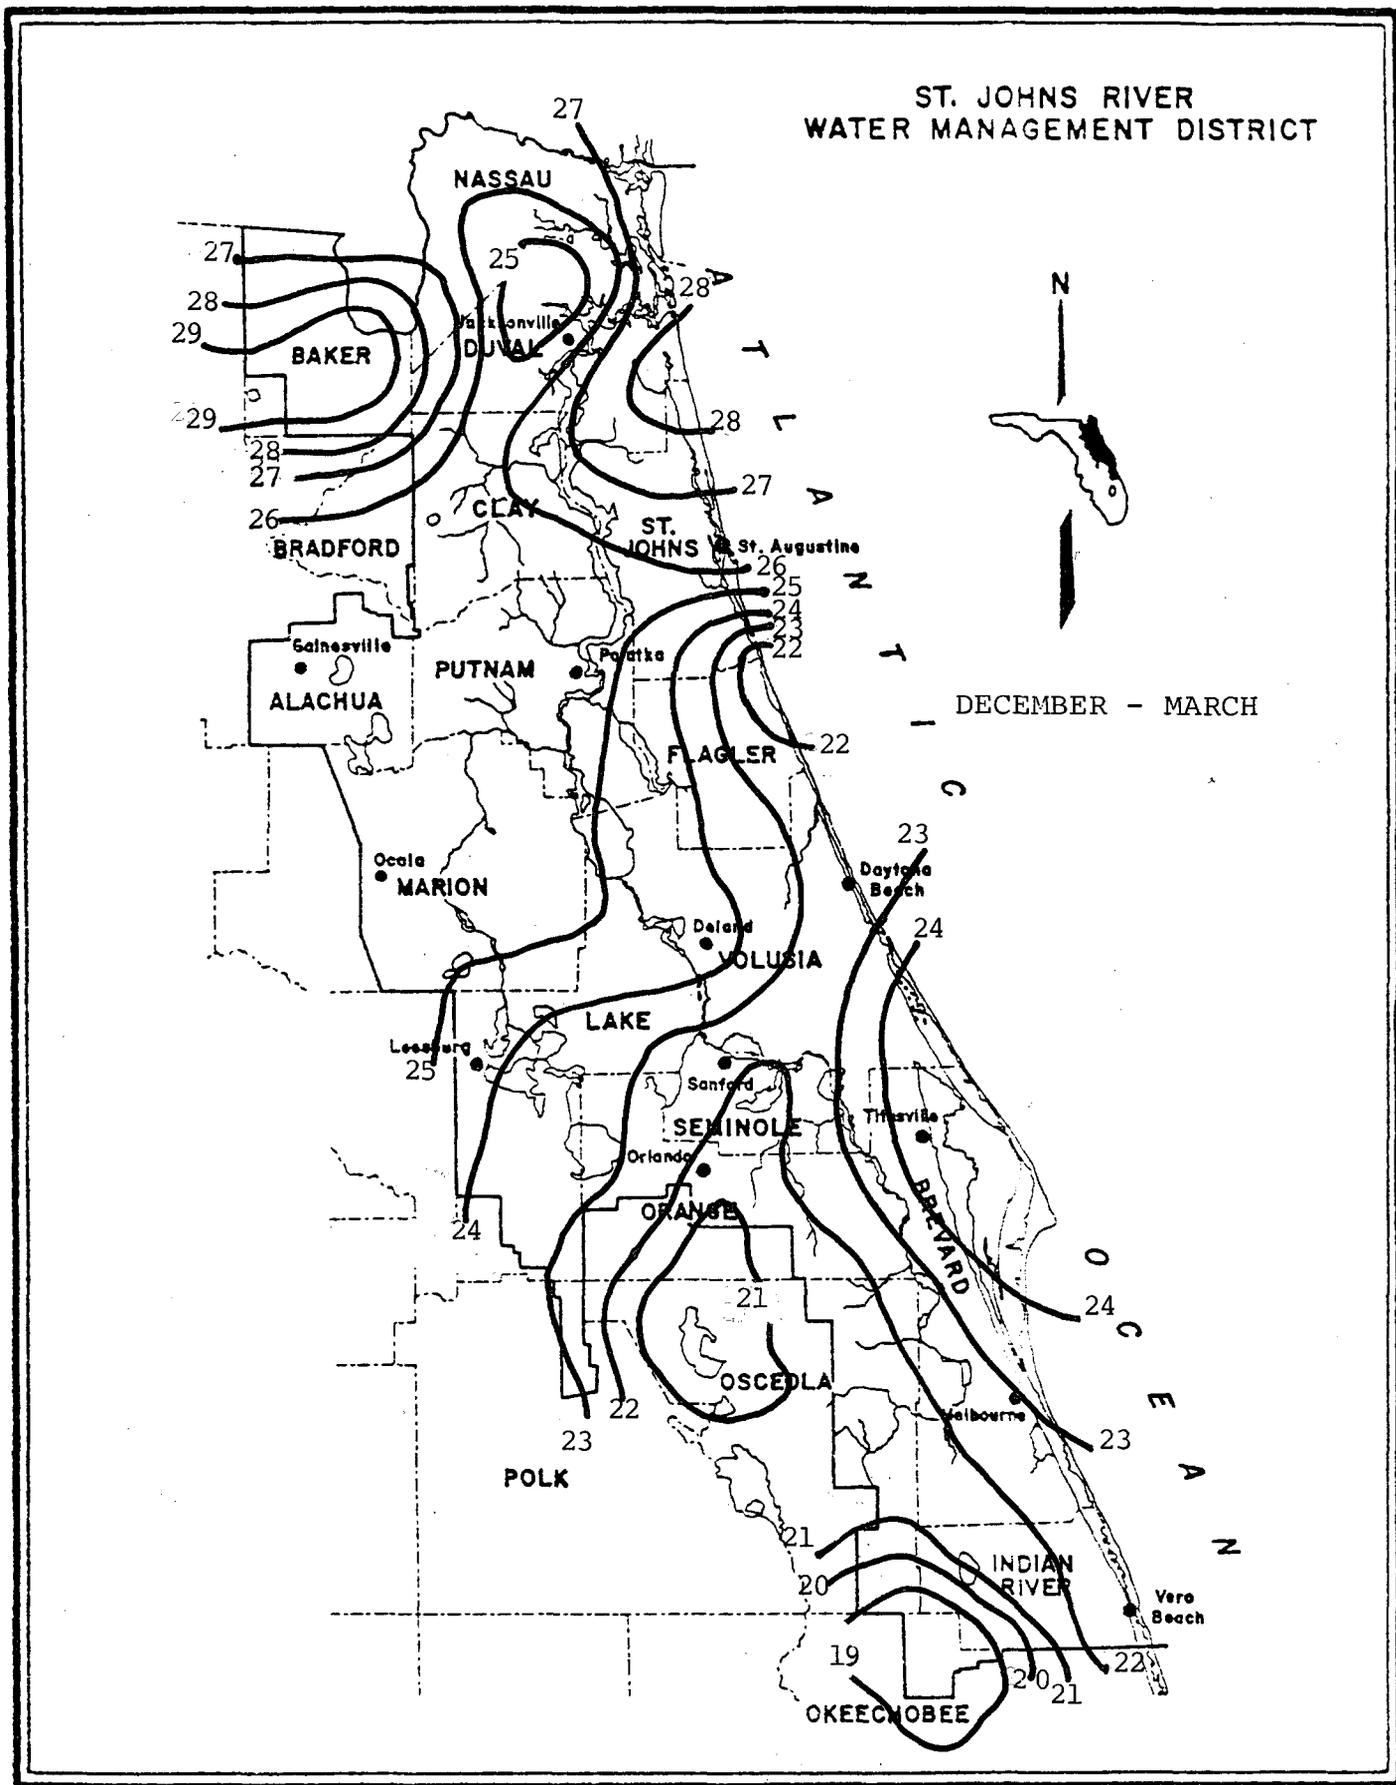


Figure 31. Cold season maximum rainfall, inches, T = 100 yr

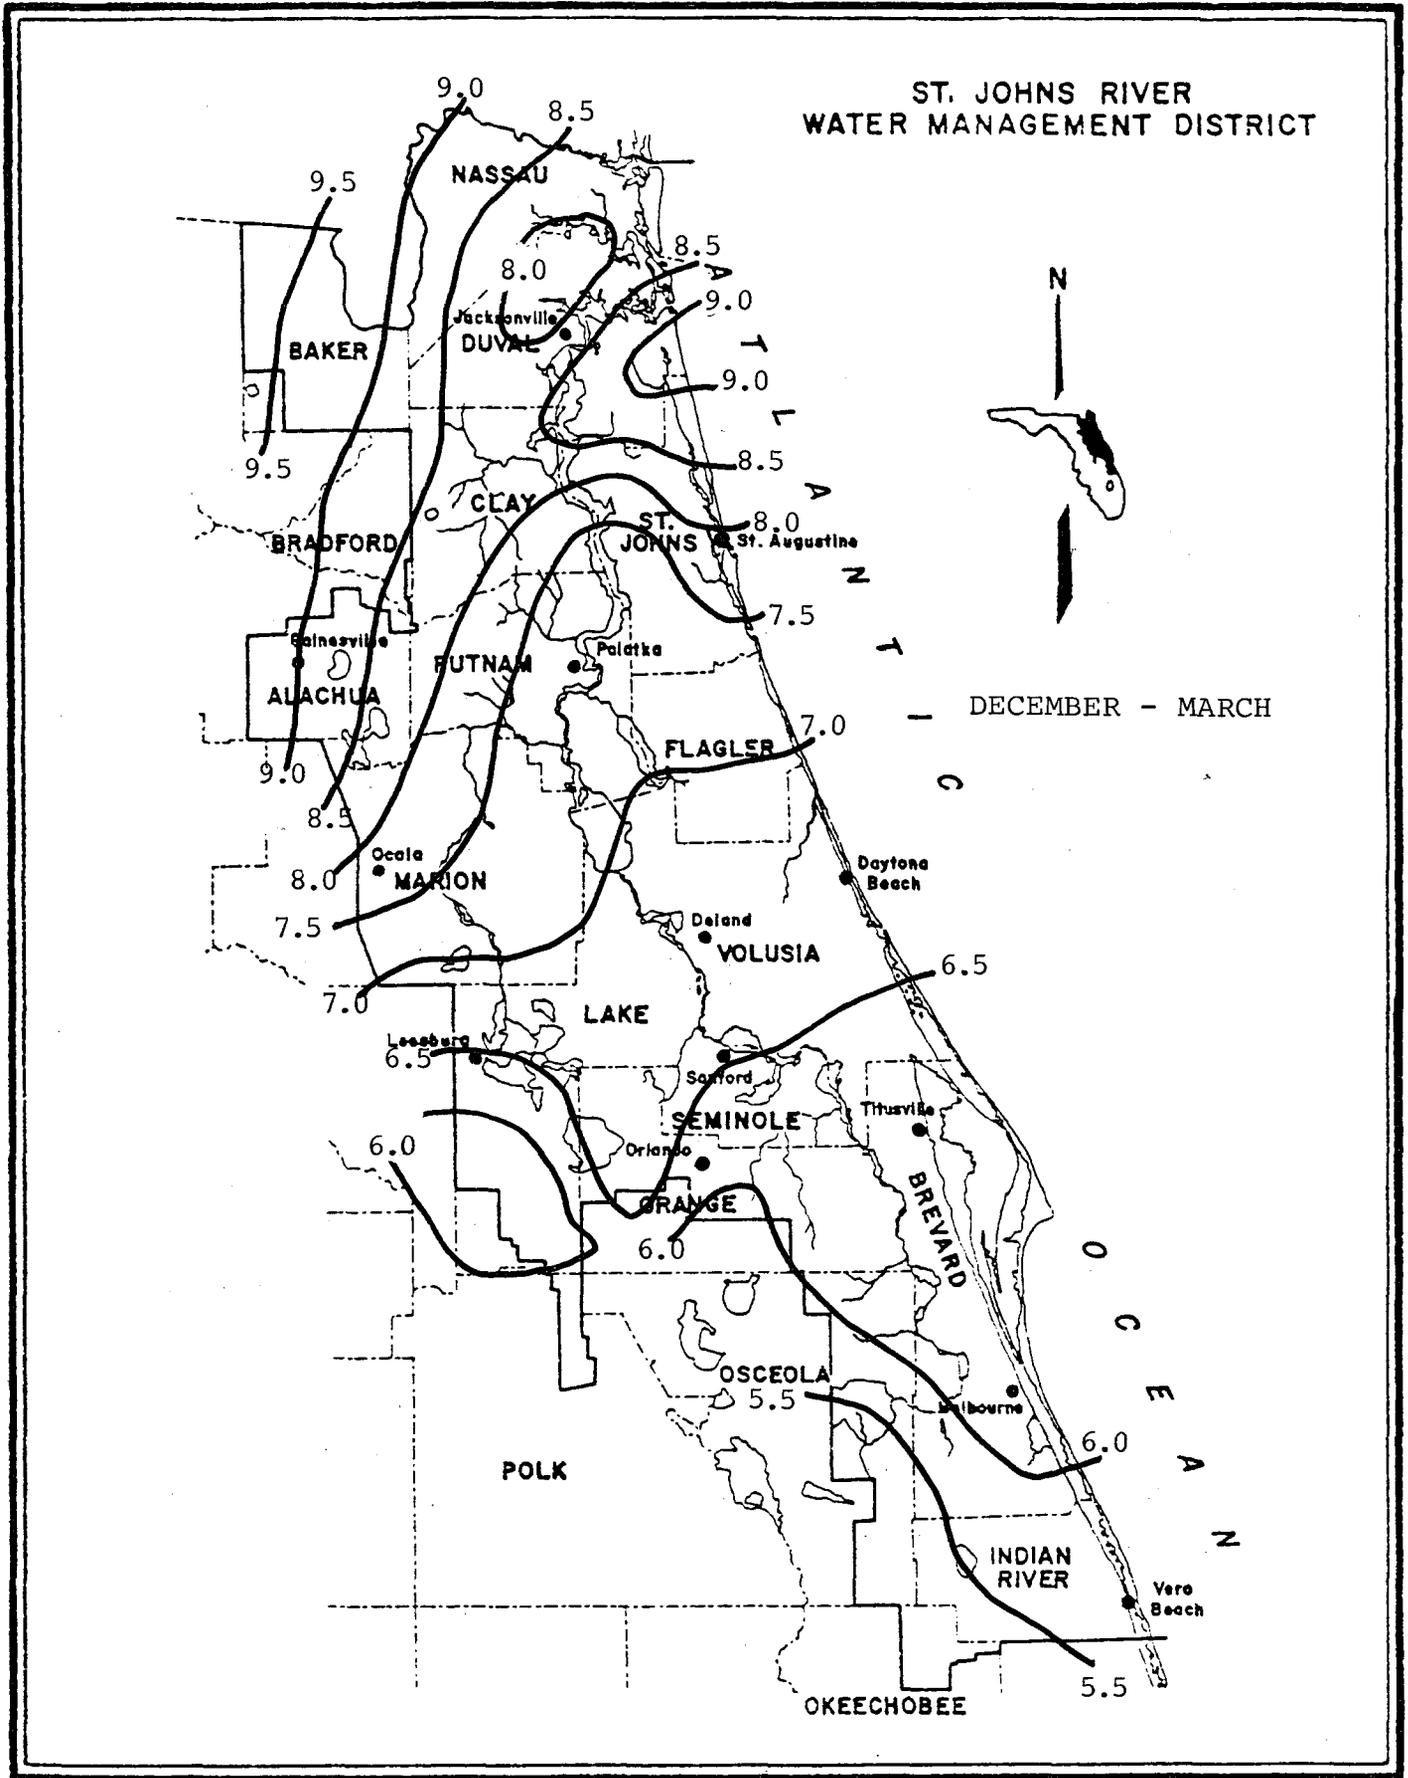


Figure 32. - Cold season minimum rainfall, inches, T = 5 yr

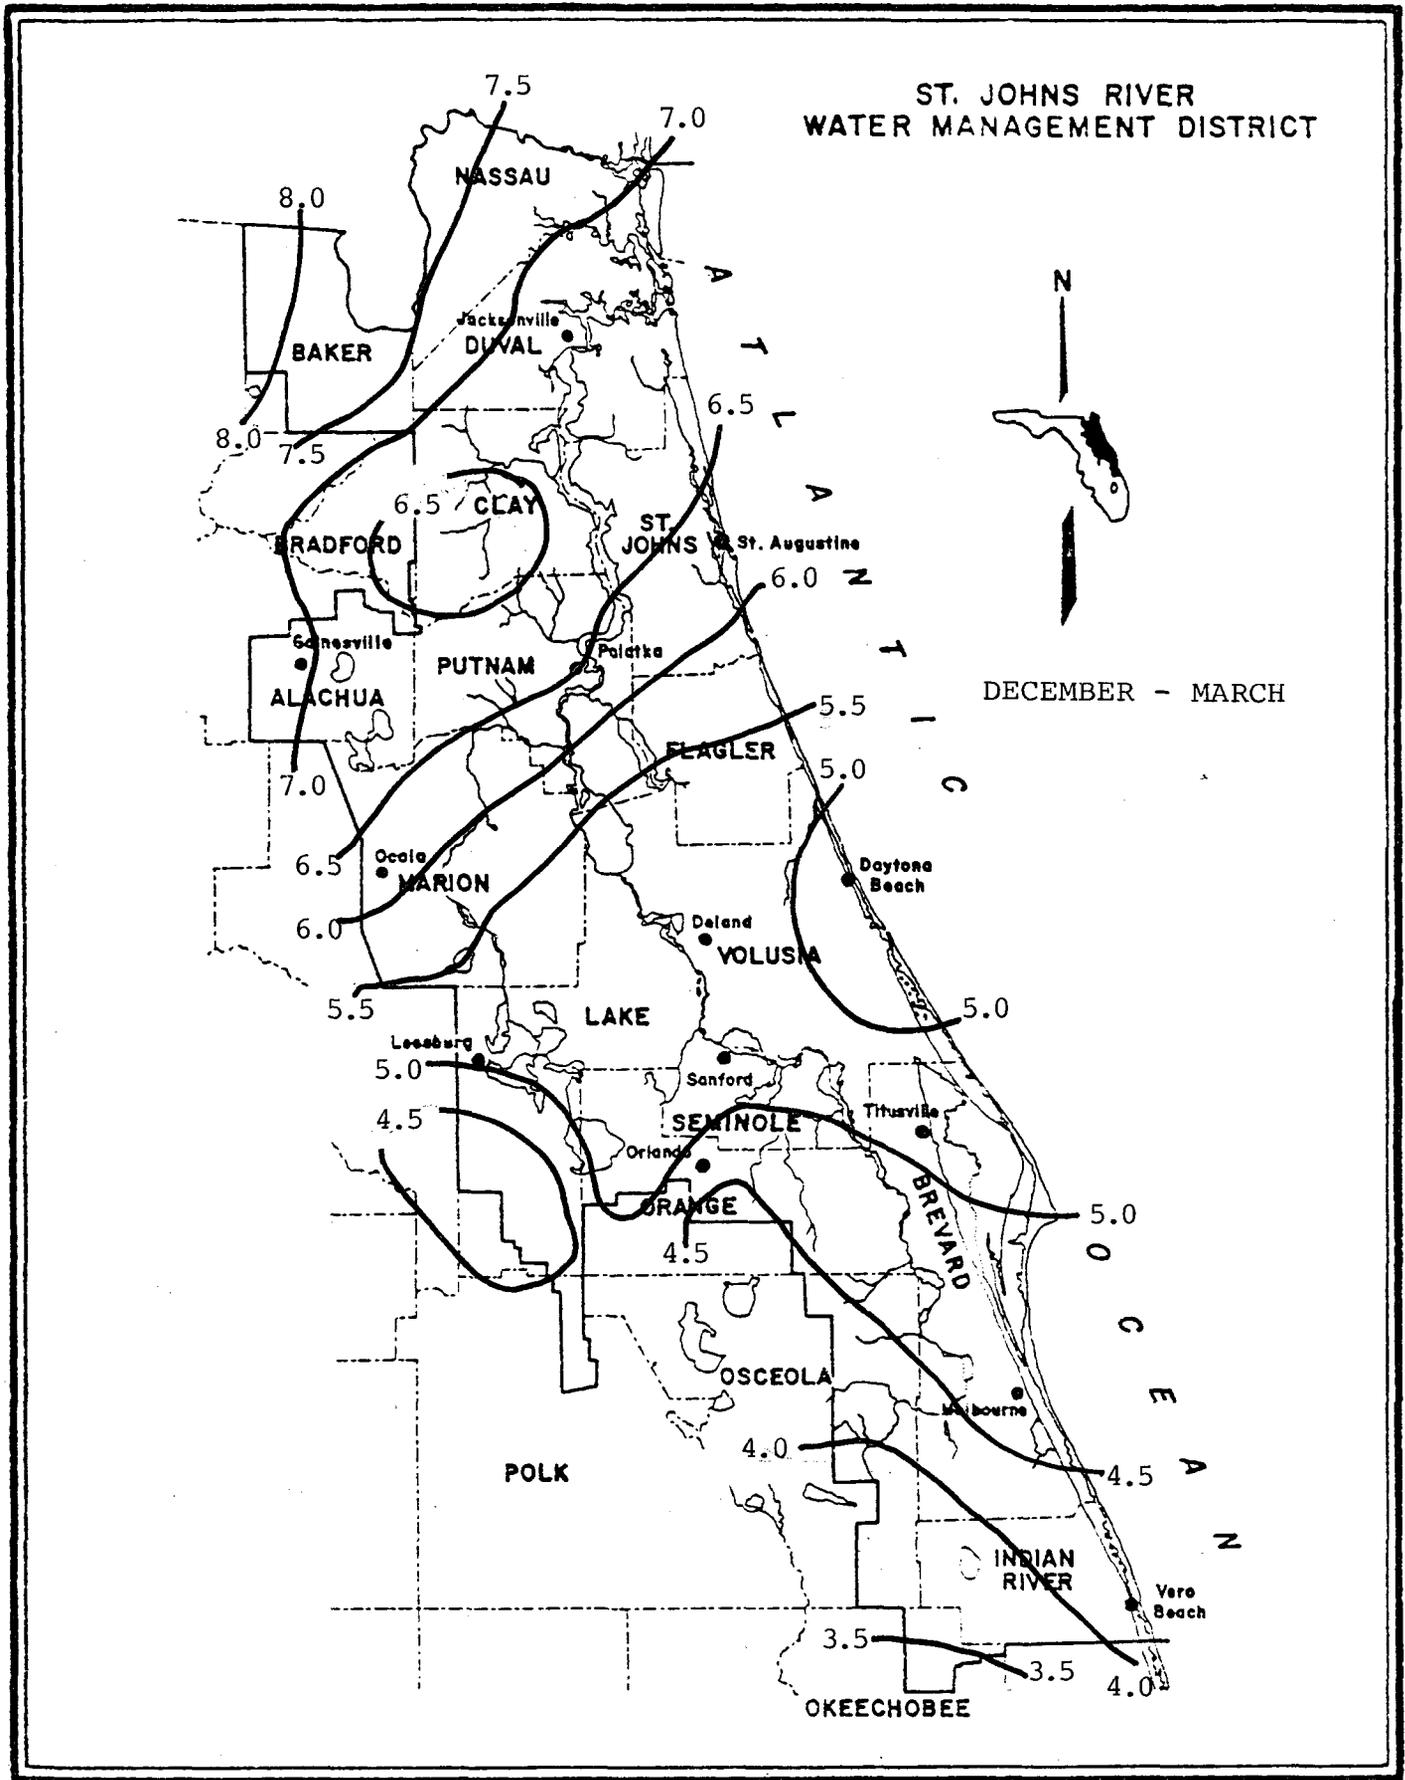


Figure 33. Cold season minimum rainfall, inches, T = -10 yr.

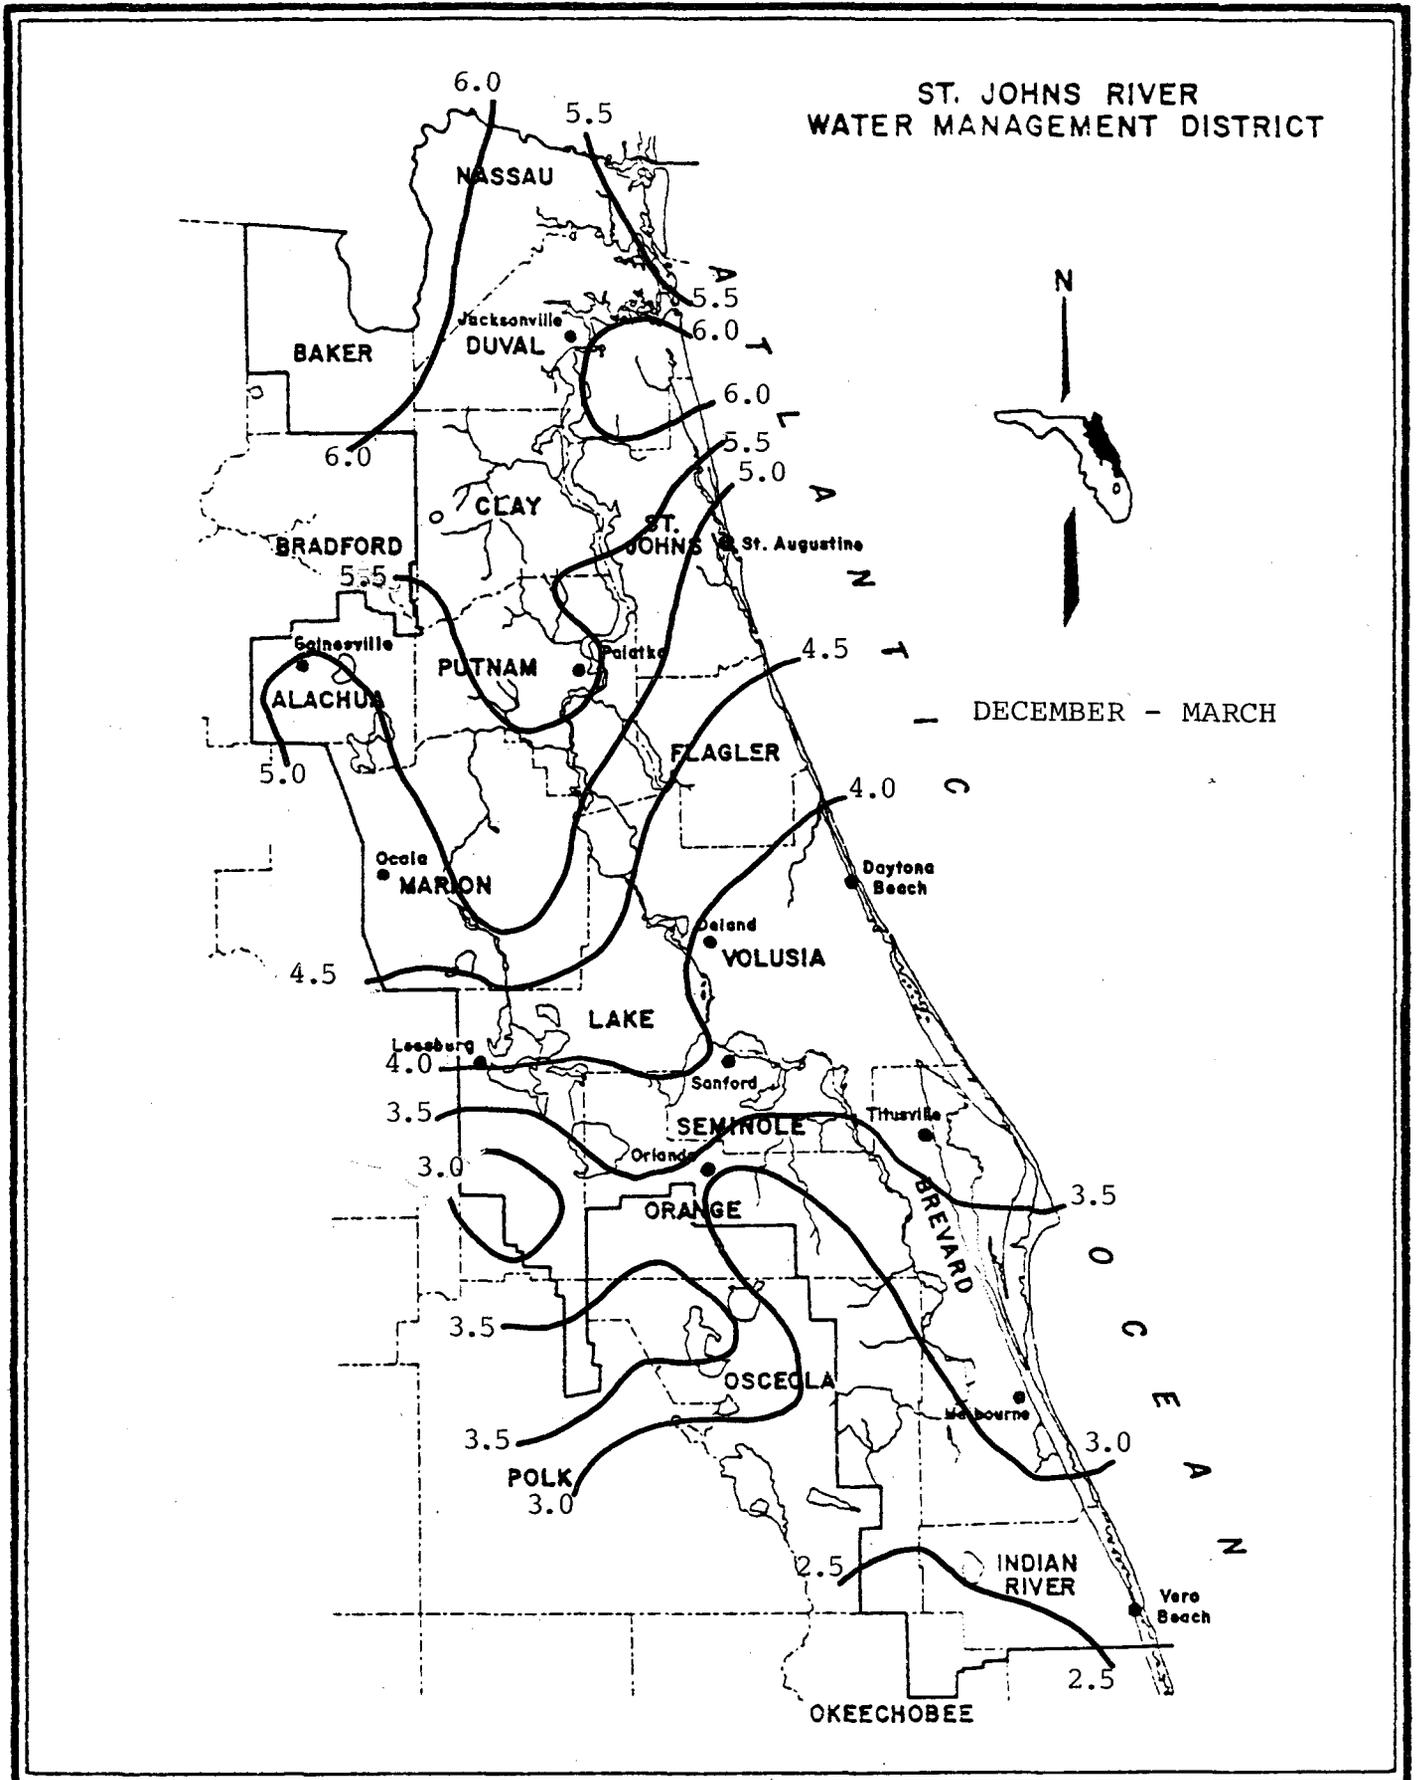


Figure 34. Cold season minimum rainfall, inches, T = 25 yr

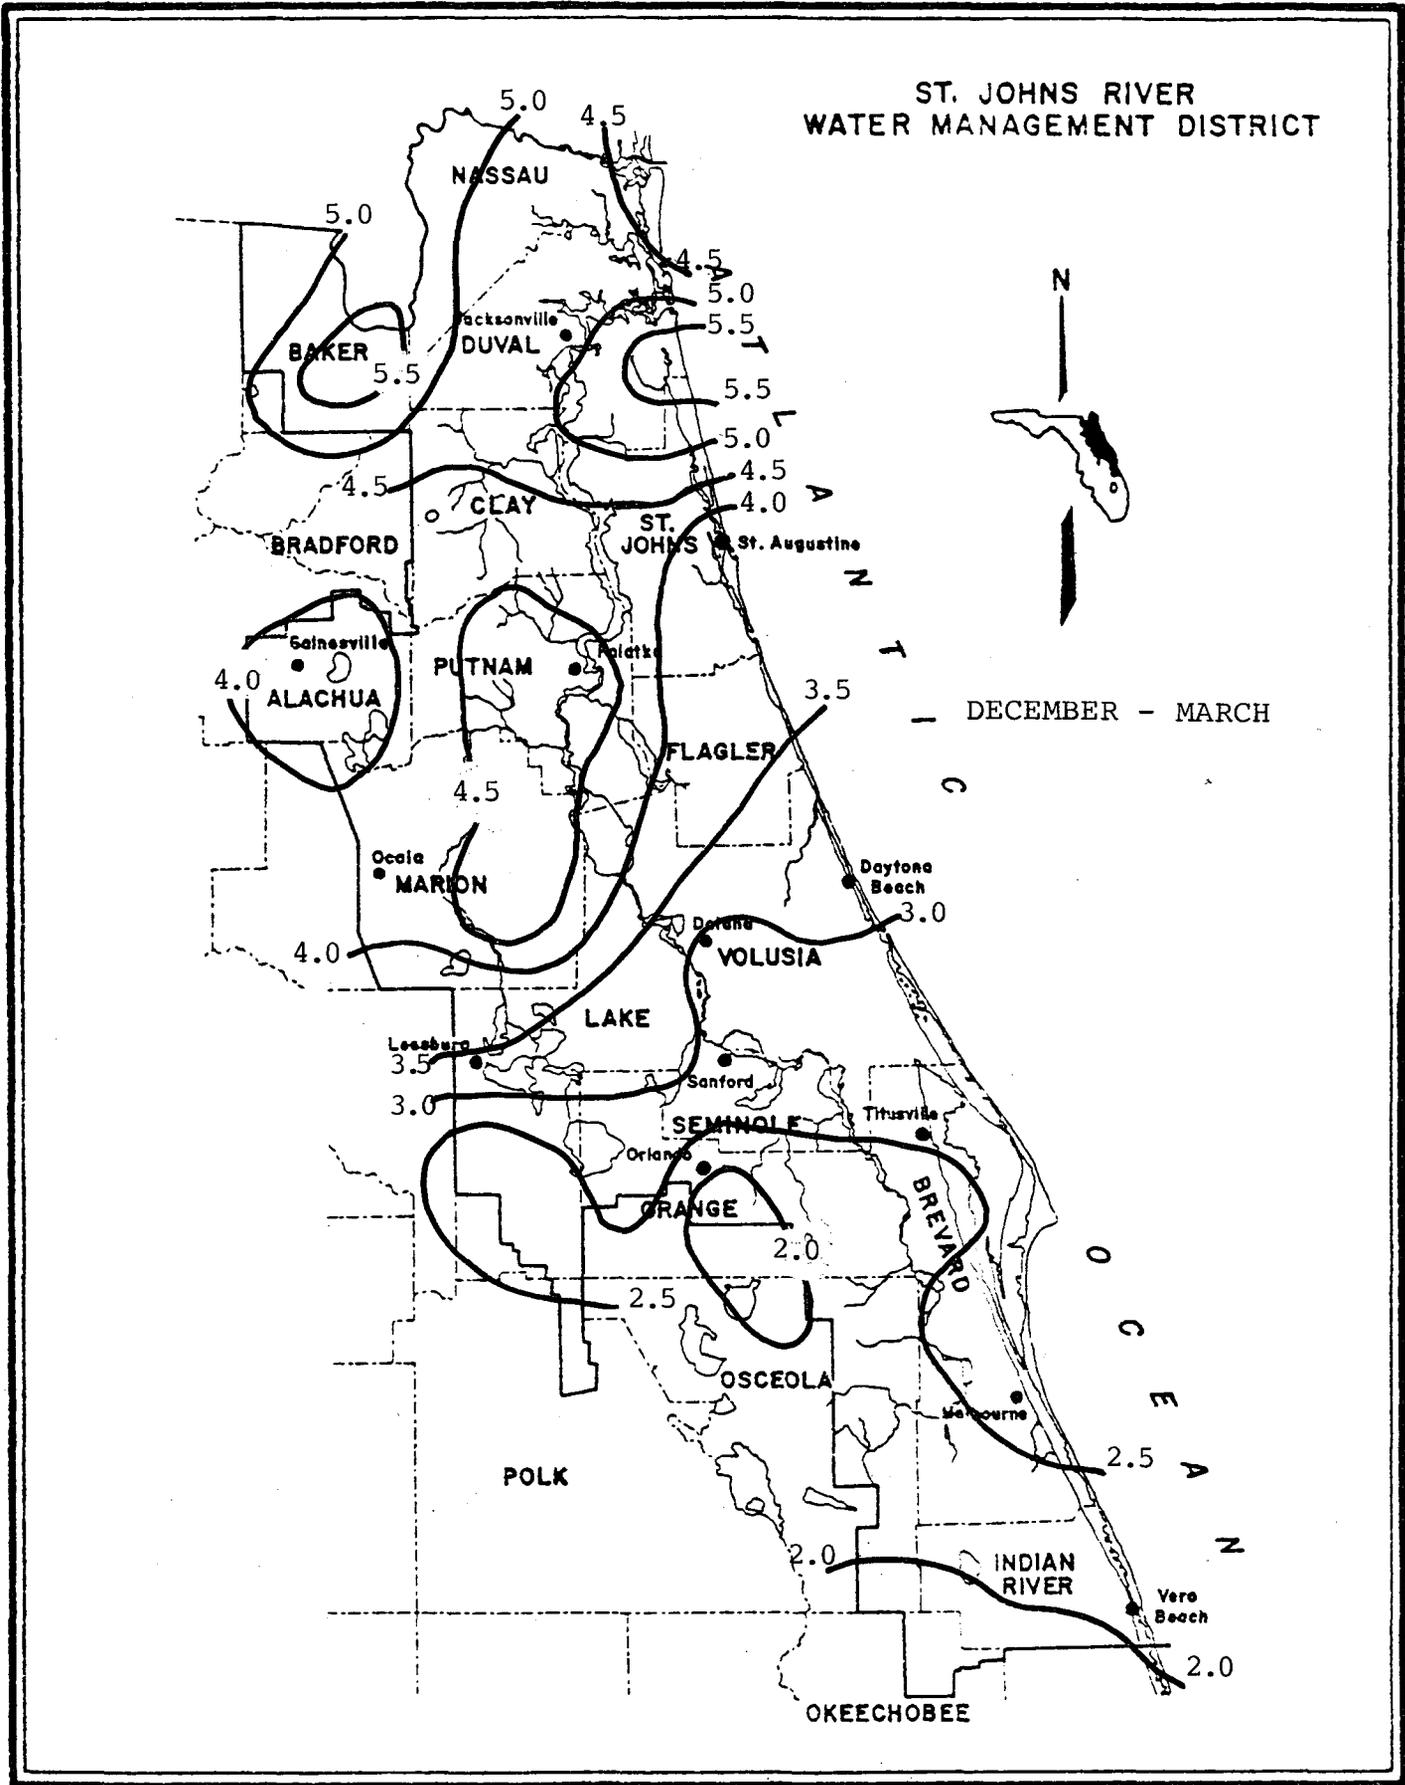


Figure 35. Cold season minimum rainfall, inches, T = 50 yr

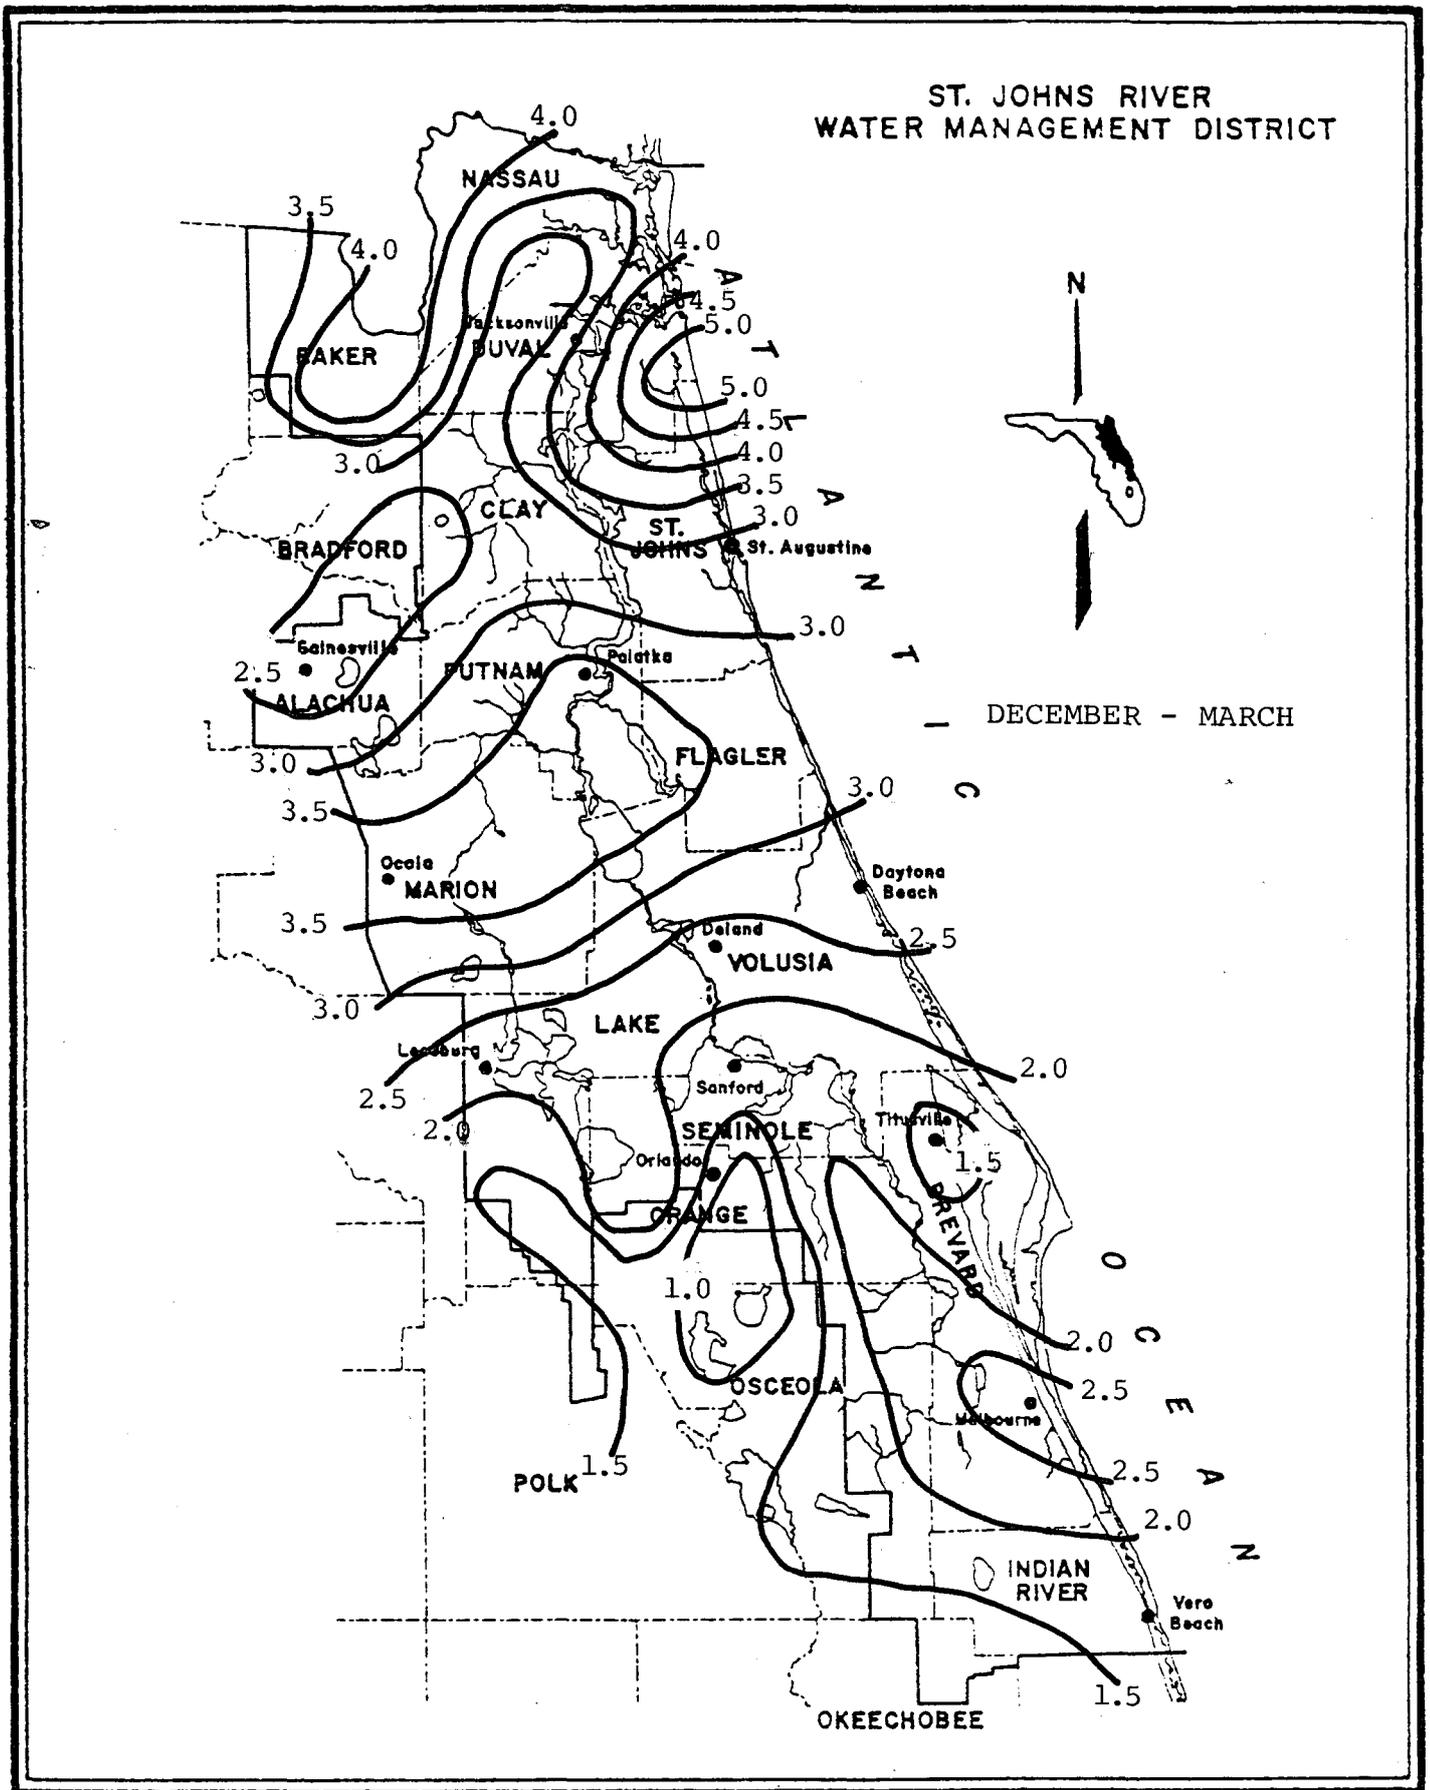


Figure 36. Cold season minimum rainfall, inches, T = 100 yr